



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**17 MCCORMACK TORONTO, BASEMENT MAINSTAY HOUSING U607924X**

Component  
**Rear Diesel Engine**

Fluid  
**ESSO XD-3 EXTRA 15W40 (10 LTR)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>PN0005940</b>	PN0004741	PN0003379
Sample Date		Client Info		<b>03 Apr 2024</b>	16 Mar 2023	18 Mar 2022
Machine Age	hrs	Client Info		<b>344</b>	340	330
Oil Age	hrs	Client Info		<b>3</b>	10	0
Filter Age	hrs	Client Info		<b>3</b>	10	0
Oil Changed		Client Info		<b>Changed</b>	Changed	Not Changd
Filter Changed		Client Info		<b>Changed</b>	Changed	Not Changd
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>250	<b>1</b>	1	2
Chromium	ppm	ASTM D5185(m)	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>5	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>35	<b>1</b>	3	3
Lead	ppm	ASTM D5185(m)	>100	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185(m)	>60	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
White Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---

**CONTAMINATION**











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>35	<b>4</b>	8	6
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	<1
Fuel		WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	ASTM D7844*	>3	<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>4.8</b>	6.6	2.9
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>17.4</b>	19.1	9.1
Silt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Debris	scalar	Visual*	NONE	<b>VLITE</b>	---	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	<b>1</b>	3	2
Boron	ppm	ASTM D5185(m)		<b>16</b>	72	74
Barium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)		<b>61</b>	82	73
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)		<b>762</b>	33	127
Calcium	ppm	ASTM D5185(m)	3780	<b>1255</b>	2198	1997
Phosphorus	ppm	ASTM D5185(m)	1370	<b>998</b>	1068	966
Zinc	ppm	ASTM D5185(m)	1500	<b>1159</b>	1115	1092
Sulfur	ppm	ASTM D5185(m)	3800	<b>2721</b>	3211	3009
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>13.1</b>	12.1	5.8
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	<b>14.7</b>	14.7	14.3

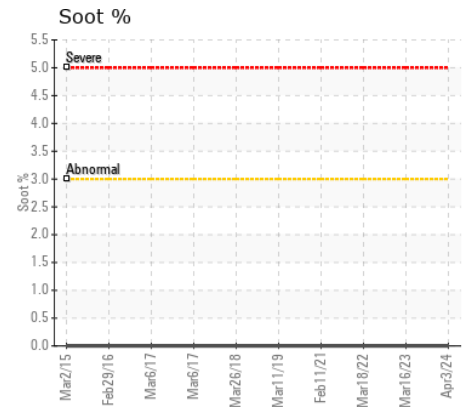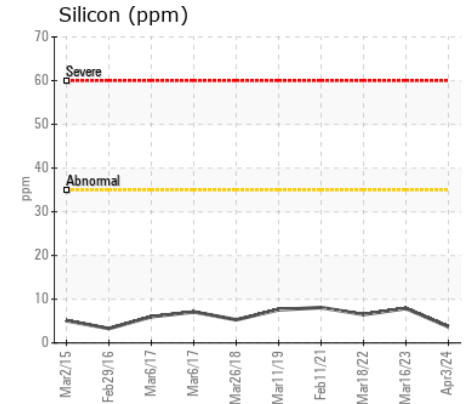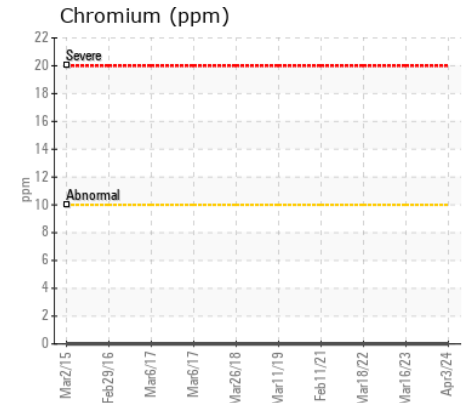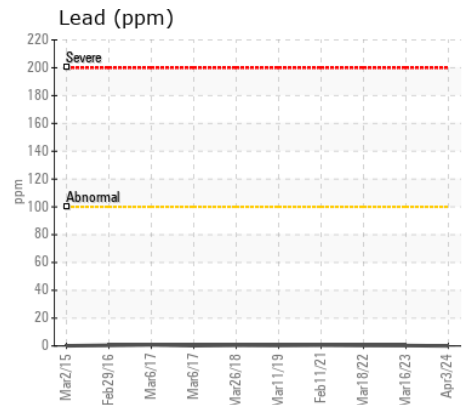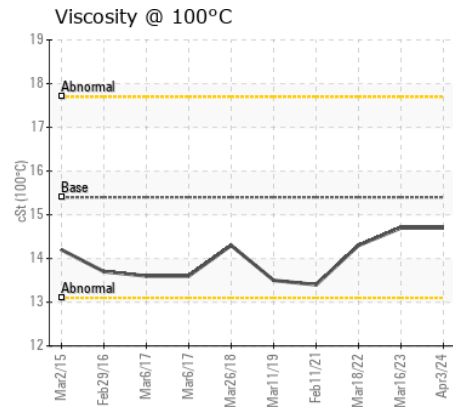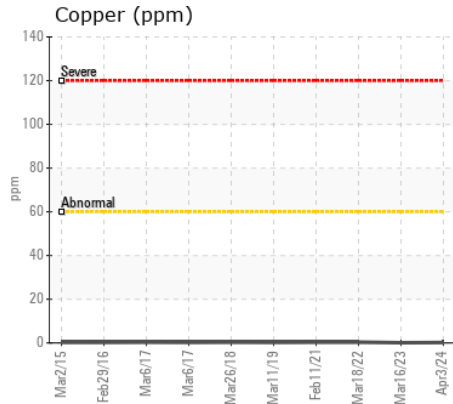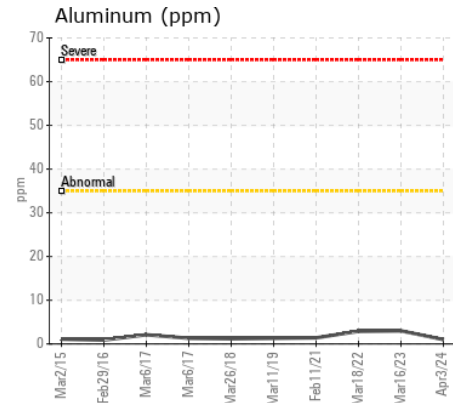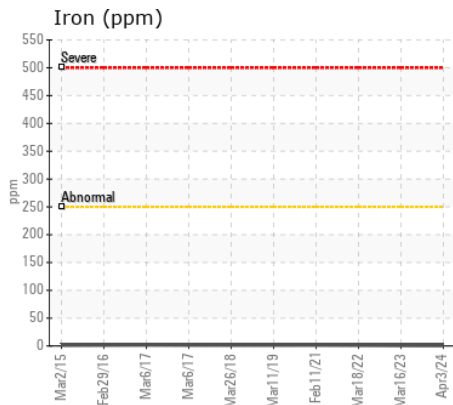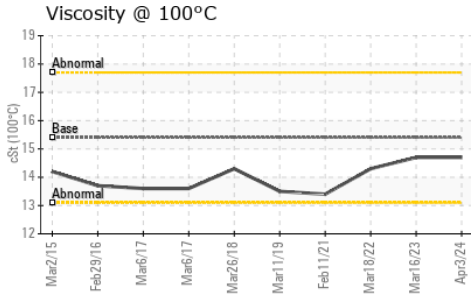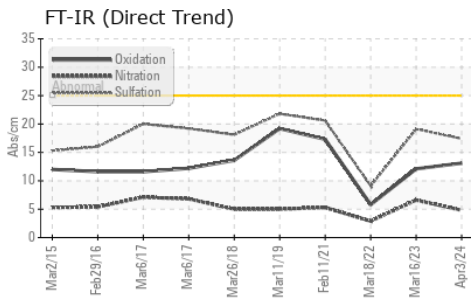

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PN0005940 **Received** : 09 Apr 2024  
**Lab Number** : 02627569 **Tested** : 09 Apr 2024  
**Unique Number** : 5760701 **Diagnosed** : 09 Apr 2024 - Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: Visual )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**POWER STATION INC.**  
 1050 JAYSON COURT  
 MISSISSAUGA, ON  
 CA L4W 2V5  
 Contact: Ryan Udall  
 rudall@pwrstn.com  
 T: (905)565-1621  
 F: (905)629-1499