



**POWER SYSTEMS**  
**SYSTÈMES DE PUISSANCE**

OIL ANALYSIS REPORT

|                 |               |
|-----------------|---------------|
| WEAR            | <b>NORMAL</b> |
| CONTAMINATION   | <b>NORMAL</b> |
| FLUID CONDITION | <b>NORMAL</b> |

Area

[6100274428]

Machine Id

GENERAC TW3H00130

Component

Diesel Engine

Fluid

SHELL ROTELLA T 15W40 (--- GAL)

**RECOMMENDATION**

Resample at the next service interval to monitor.

| Test           | UOM | Method      | Limit/Abn | Current     | History1 | History2 |
|----------------|-----|-------------|-----------|-------------|----------|----------|
| Sample Number  |     | Client Info |           | WA0021304   | ---      | ---      |
| Sample Date    |     | Client Info |           | 05 Apr 2024 | ---      | ---      |
| Machine Age    | hrs | Client Info |           | 481         | ---      | ---      |
| Oil Age        | hrs | Client Info |           | 0           | ---      | ---      |
| Filter Age     | hrs | Client Info |           | 0           | ---      | ---      |
| Oil Changed    |     | Client Info |           | Changed     | ---      | ---      |
| Filter Changed |     | Client Info |           | Changed     | ---      | ---      |
| Sample Status  |     |             |           | NORMAL      | ---      | ---      |

**WEAR**

Metal levels are typical for a new component breaking in.

|          |     |               |      |    |     |     |
|----------|-----|---------------|------|----|-----|-----|
| Iron     | ppm | ASTM D5185(m) | >100 | 2  | --- | --- |
| Chromium | ppm | ASTM D5185(m) | >20  | 0  | --- | --- |
| Nickel   | ppm | ASTM D5185(m) | >4   | 0  | --- | --- |
| Titanium | ppm | ASTM D5185(m) |      | 0  | --- | --- |
| Silver   | ppm | ASTM D5185(m) | >3   | 0  | --- | --- |
| Aluminum | ppm | ASTM D5185(m) | >20  | <1 | --- | --- |
| Lead     | ppm | ASTM D5185(m) | >40  | 0  | --- | --- |
| Copper   | ppm | ASTM D5185(m) | >330 | <1 | --- | --- |
| Tin      | ppm | ASTM D5185(m) | >15  | 0  | --- | --- |
| Vanadium | ppm | ASTM D5185(m) |      | 0  | --- | --- |

**CONTAMINATION**












There is no indication of any contamination in the oil.

|                  |          |               |      |      |     |     |
|------------------|----------|---------------|------|------|-----|-----|
| Silicon          | ppm      | ASTM D5185(m) | >25  | 3    | --- | --- |
| Potassium        | ppm      | ASTM D5185(m) | >20  | 7    | --- | --- |
| Fuel             |          | WC Method     | >5   | <1.0 | --- | --- |
| Water            |          | WC Method     | >0.2 | NEG  | --- | --- |
| Glycol           | %        | ASTM D7922*   |      | 0.0  | --- | --- |
| Soot %           | %        | ASTM D7844*   | >3   | 0    | --- | --- |
| Nitration        | Abs/cm   | ASTM D7624*   | >20  | 5.4  | --- | --- |
| Sulfation        | Abs/.1mm | ASTM D7415*   | >30  | 20.2 | --- | --- |
| Emulsified Water | scalar   | Visual*       | >0.2 | NEG  | --- | --- |

**FLUID CONDITION**

The condition of the oil is acceptable for the time in service.

|              |          |               |      |      |     |     |
|--------------|----------|---------------|------|------|-----|-----|
| Sodium       | ppm      | ASTM D5185(m) |      | 2    | --- | --- |
| Boron        | ppm      | ASTM D5185(m) | 35   | 182  | --- | --- |
| Barium       | ppm      | ASTM D5185(m) | 0    | 0    | --- | --- |
| Molybdenum   | ppm      | ASTM D5185(m) | 0    | 0    | --- | --- |
| Manganese    | ppm      | ASTM D5185(m) | 0    | 0    | --- | --- |
| Magnesium    | ppm      | ASTM D5185(m) | 10   | 15   | --- | --- |
| Calcium      | ppm      | ASTM D5185(m) | 2340 | 2143 | --- | --- |
| Phosphorus   | ppm      | ASTM D5185(m) | 1110 | 959  | --- | --- |
| Zinc         | ppm      | ASTM D5185(m) | 1210 | 1110 | --- | --- |
| Sulfur       | ppm      | ASTM D5185(m) | 3890 | 2966 | --- | --- |
| Oxidation    | Abs/.1mm | ASTM D7414*   | >25  | 16.1 | --- | --- |
| Visc @ 100°C | cSt      | ASTM D7279(m) | 15.7 | 14.5 | --- | --- |

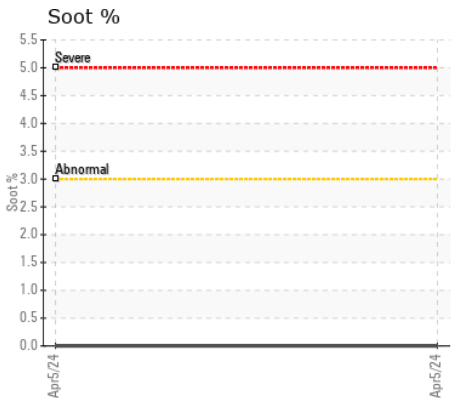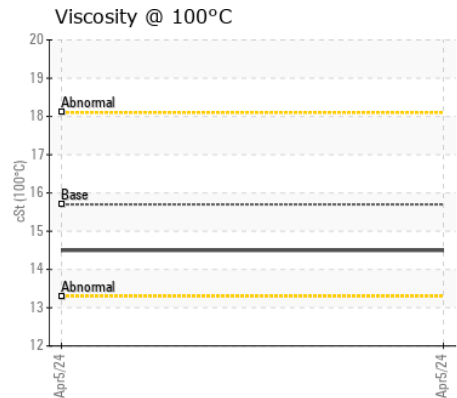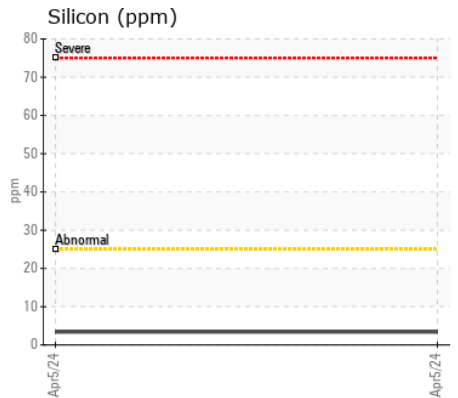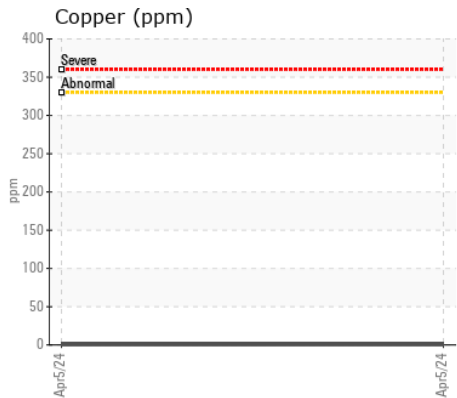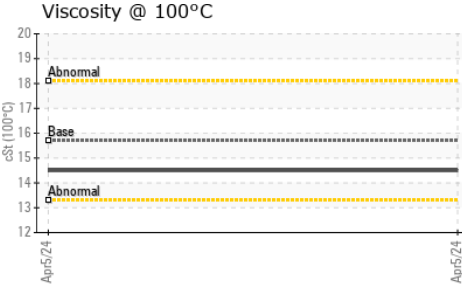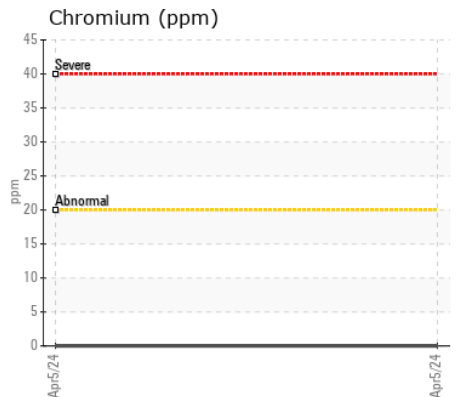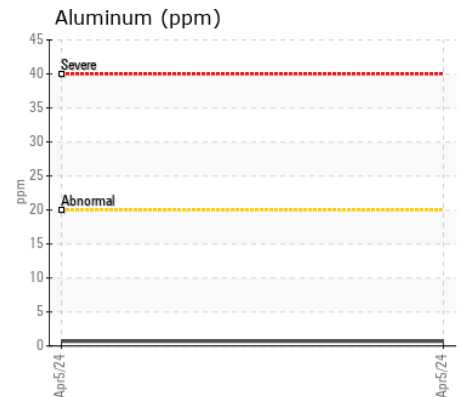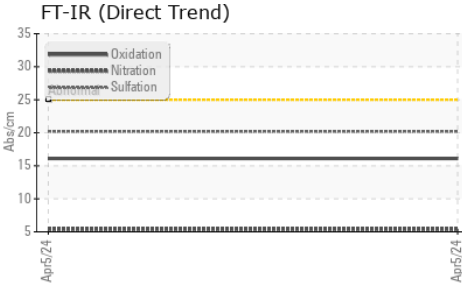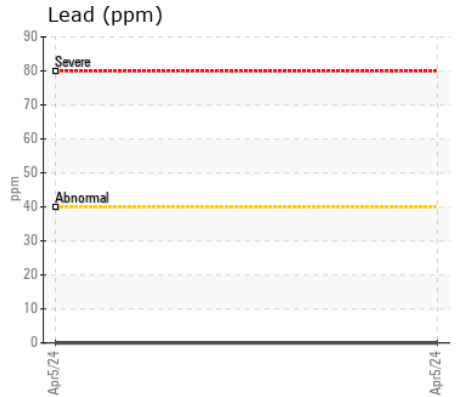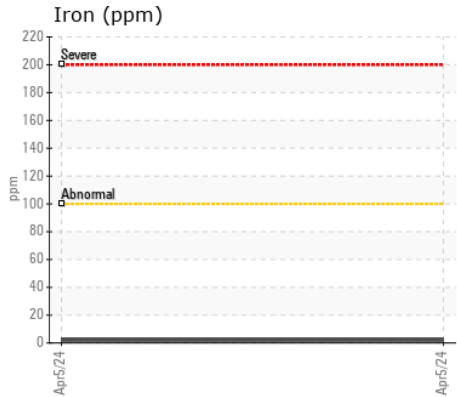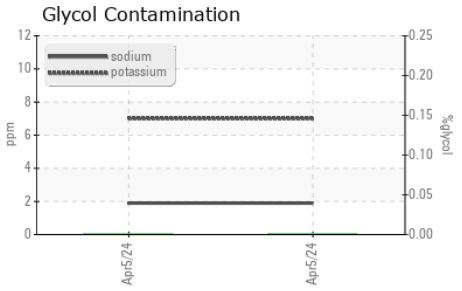

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WA0021304 **Received** : 09 Apr 2024  
**Lab Number** : 02627610 **Tested** : 09 Apr 2024  
**Unique Number** : 5760742 **Diagnosed** : 09 Apr 2024 - Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: Glycol )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**Wajax Power Systems**  
 70 Raddall Avenue  
 Dartmouth, NS  
 CA B3B 1T7  
 Contact: Danelle Hoffman  
 dhoffman@wajax.com  
 T: (902)468-6200  
 F: (902)468-3325