MOB

POWERStation
WWW.POWERSTATIONGENERATORS.COM
POWER GENERATION PRODUCTS

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	SEVERE
FLUID CONDITION	SEVERE

Machine Id
117 WEST ST NAPANEE BELL CANADA 6A0260367
Component
Right Diesel Engine
Fluid
ESSO XD-3 EXTRA SAE 40 (35 LTR)

RECOMMENDATION

We advise that you check the fuel injection system. The oil change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

WEAR

Metal levels are typical for a new component breaking in.

CONTAMINATION

There is a high amount of fuel present in the oil. Tests confirm the presence of fuel in the oil.

FLUID CONDITION

Fuel is present in the oil and is lowering the viscosity. The oil is no longer serviceable due to the presence of contaminants.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005993	PN0004646	PN0003032
Sample Date		Client Info		08 Apr 2024	19 Apr 2023	08 Feb 2022
Machine Age	hrs	Client Info		431	422	391
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Not Changd	Changed	Changed
Sample Status				SEVERE	SEVERE	SEVERE
Iron	ppm	ASTM D5185(m)	>120	1	2	3
Chromium	ppm	ASTM D5185(m)	>5	0	0	0
Nickel	ppm	ASTM D5185(m)	>4	0	<1	<1
Titanium	ppm	ASTM D5185(m)	>2	0	0	0
Silver	ppm	ASTM D5185(m)	>2	0	0	0
Aluminum	ppm	ASTM D5185(m)	>5	0	<1	<1
Lead	ppm	ASTM D5185(m)	>25	0	<1	<1
Copper	ppm	ASTM D5185(m)	>40	2	2	3
Tin	ppm	ASTM D5185(m)	>15	0	<1	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Silicon	ppm	ASTM D5185(m)	>25	3	2	2
Potassium	ppm	ASTM D5185(m)	>20	2	<1	<1
Fuel	%	ASTM D7593*	>3.0	▲ 9.6	▲ 11.9	▲ 7.3
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	▲ 0.016
Soot %	%	ASTM D7844*	>0.8	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	3.2	3.7	3.9
Sulfation	Abs/.1mm	ASTM D7415*	>30	12.4	13.1	14.6
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG
Sodium	ppm	ASTM D5185(m)		2	3	8
Boron	ppm	ASTM D5185(m)		4	14	14
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		2	11	13
Manganese	ppm	ASTM D5185(m)		0	<1	0
Magnesium	ppm	ASTM D5185(m)		669	51	34
Calcium	ppm	ASTM D5185(m)	2550	1412	3050	2895
Phosphorus	ppm	ASTM D5185(m)	1000	896	666	708
Zinc	ppm	ASTM D5185(m)	1120	1019	663	759
Sulfur	ppm	ASTM D5185(m)		2352	2150	2117
Oxidation	Abs/.1mm	ASTM D7414*	>25	5.4	4.8	5.6
Visc @ 100°C	cSt	ASTM D7279(m)	14.3	▲ 10.0	▲ 9	▲ 10.3

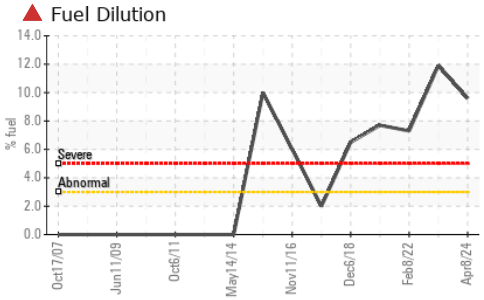

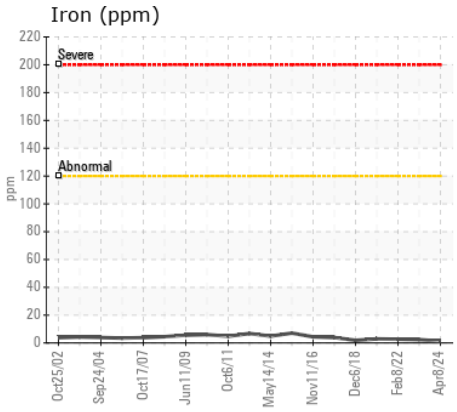

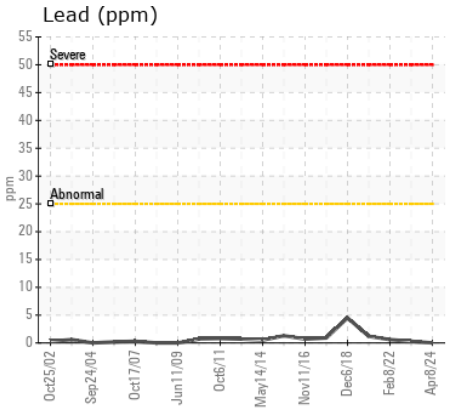

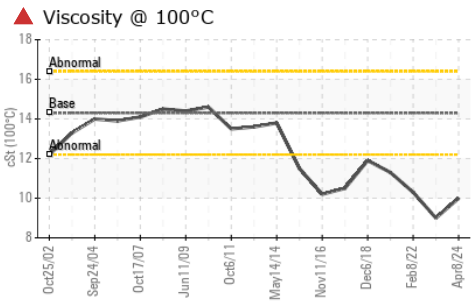

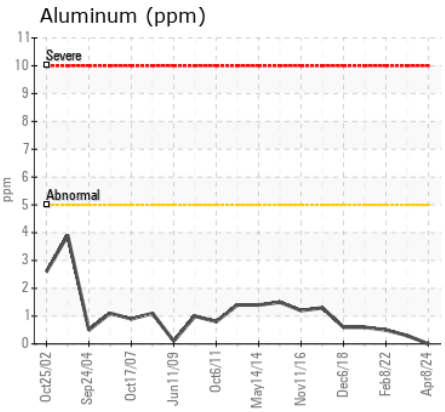

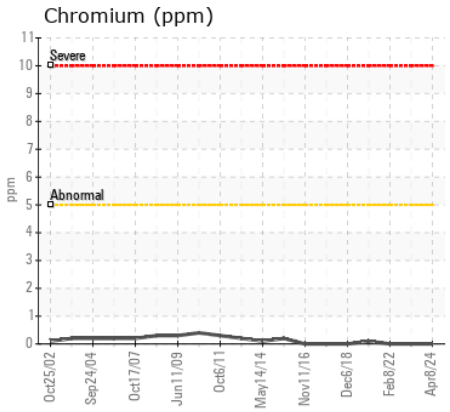

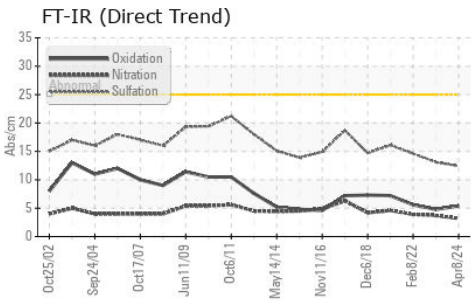

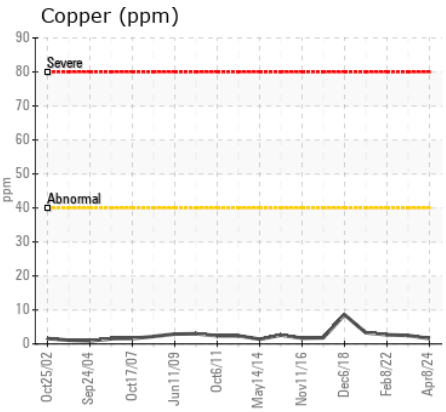

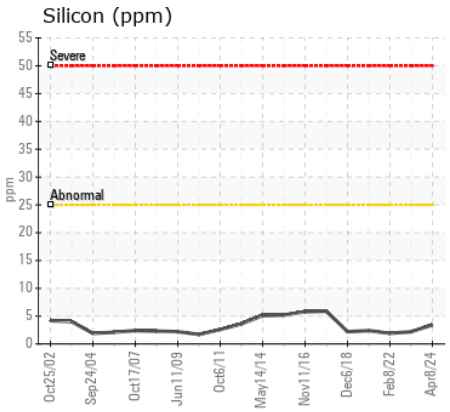

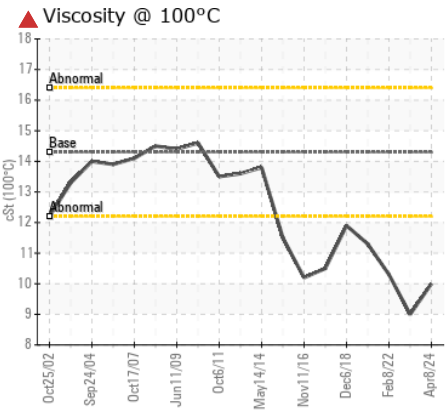

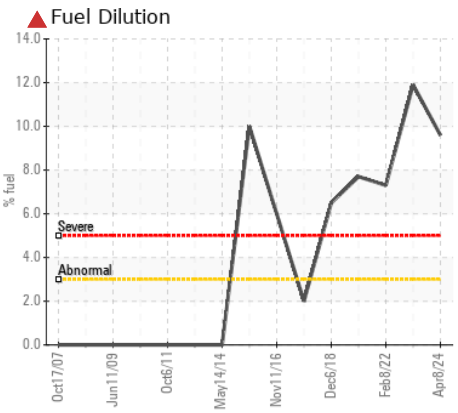

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005993 **Received** : 09 Apr 2024
Lab Number : 02627625 **Tested** : 10 Apr 2024
Unique Number : 5760757 **Diagnosed** : 10 Apr 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: PercentFuel)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

POWER STATION INC.
1050 JAYSON COURT
MISSISSAUGA, ON
CA L4W 2V5
Contact: Ryan Udall
rudall@pwrstn.com
T: (905)565-1621
F: (905)629-1499