



Machine Id
28 MINERAL RD BELLEVILLE NEXACOR NEXACOR
 Component
Left Diesel Engine
 Fluid
ESSO XD-3 EXTRA 15W40 (15 LTR)

RECOMMENDATION

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. No other corrective action is recommended at this time.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005995	---	---
Sample Date		Client Info		04 Apr 2024	---	---
Machine Age	hrs	Client Info		53	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Not Changd	---	---
Sample Status				ABNORMAL	---	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	6	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	3	---	---
Lead	ppm	ASTM D5185(m)	>40	0	---	---
Copper	ppm	ASTM D5185(m)	>330	8	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION












Light fuel dilution occurring. No other contaminants were detected in the oil.

Silicon	ppm	ASTM D5185(m)	>25	22	---	---
Potassium	ppm	ASTM D5185(m)	>20	6	---	---
Fuel	%	ASTM D7593*	>5	1	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	5.8	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	16.4	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	VLITE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

Viscosity of sample indicates oil is within SAE 30 range, advise investigate. The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	2	---	---
Boron	ppm	ASTM D5185(m)		5	---	---
Barium	ppm	ASTM D5185(m)		<1	---	---
Molybdenum	ppm	ASTM D5185(m)		0	---	---
Manganese	ppm	ASTM D5185(m)		<1	---	---
Magnesium	ppm	ASTM D5185(m)		12	---	---
Calcium	ppm	ASTM D5185(m)	3780	2433	---	---
Phosphorus	ppm	ASTM D5185(m)	1370	884	---	---
Zinc	ppm	ASTM D5185(m)	1500	1007	---	---
Sulfur	ppm	ASTM D5185(m)	3800	3125	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	10.7	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	▲ 11.2	---	---

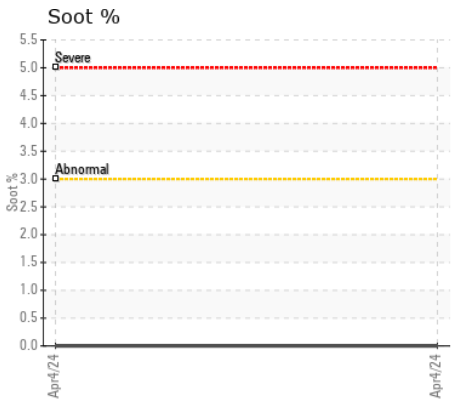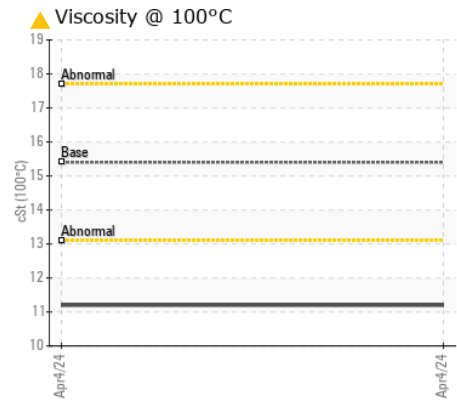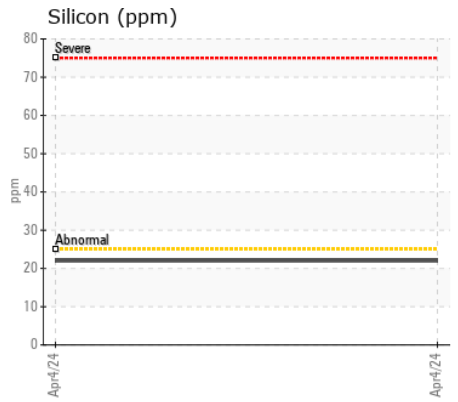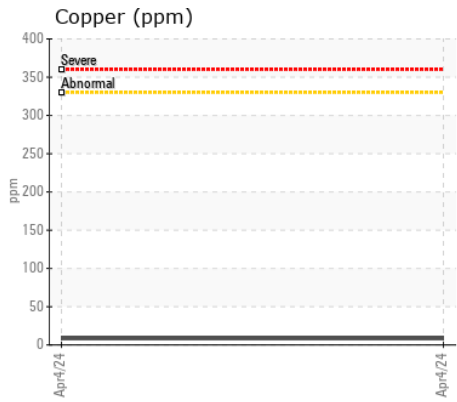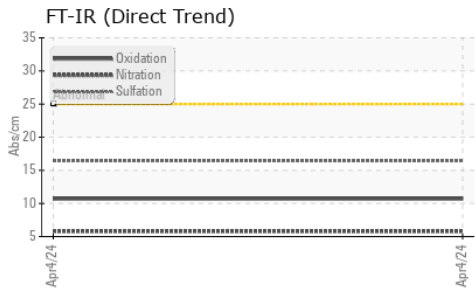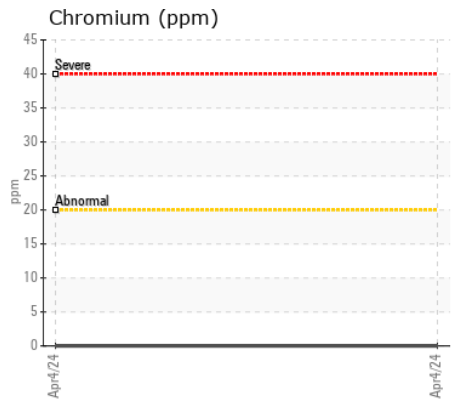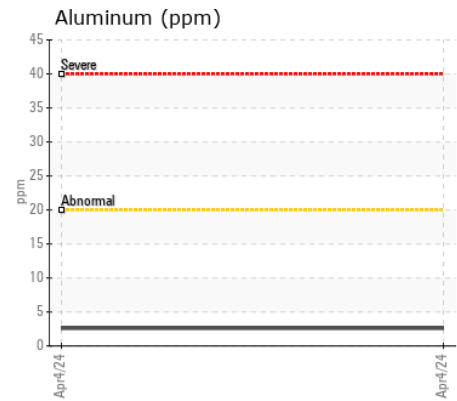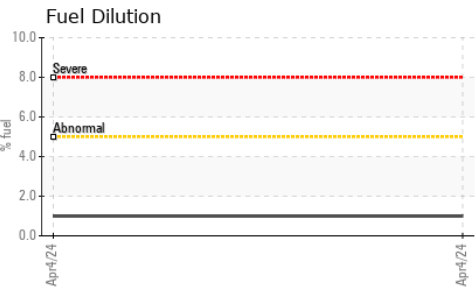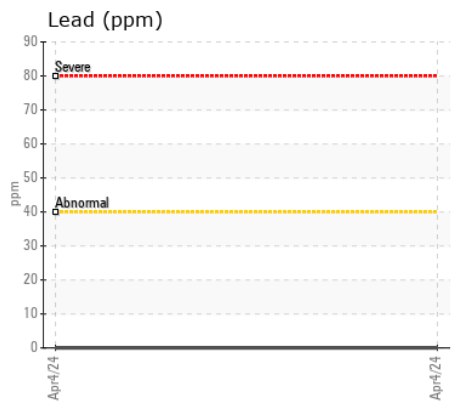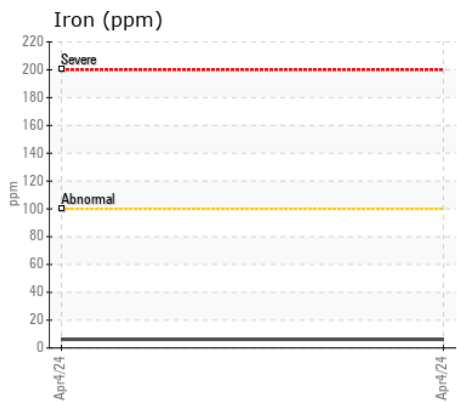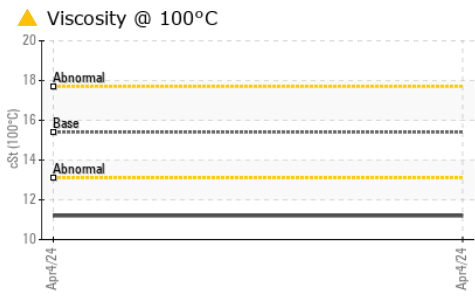

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005995 **Received** : 09 Apr 2024
Lab Number : **02627637** **Tested** : 10 Apr 2024
Unique Number : 5760769 **Diagnosed** : 10 Apr 2024 - Kevin Marson
Test Package : MOB 1 (Additional Tests: FuelDilution, PercentFuel, Visual)

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)565-8544

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.