

[4501238207] Machine Id BITZER EVERGREEN BRICKS

Screw Compressor

CIMCO TYPE A (--- GAL)

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		WC0902699	WC0669260	
	Sample Date		Client Info		22 Mar 2024	17 Mar 2022	
	Machine Age	hrs	Client Info		9067	7625	
	Oil Age	hrs	Client Info		0	0	
	Filter Age	hrs	Client Info		0	0	
	Oil Changed		Client Info		N/A	N/A	
	Filter Changed		Client Info		N/A	N/A	
	Sample Status				NORMAL	NORMAL	
WEAR	PQ		ASTM D8184*		0	0	
All component wear rates are normal.	Iron	ppm	ASTM D5185(m)		27	19	
	Chromium	ppm	ASTM D5185(m)	>4	0	0	
	Nickel	ppm	ASTM D5185(m)		0	<1	
	Titanium	ppm	ASTM D5185(m)		0	0	
	Silver	ppm	ASTM D5185(m)		0	0	
	Aluminum	ppm	ASTM D5185(m)	>5	0	0	
	Lead	ppm	ASTM D5185(m)	>10	0	0	
	Copper	ppm	ASTM D5185(m)	>30	<1	<1	
	Tin	ppm	ASTM D5185(m)	>15	0	0	
	Vanadium	ppm	ASTM D5185(m)		0	0	
	White Metal	scalar	Visual*	NONE	NONE	NONE	
	Yellow Metal	scalar	Visual*	NONE	NONE	NONE	
CONTAMINATION The water content is negligible. There is no indication of any contamination in the oil.	Silicon	ppm	ASTM D5185(m)	>50	0	2	
	Potassium	ppm	ASTM D5185(m)	>20	<1	0	
	Water	%	ASTM D6304*	>0.1	0.001	0.018	
	ppm Water	ppm	ASTM D6304*	>1000	4	185.6	
	Silt	scalar	Visual*	NONE	NONE	NONE	
	Debris	scalar	Visual*	NONE	VLITE	VLITE	
	Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	
	Appearance	scalar	Visual*	NORML	NORML	NORML	
	Odor	scalar	Visual*	NORML	AMMON	NORML	
	Emulsified Water	scalar	Visual*	>0.1	NEG	.2%	
FLUID CONDITION	Sodium	ppm	ASTM D5185(m)		0	0	
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Boron	ppm	ASTM D5185(m)		0	<1	
	Barium	ppm	ASTM D5185(m)		0	0	
	Molybdenum	ppm	ASTM D5185(m)		0	0	
	Manganese	ppm	ASTM D5185(m)		0	0	
	Magnesium	ppm	ASTM D5185(m)		<1	<1	
	Calcium	ppm	ASTM D5185(m)		<1	<1	
	Phosphorus	ppm	ASTM D5185(m)		<1	1	
	Zinc	ppm	ASTM D5185(m)		5	2	
	Sulfur	ppm	ASTM D5185(m)		18	18	
			. /				

Acid Number (AN) mg KOH/g ASTM D974* 0.05


Visc @ 40°C cSt ASTM D7279(m) 58

0.01

54.9

0.01

56.1

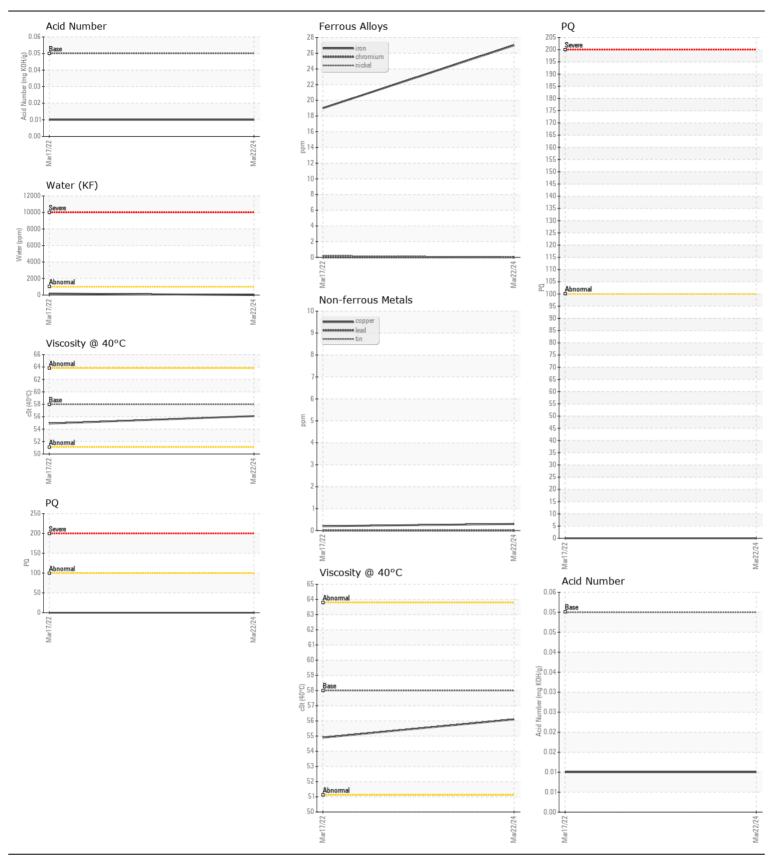

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **CIMCO** Refrigeration CALA Sample No. Received : WC0902699 : 09 Apr 2024 1551 Corporate Drive 80 Lab Number : 02627700 Tested : 10 Apr 2024 Burlington, ON ISO 17025:2017 Diagnosed Accredited : 10 Apr 2024 - Bill Quesnel CA L7L 6M3 Unique Number : 5760832 Laboratory Test Package : IND 2 (Additional Tests: KF, TAN Man) Contact: DAVID PARISE DPARISE@ToROMONT.COM To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. T: (416)465-7581 Validity of results and interpretation are based on the sample and information as supplied. F: (416)465-8815

Contact/Location: DAVID PARISE - CIMTOR Page 2 of 2