



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
SUNLIFE [33553]
 Machine Id
500KW CUMMINS WESTMOUNT (S/N 6010259475)
 Component
Diesel Engine
 Fluid
APRIL SUPERFLO GOLD K 15W40 (96 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0767424	WC0817960	WC0521227
Sample Date		Client Info		09 Apr 2024	08 May 2023	17 Nov 2022
Machine Age	hrs	Client Info		0	335	330
Oil Age	hrs	Client Info		0	5	8
Filter Age	hrs	Client Info		0	5	8
Oil Changed		Client Info		N/A	Not Changd	Changed
Filter Changed		Client Info		N/A	Not Changd	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>90	<1	<1	<1
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>2	<1	0	0
Titanium	ppm	ASTM D5185(m)	>2	0	0	0
Silver	ppm	ASTM D5185(m)	>2	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>40	0	0	0
Copper	ppm	ASTM D5185(m)	>330	<1	0	<1
Tin	ppm	ASTM D5185(m)	>15	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	3	4	4
Potassium	ppm	ASTM D5185(m)	>20	0	0	<1
Fuel		WC Method	>3.0	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>6	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	4.7	4.1	4.7
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.5	16.8	18.7
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		1	1	2
Boron	ppm	ASTM D5185(m)	34	12	7	14
Barium	ppm	ASTM D5185(m)	0	0	0	0
Molybdenum	ppm	ASTM D5185(m)	70	55	56	55
Manganese	ppm	ASTM D5185(m)		0	<1	0
Magnesium	ppm	ASTM D5185(m)	640	895	903	876
Calcium	ppm	ASTM D5185(m)	1410	992	1027	1011
Phosphorus	ppm	ASTM D5185(m)	1020	904	1019	1009
Zinc	ppm	ASTM D5185(m)	1170	1076	1110	1076
Sulfur	ppm	ASTM D5185(m)	2930	2402	2556	2544
Oxidation	Abs/.1mm	ASTM D7414*	>25	12.8	11.4	13.1
Visc @ 100°C	cSt	ASTM D7279(m)	16.0	15.2	14.1	13.4

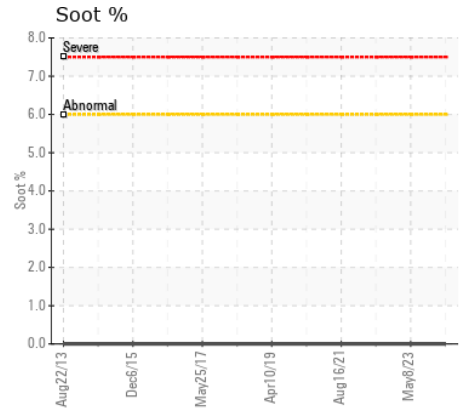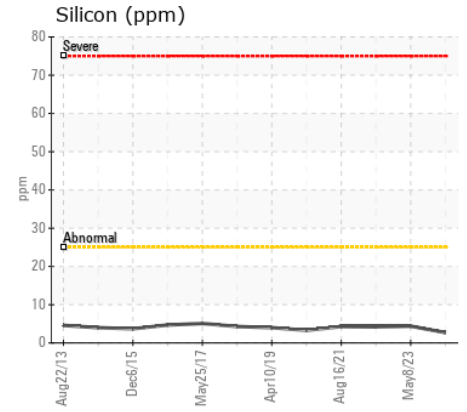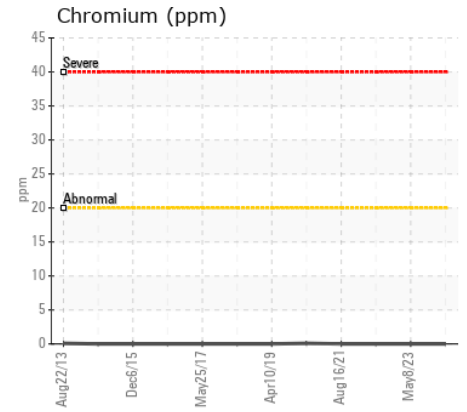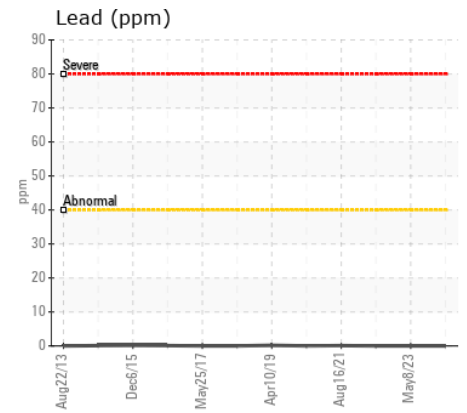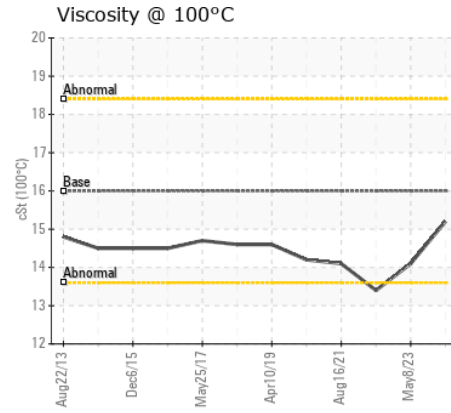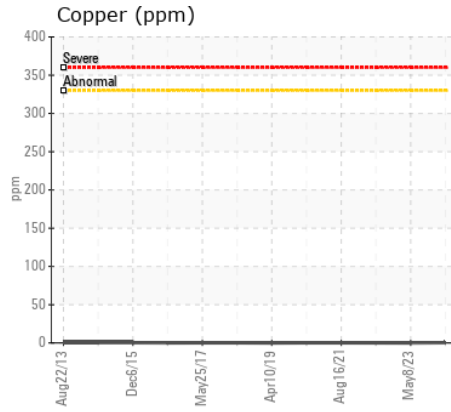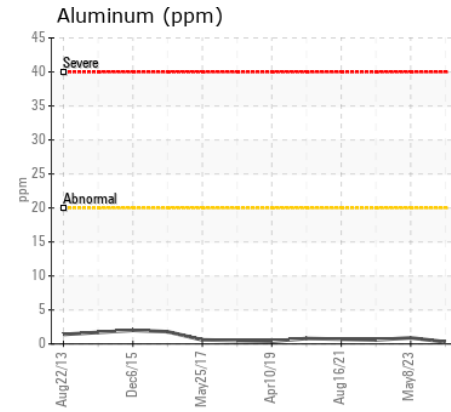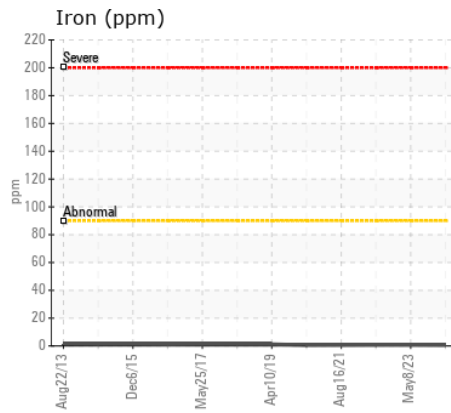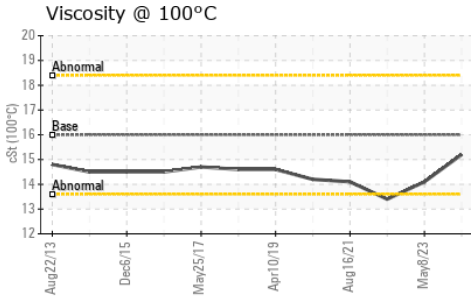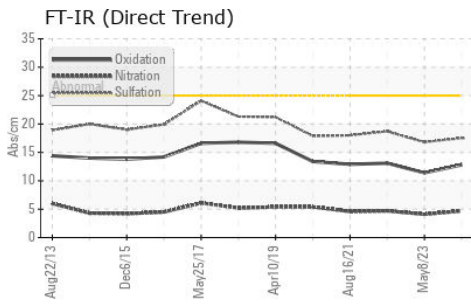

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0767424
Lab Number : 02628069
Unique Number : 5761201
Test Package : MOB 1
Received : 11 Apr 2024
Tested : 11 Apr 2024
Diagnosed : 11 Apr 2024 - Wes Davis

SOMMERS GENERATOR SALES LTD.
 70 PACKHAM AVENUE
 STRATFORD, ON
 CA N4Z 0A6
 Contact: Pat Devereaux
 pat.devereaux@sommersgen.com
 T: (519)655-2396
 F: (519)655-6881

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.