



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area  
**[33376]**  
 Machine Id  
**MTU SUNLIFE LS**  
 Component  
**Diesel Engine**  
 Fluid  
**SAE 15W40 (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0841627	---	---
Sample Date		Client Info		09 Apr 2024	---	---
Machine Age	hrs	Client Info		616	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

## WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	1	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	<1	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<1	---	---
Lead	ppm	ASTM D5185(m)	>40	0	---	---
Copper	ppm	ASTM D5185(m)	>330	11	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

## CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	1	---	---
Potassium	ppm	ASTM D5185(m)	>20	0	---	---
Fuel		WC Method	>5	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	4.4	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.6	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

## FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>57	1	---	---
Boron	ppm	ASTM D5185(m)		10	---	---
Barium	ppm	ASTM D5185(m)		0	---	---
Molybdenum	ppm	ASTM D5185(m)		58	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)		921	---	---
Calcium	ppm	ASTM D5185(m)		1030	---	---
Phosphorus	ppm	ASTM D5185(m)		971	---	---
Zinc	ppm	ASTM D5185(m)		1100	---	---
Sulfur	ppm	ASTM D5185(m)		2329	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	12.4	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.5	13.0	---	---

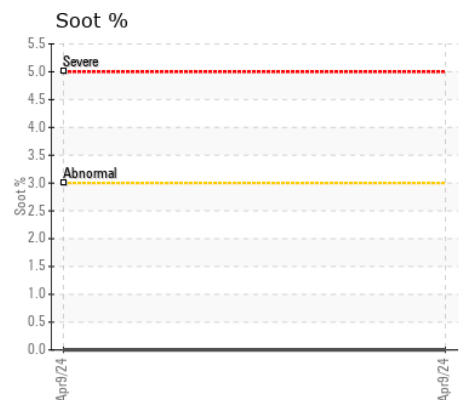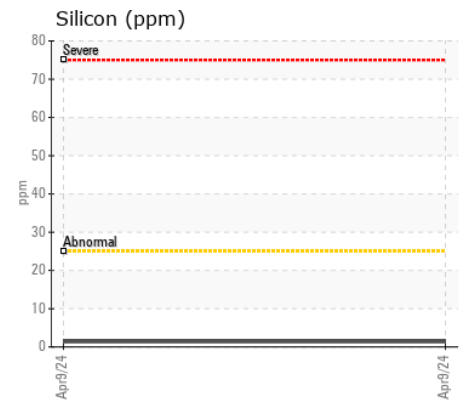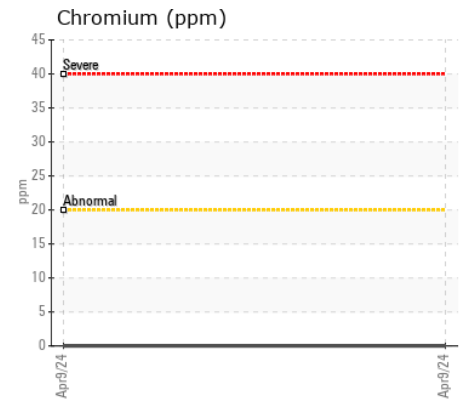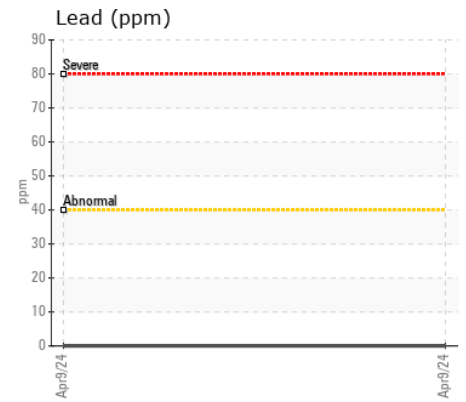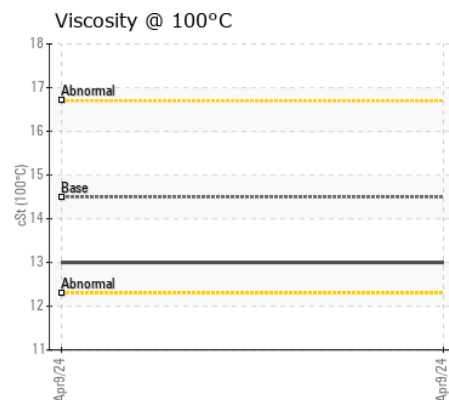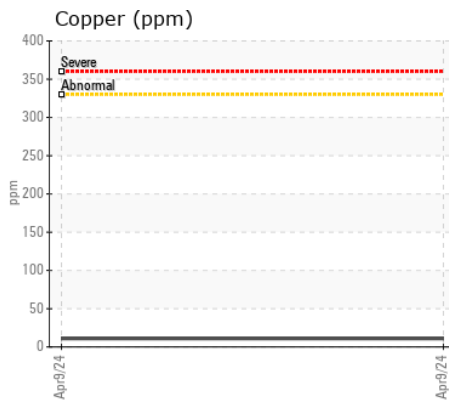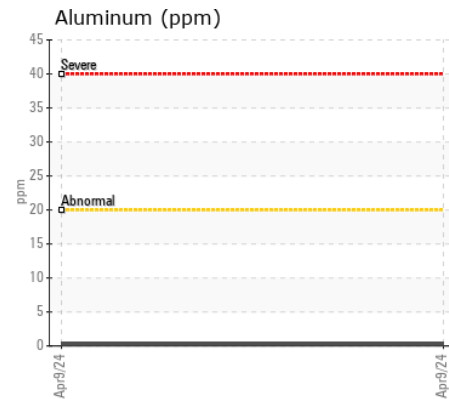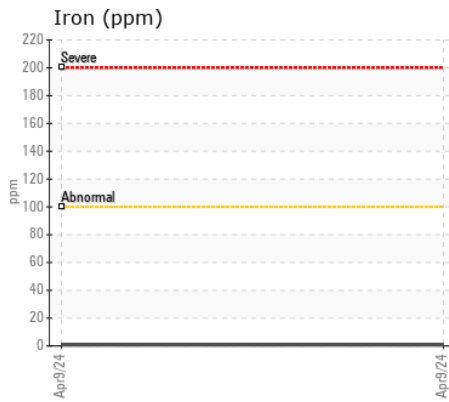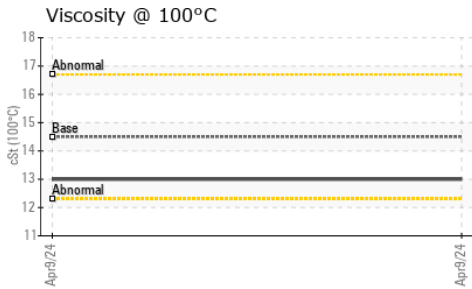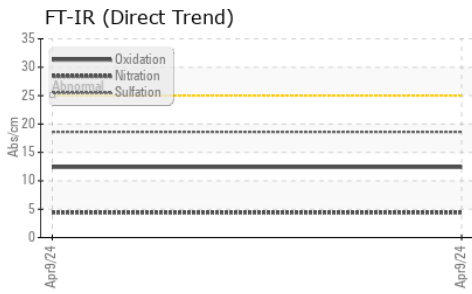

ISO 17025:2017  
Accredited  
Laboratory

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0841627  
**Lab Number** : 02628070  
**Unique Number** : 5761202  
**Test Package** : MOB 1

**Received** : 11 Apr 2024  
**Tested** : 11 Apr 2024  
**Diagnosed** : 11 Apr 2024 - Wes Davis

**SOMMERS GENERATOR SALES LTD.**  
 70 PACKHAM AVENUE  
 STRATFORD, ON  
 CA N4Z 0A6

Contact: Pat Devereaux  
 pat.devereaux@sommersgen.com  
 T: (519)655-2396  
 F: (519)655-6881

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.