
CORROSION CONTAMINANTS COOLANT CONDITION

NORMAL NORMAL

[33375] SUNLIFE G3 Component Coolant

HYBRID (HOAT) COOLANT (--- GAL)

HYBRID (HOAT) COOLANT (GAL)							
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
The fluid is suitable for further service. Resample at the next service interval to monitor.	Sample Number		Client Info		WC0767442		
	Sample Date		Client Info		09 Apr 2024		
	Machine Age	hrs	Client Info		0		
	Oil Age	hrs	Client Info		0		
	Oil Changed		Client Info		N/A		
	Sample Status				NORMAL		
CORROSION	Iron	ppm	ASTM D5185(m)	>15	<1		
All metal levels are normal indicating no corrosion in the cooling system.	Aluminum	ppm	ASTM D5185(m)	>10	<1		
	Copper	ppm	ASTM D5185(m)		2		
	Lead	ppm	ASTM D5185(m)		0		
	Tin	ppm	ASTM D5185(m)	>10	0		
	Silver	ppm	ASTM D5185(m)	>10	<1		
	Zinc	ppm	ASTM D5185(m)	>10	1		
CONTAMINANTS							
There is no indication of any contamination in the coolant.	Calcium	ppm	ASTM D5185(m)		13		
	Magnesium	ppm	ASTM D5185(m)	>40	2		
	Appearance	scalar	Visual*	NORML	NORML		
	Odor	scalar	Visual*	NORML	NORML		
	Coolant Appearance		Visual*	Clear	Clear		
COOLANT CONDITION	Boiling Point	°C	WC Method*		107		
The nitrite level is acceptable. The pH level of this fluid is within the acceptable limits. The reserve alkalinity of this fluid is acceptable.	Specific Gravity		ASTM D1298*		1.063		
	рН	Scale 0-14	ASTM D1287*		8.42		
	Nitrites	ppm	Alcan Test Kit*		1200		
	Reserve Alkalinity	Scale 0-20	ASTM D1121*		2.6		
	Percentage Glycol	%	ASTM D3321*		46.8		
	Freezing Point	°C	ASTM D3321*		-32		
	Carboxylate						
	Silicon	ppm	ASTM D5185(m)		8		
	Phosphorus	ppm	ASTM D5185(m)		15		
	Boron	ppm	ASTM D5185(m)		157		
	Molybdenum	ppm	ASTM D5185(m)		21		
	Sodium	ppm	ASTM D5185(m)		1285		
	Potassium	ppm	ASTM D5185(m)		36		
	Coolant Color		Visual*		Other		

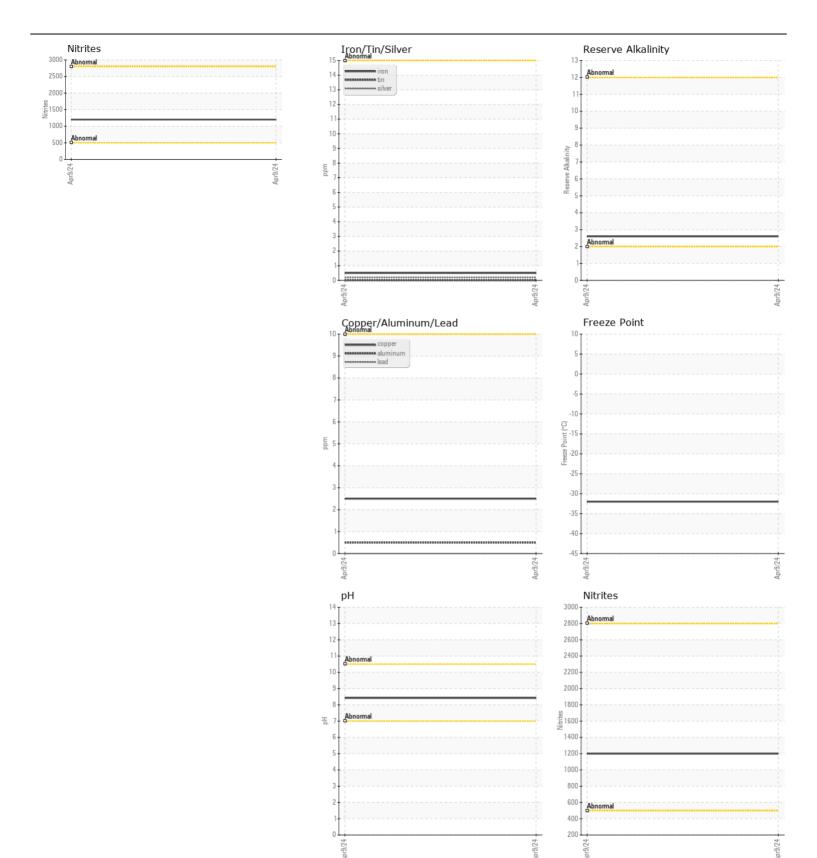



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No.

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 SOMMERS GENERATOR SALES LTD. : WC0767442 Lab Number : 02628303

Unique Number : 5761435 **Test Package**: COOL (Additional Tests: GlycolType)

Received **Tested** Diagnosed

: 11 Apr 2024 : 15 Apr 2024 : 15 Apr 2024 - Kevin Marson

70 PACKHAM AVENUE STRATFORD, ON CA N4Z 0A6

Contact: Pat Devereaux pat.devereaux@sommersgen.com T: (519)655-2396

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

F: (519)655-6881 Validity of results and interpretation are based on the sample and information as supplied.