



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
[85569]
 Machine Id
NEXCCOR TORONTO UNIT #1 BELL CANADA 8VF427550
 Component
Right Diesel Engine
 Fluid
ESSO XD-3 EXTRA SAE 40 (30 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0006020	PN0004748	PN0003428
Sample Date		Client Info		08 Apr 2024	14 Mar 2023	25 Mar 2022
Machine Age	hrs	Client Info		481	459	420
Oil Age	hrs	Client Info		22	0	27
Filter Age	hrs	Client Info		22	0	27
Oil Changed		Client Info		Changed	Changed	Not Changd
Filter Changed		Client Info		Changed	Changed	Not Changd
Sample Status				NORMAL	ATTENTION	ABNORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>200	4	6	20
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>2	0	0	<1
Titanium	ppm	ASTM D5185(m)	>2	0	0	<1
Silver	ppm	ASTM D5185(m)	>2	0	0	<1
Aluminum	ppm	ASTM D5185(m)	>30	<1	<1	1
Lead	ppm	ASTM D5185(m)	>30	2	4	15
Copper	ppm	ASTM D5185(m)	>30	1	2	4
Tin	ppm	ASTM D5185(m)	>15	<1	2	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>30	4	6	8
Potassium	ppm	ASTM D5185(m)	>20	0	0	1
Fuel		WC Method	>3.0	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	0.0	▲ 0.019
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	3.4	3.3	2.7
Sulfation	Abs/.1mm	ASTM D7415*	>30	12.8	15.0	10.9
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		3	8	● 28
Boron	ppm	ASTM D5185(m)		4	12	14
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		3	11	11
Manganese	ppm	ASTM D5185(m)		0	<1	<1
Magnesium	ppm	ASTM D5185(m)		665	66	38
Calcium	ppm	ASTM D5185(m)	2550	1795	● 3652	▲ 3215
Phosphorus	ppm	ASTM D5185(m)	1000	944	● 748	▲ 720
Zinc	ppm	ASTM D5185(m)	1120	1070	● 772	▲ 769
Sulfur	ppm	ASTM D5185(m)		2565	2549	2789
Oxidation	Abs/.1mm	ASTM D7414*	>25	5.6	4.6	4.0
Visc @ 100°C	cSt	ASTM D7279(m)	14.3	13.7	13.1	13.0

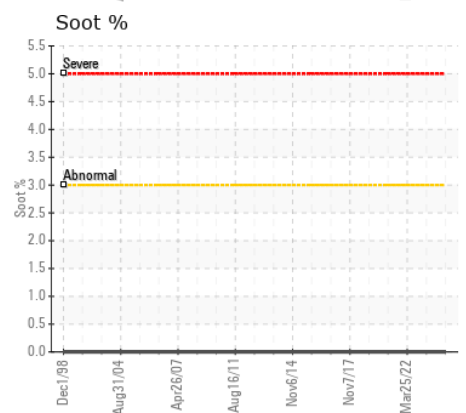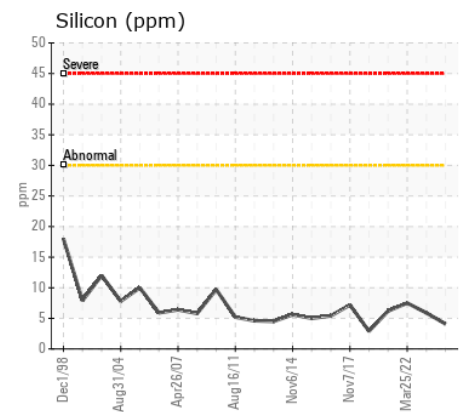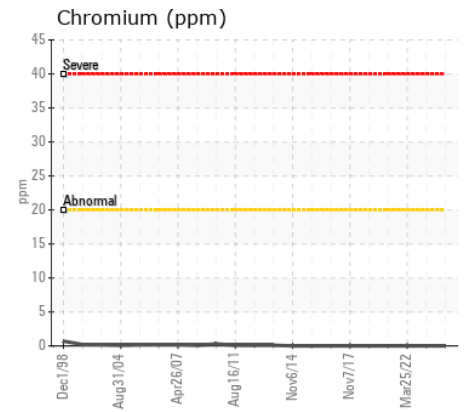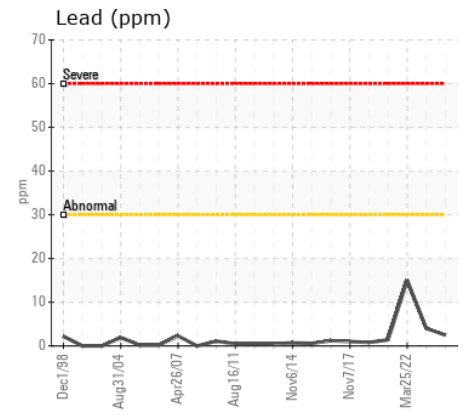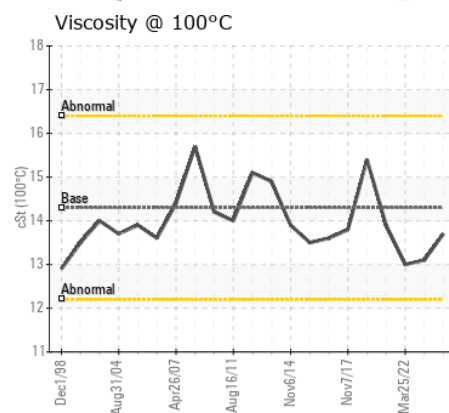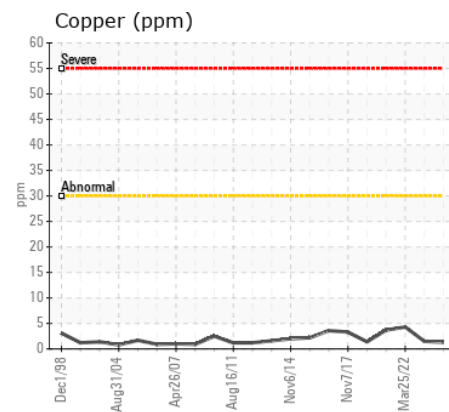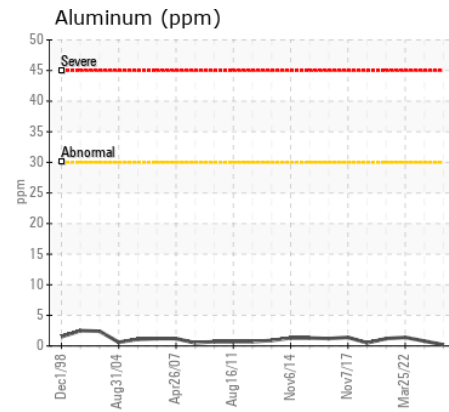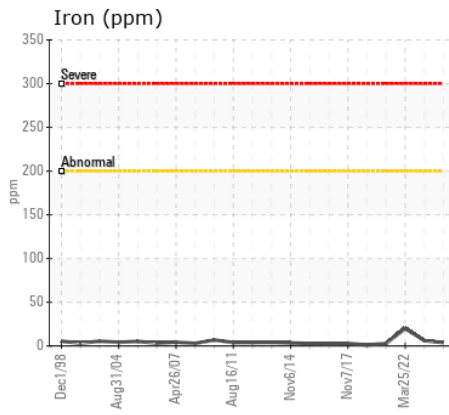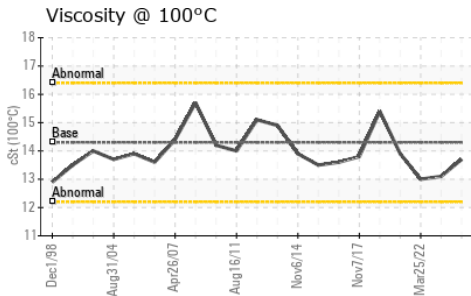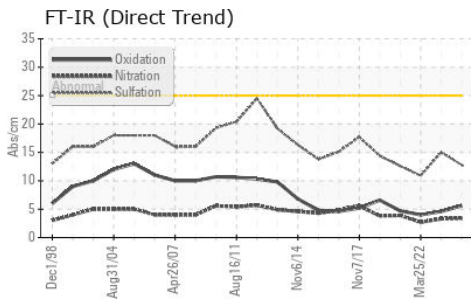

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0006020
Lab Number : 02628412
Unique Number : 5761544
Test Package : MOB 1

Received : 12 Apr 2024
Tested : 12 Apr 2024
Diagnosed : 12 Apr 2024 - Wes Davis

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T:
 F: (905)665-8544