



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[142229]

Machine Id

WALLACEBURG WASTE WATER

Component

Diesel Engine

Fluid

SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0919637	---	---
Sample Date		Client Info		11 Apr 2024	---	---
Machine Age	hrs	Client Info		215	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Not Changed	---	---
Filter Changed		Client Info		Not Changed	---	---
Sample Status				NORMAL	---	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>250	2	---	---
Chromium	ppm	ASTM D5185(m)	>10	0	---	---
Nickel	ppm	ASTM D5185(m)	>5	0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>35	<1	---	---
Lead	ppm	ASTM D5185(m)	>100	1	---	---
Copper	ppm	ASTM D5185(m)	>60	20	---	---
Tin	ppm	ASTM D5185(m)	>5	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>35	3	---	---
Potassium	ppm	ASTM D5185(m)	>20	<1	---	---
Fuel		WC Method	>5	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	5.3	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	15.3	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185(m)	>57	1	---	---
Boron	ppm	ASTM D5185(m)		36	---	---
Barium	ppm	ASTM D5185(m)		0	---	---
Molybdenum	ppm	ASTM D5185(m)		7	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)		84	---	---
Calcium	ppm	ASTM D5185(m)		1955	---	---
Phosphorus	ppm	ASTM D5185(m)		790	---	---
Zinc	ppm	ASTM D5185(m)		895	---	---
Sulfur	ppm	ASTM D5185(m)		2777	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	8.9	---	---
Base Number (BN)	mg KOH/g	ASTM D2896*		7.83	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.5	12.5	---	---

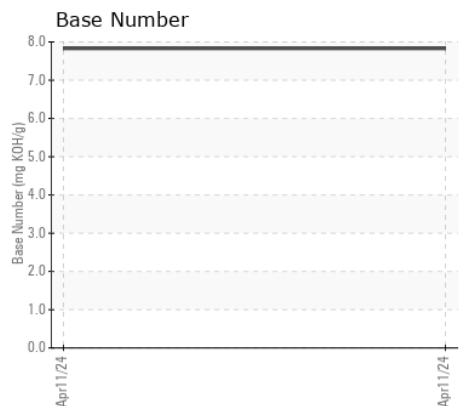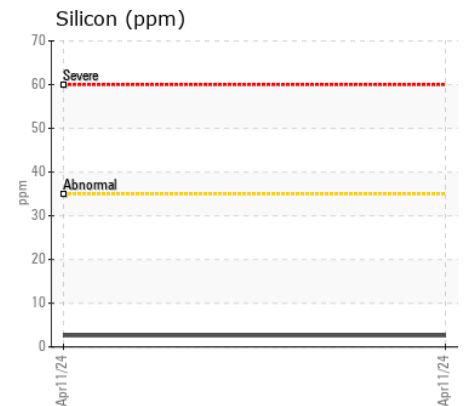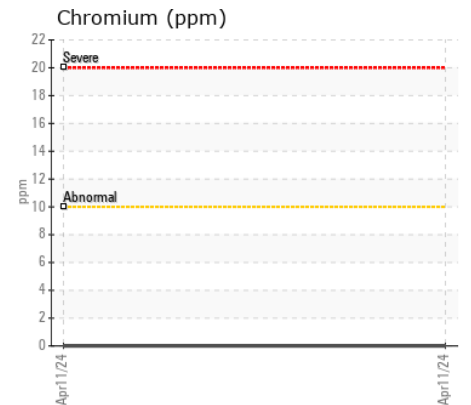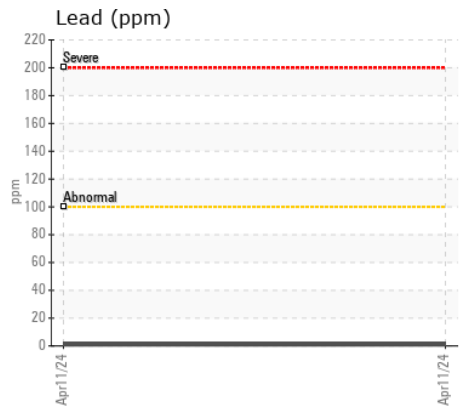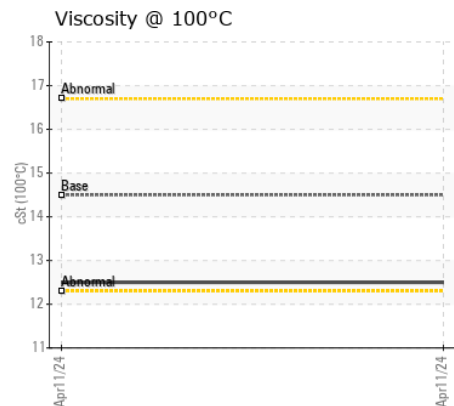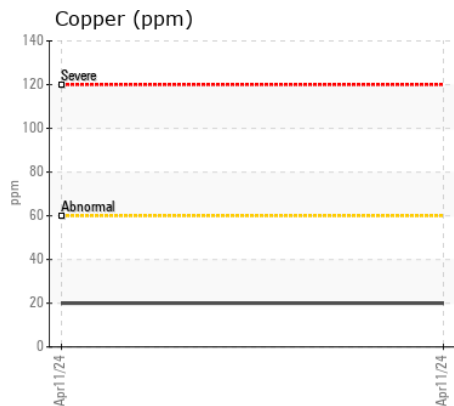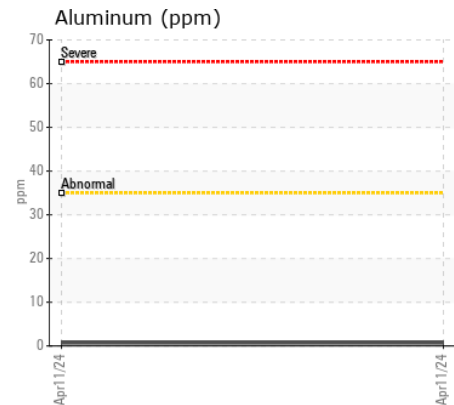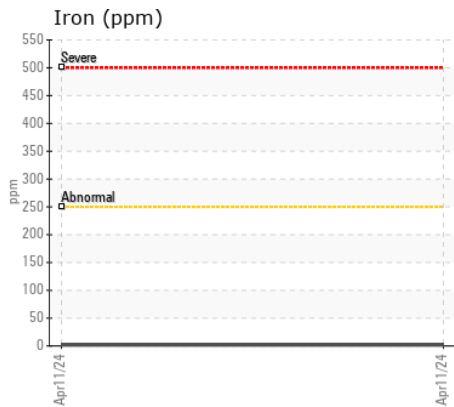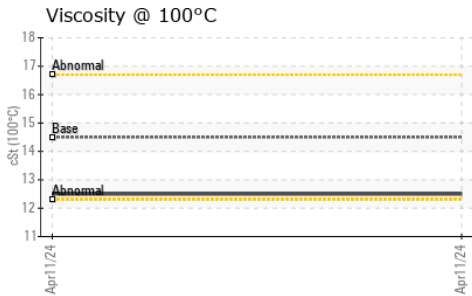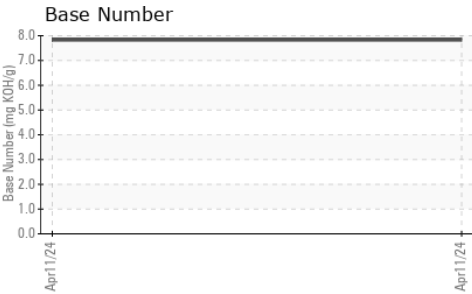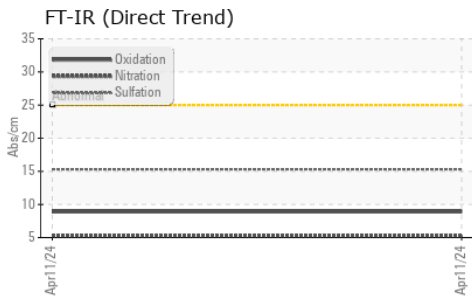

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0919637
Lab Number : 02628656
Unique Number : 5761788
Test Package : MOB 2
Received : 15 Apr 2024
Tested : 17 Apr 2024
Diagnosed : 17 Apr 2024 - Wes Davis

GENREP LTD
 476 HWY 77, R.R. # 3
 LEAMINGTON, ON
 CA N8H 3V6
 Contact: Debbie Johnston
 djohnston@genrep.com
 T: (519)325-0202
 F: (519)322-0026

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.