



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
241 MAPLE
 Component
Diesel Engine
 Fluid
TOTAL FINA RUBIA TIR 7900 15W40 (--- LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0888774	WC0787095	WC0665441
Sample Date		Client Info		27 Feb 2024	24 Apr 2023	11 May 2022
Machine Age	hrs	Client Info		344	324	292
Oil Age	hrs	Client Info		20	0	0
Filter Age	hrs	Client Info		20	0	0
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>90	<1	1	1
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>2	0	0	0
Titanium	ppm	ASTM D5185(m)	>2	0	<1	<1
Silver	ppm	ASTM D5185(m)	>2	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	2	2	2
Lead	ppm	ASTM D5185(m)	>40	0	<1	<1
Copper	ppm	ASTM D5185(m)	>330	2	2	2
Tin	ppm	ASTM D5185(m)	>15	0	<1	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	2	5	3
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Fuel		WC Method	>3.0	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>6	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	6.9	7.0	7.0
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.4	17.4	18.0
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		2	2	2
Boron	ppm	ASTM D5185(m)		62	64	64
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		67	66	55
Manganese	ppm	ASTM D5185(m)		0	<1	<1
Magnesium	ppm	ASTM D5185(m)		134	107	152
Calcium	ppm	ASTM D5185(m)	3290	2076	2185	2069
Phosphorus	ppm	ASTM D5185(m)	1200	1003	1076	1051
Zinc	ppm	ASTM D5185(m)	1400	1126	1119	1094
Sulfur	ppm	ASTM D5185(m)	4000	2950	3068	2906
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.9	14.1	14.5
Visc @ 100°C	cSt	ASTM D7279(m)	15.5	13.6	13.5	13.6

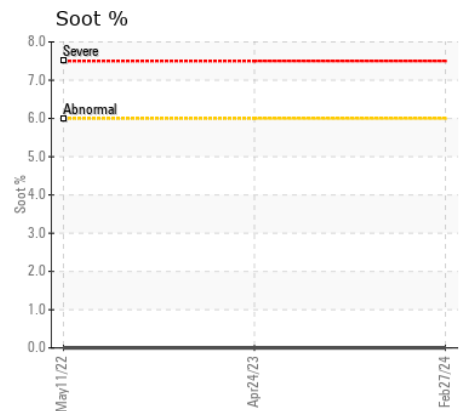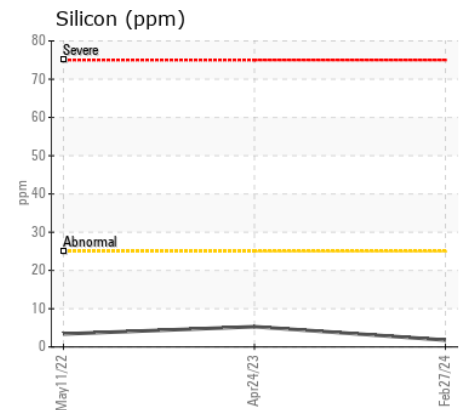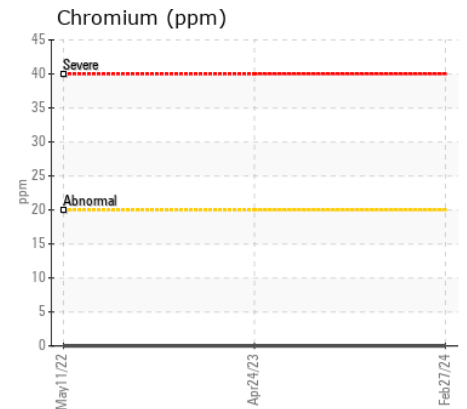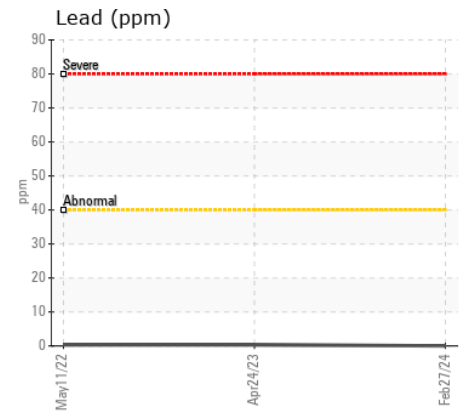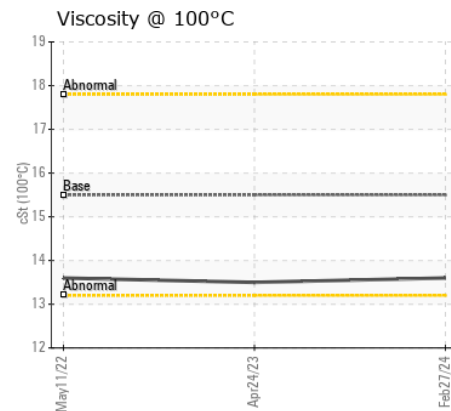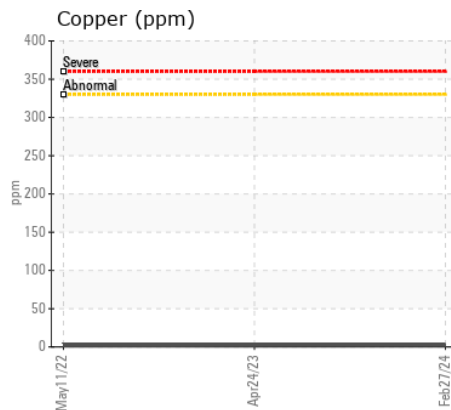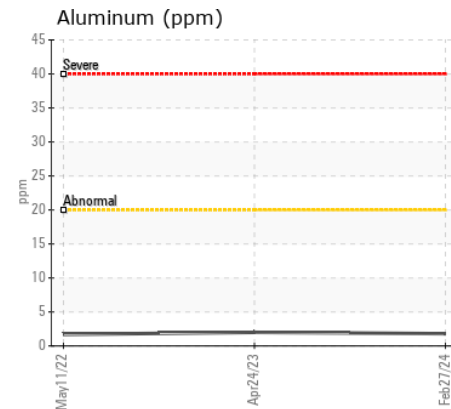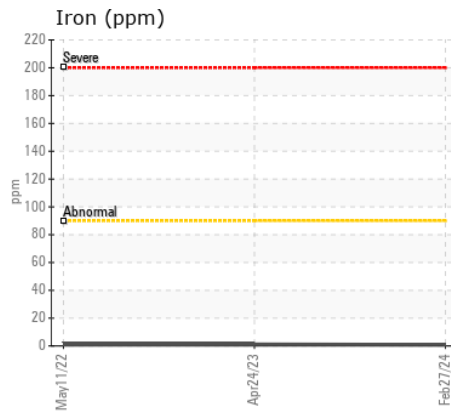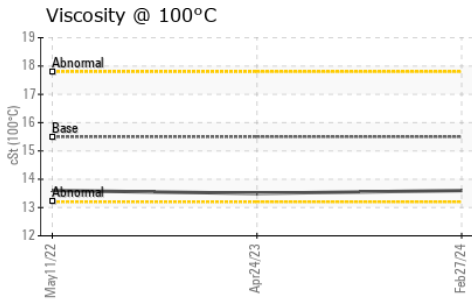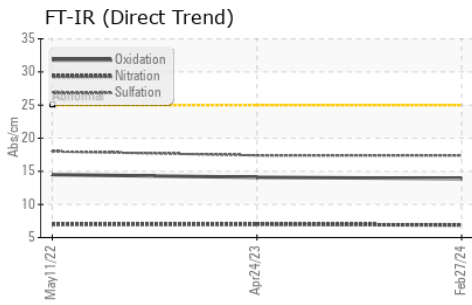

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0888774 **Received** : 15 Apr 2024
Lab Number : 02628732 **Tested** : 16 Apr 2024
Unique Number : 5761864 **Diagnosed** : 16 Apr 2024 - Wes Davis
Test Package : MOB 1

GenWorx Power Systems Inc.
 785 Westney Road, Unit 4
 Ajax, ON
 CA L1S 7G1
 Contact: J Curtis
 jcurtis@genworx.ca

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.