



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
1259 MILFORD BAY RD BRACEBRIDGE BELL CANADA BELL CANADA

Component
Rear Diesel Engine

Fluid
ESSO XD-3 EXTRA 15W40 (--- LTR)

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005544	---	---
Sample Date		Client Info		08 Apr 2024	---	---
Machine Age	hrs	Client Info		180	---	---
Oil Age	hrs	Client Info		30	---	---
Filter Age	hrs	Client Info		30	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				NORMAL	---	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	22	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	2	---	---
Lead	ppm	ASTM D5185(m)	>40	4	---	---
Copper	ppm	ASTM D5185(m)	>330	7	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

CONTAMINATION












Fuel content negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	12	---	---
Potassium	ppm	ASTM D5185(m)	>20	2	---	---
Fuel	%	ASTM D7593*	>5	0.9	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	9.2	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.7	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	9	---	---
Boron	ppm	ASTM D5185(m)		51	---	---
Barium	ppm	ASTM D5185(m)		<1	---	---
Molybdenum	ppm	ASTM D5185(m)		10	---	---
Manganese	ppm	ASTM D5185(m)		2	---	---
Magnesium	ppm	ASTM D5185(m)		157	---	---
Calcium	ppm	ASTM D5185(m)	3780	1993	---	---
Phosphorus	ppm	ASTM D5185(m)	1370	1013	---	---
Zinc	ppm	ASTM D5185(m)	1500	1140	---	---
Sulfur	ppm	ASTM D5185(m)	3800	3339	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.9	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	12.9	---	---

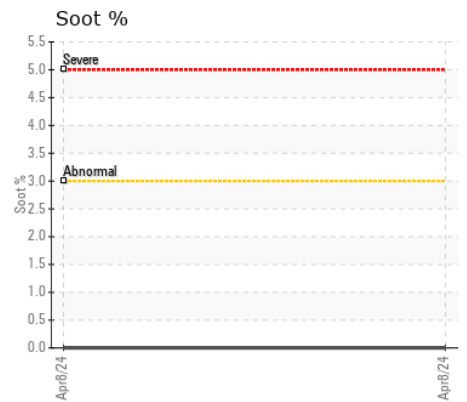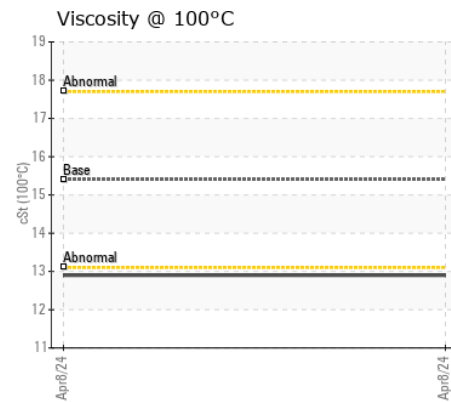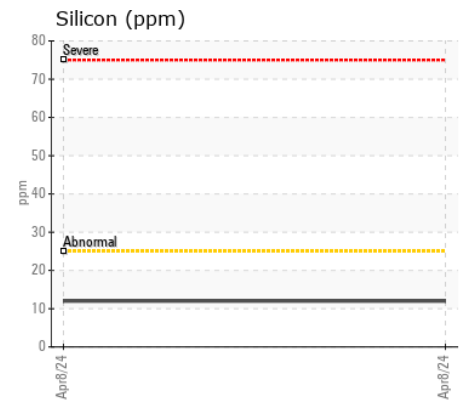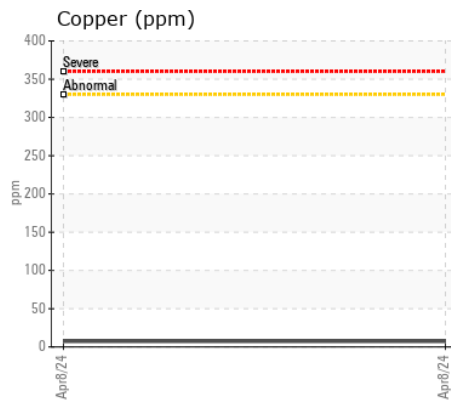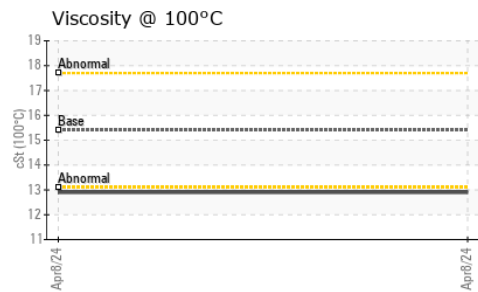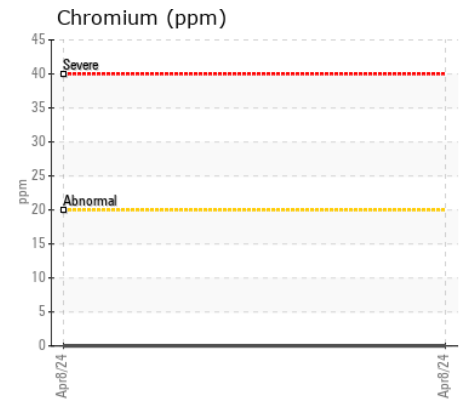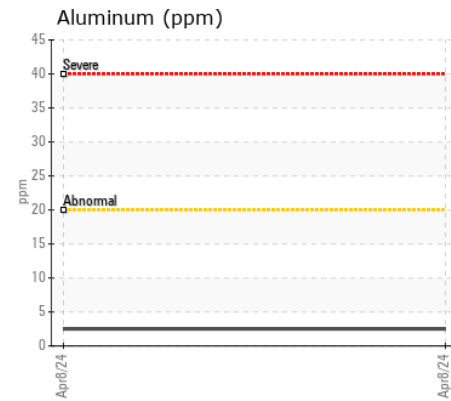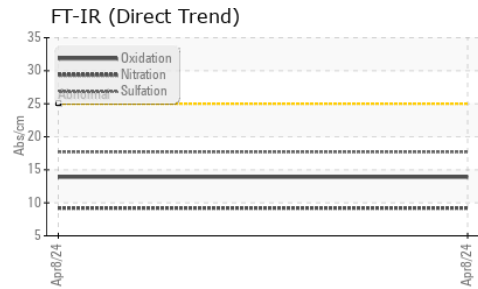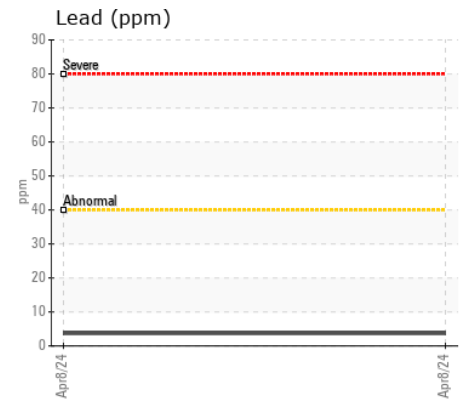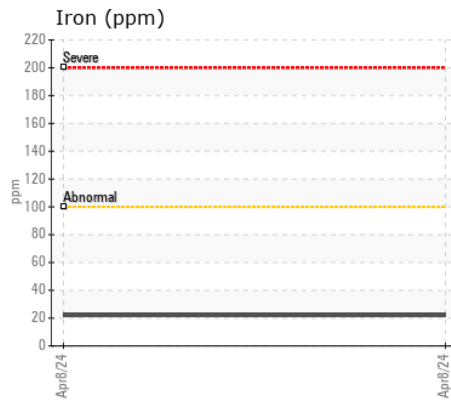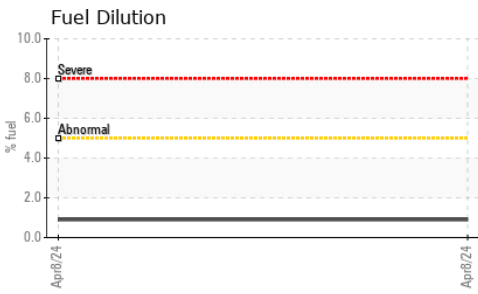

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005544 **Received** : 17 Apr 2024
Lab Number : 02629491 **Tested** : 18 Apr 2024
Unique Number : 5762623 **Diagnosed** : 18 Apr 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: FuelDilution, PercentFuel)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)565-8544