



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
1421 VICTORIA PARK, TORONTO BASEMENT NEXACOR 12VA086646
 Component
Right Diesel Engine
 Fluid
ESSO XD-3 EXTRA SAE 30 (40 LTR)

RECOMMENDATION

Confirm the source of the lubricant being utilized for top-up/fill.
 Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005856	PN0004470	PN0004471
Sample Date		Client Info		11 Apr 2024	16 Feb 2023	16 Feb 2023
Machine Age	hrs	Client Info		775	757	757
Oil Age	hrs	Client Info		18	23	23
Filter Age	hrs	Client Info		18	23	23
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>120	2	3	3
Chromium	ppm	ASTM D5185(m)	>5	0	0	0
Nickel	ppm	ASTM D5185(m)	>4	0	<1	0
Titanium	ppm	ASTM D5185(m)	>2	0	<1	<1
Silver	ppm	ASTM D5185(m)	>2	0	0	0
Aluminum	ppm	ASTM D5185(m)	>5	0	<1	1
Lead	ppm	ASTM D5185(m)	>25	0	<1	1
Copper	ppm	ASTM D5185(m)	>40	1	<1	2
Tin	ppm	ASTM D5185(m)	>15	0	<1	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	2	4	2
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	0
Fuel		WC Method	>3.0	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>0.8	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	3.2	3.9	7.0
Sulfation	Abs/.1mm	ASTM D7415*	>30	12.8	15.7	21.0
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

Additive levels indicate the addition of a different brand, or type of oil.
 The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>16	2	5	3
Boron	ppm	ASTM D5185(m)		4	14	52
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		2	13	38
Manganese	ppm	ASTM D5185(m)		0	<1	<1
Magnesium	ppm	ASTM D5185(m)		689	68	549
Calcium	ppm	ASTM D5185(m)	2550	1498	3355	1642
Phosphorus	ppm	ASTM D5185(m)	1000	931	741	905
Zinc	ppm	ASTM D5185(m)	1120	1046	765	937
Sulfur	ppm	ASTM D5185(m)		2392	2285	2555
Oxidation	Abs/.1mm	ASTM D7414*	>25	5.9	5.6	17.1
Visc @ 100°C	cSt	ASTM D7279(m)	12.0	12.4	12.1	12.1

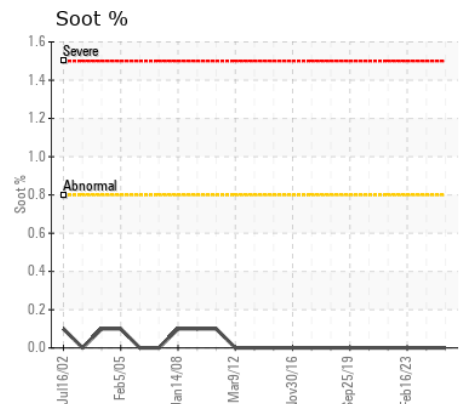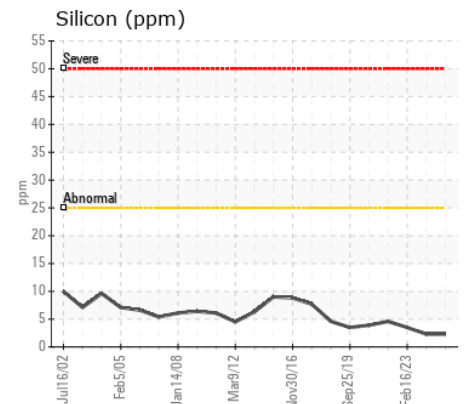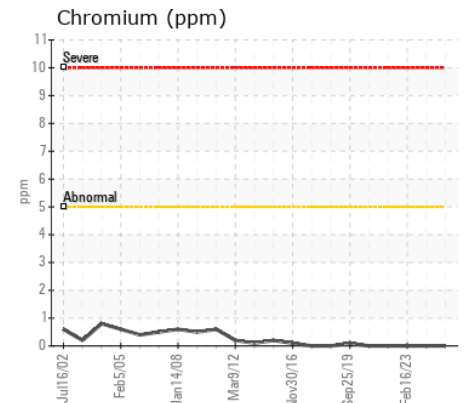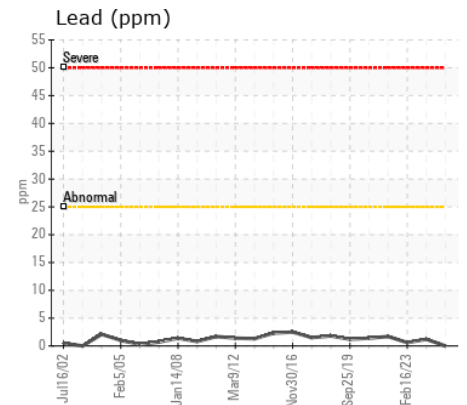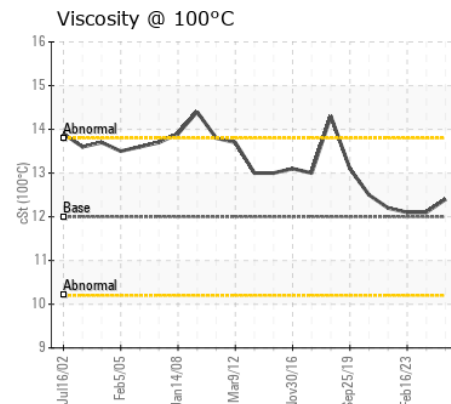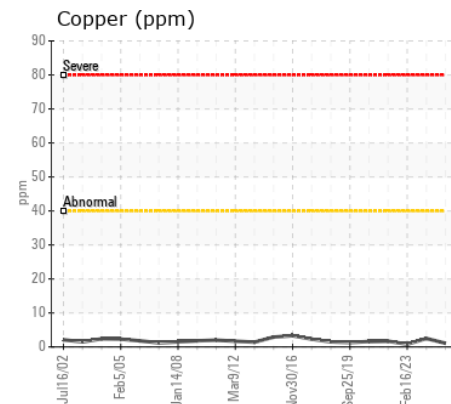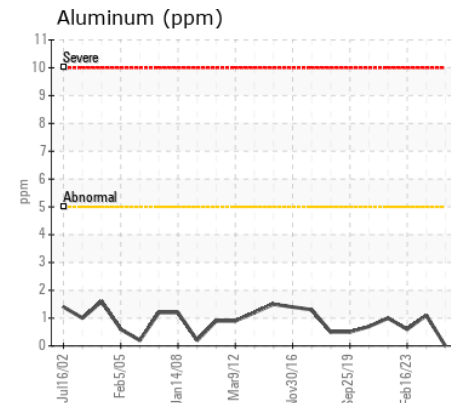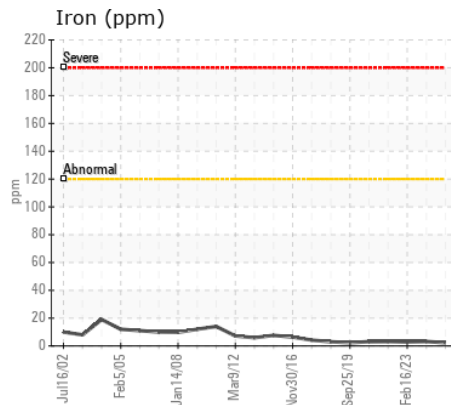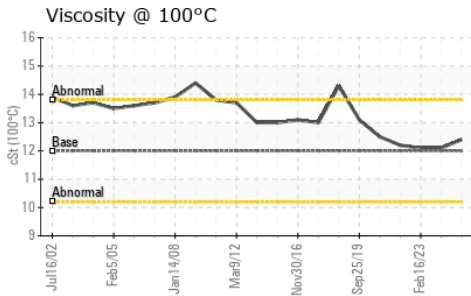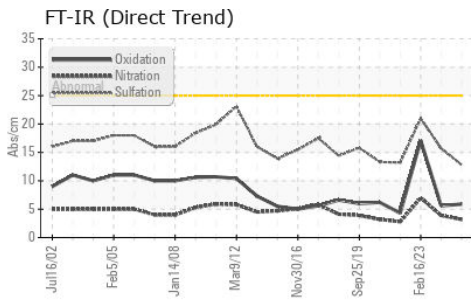

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005856
Lab Number : 02629498
Unique Number : 5762630
Test Package : MOB 1

Received : 17 Apr 2024
Tested : 17 Apr 2024
Diagnosed : 17 Apr 2024 - Wes Davis

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Ryan Udall
 rudall@pwrstn.com
 T: (905)565-1621
 F: (905)629-1499

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.