



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

Harvest Gear Drives [413628175]

Machine Id

3114-220 Hide Puller Hold Back - Maximo #2600 Equip #1000043488 (S/N 0221-07743-1419)

Component

Gear Drive

Fluid

KLUBER KLUBEROIL 4 UH1-460 N (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0912757	WC0884772	WC0852631
Sample Date		Client Info		11 Apr 2024	16 Jan 2024	19 Oct 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

PQ		ASTM D8184*		0	0	0
Iron	ppm	ASTM D5185(m)	>150	2	3	2
Chromium	ppm	ASTM D5185(m)	>10	0	0	0
Nickel	ppm	ASTM D5185(m)	>10	0	0	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	0	<1
Aluminum	ppm	ASTM D5185(m)	>25	0	<1	0
Lead	ppm	ASTM D5185(m)	>100	0	0	<1
Copper	ppm	ASTM D5185(m)	>50	<1	1	1
Tin	ppm	ASTM D5185(m)	>10	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE

CONTAMINATION









There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>50	30	29	31
Potassium	ppm	ASTM D5185(m)	>20	0	2	<1
Water		WC Method	>0.1	NEG	NEG	NEG
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	VLITE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185(m)		0	0	<1
Boron	ppm	ASTM D5185(m)		1	2	<1
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		0	<1	0
Calcium	ppm	ASTM D5185(m)		0	2	1
Phosphorus	ppm	ASTM D5185(m)		569	585	609
Zinc	ppm	ASTM D5185(m)		2	3	3
Sulfur	ppm	ASTM D5185(m)		540	556	538
Acid Number (AN)	mg KOH/g	ASTM D974*		2.05	1.99	2.10
Visc @ 40°C	cSt	ASTM D7279(m)	460	414	415	414

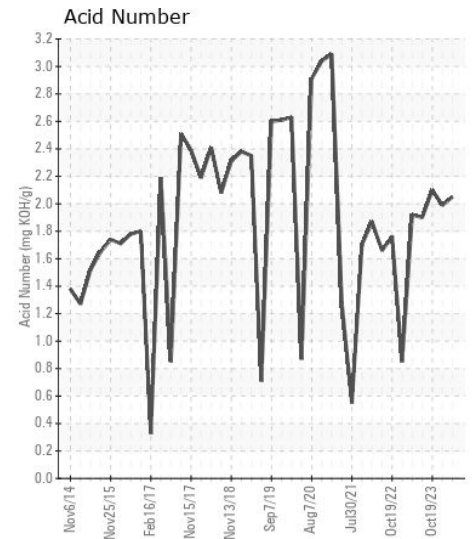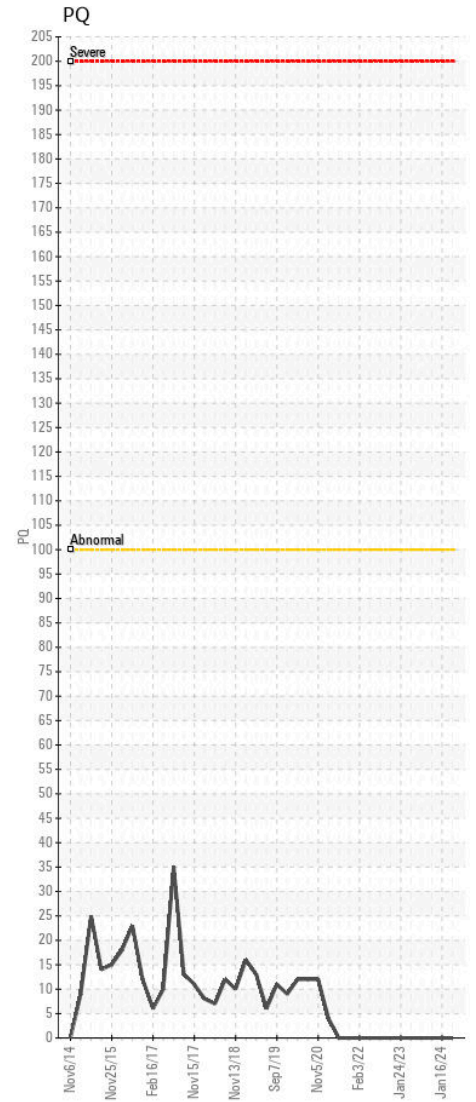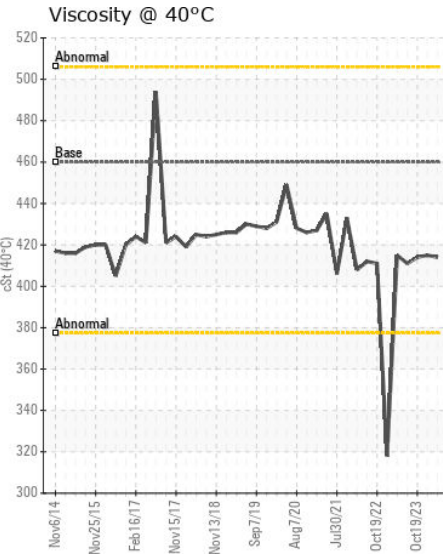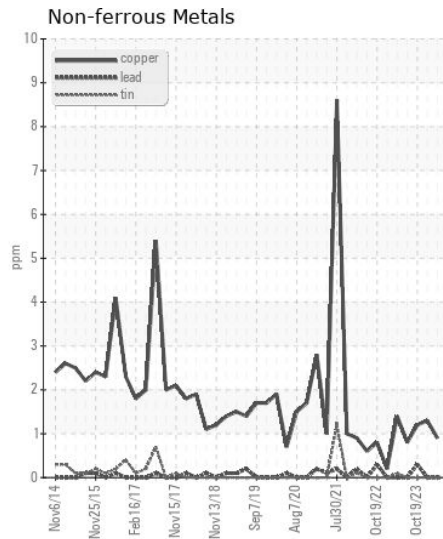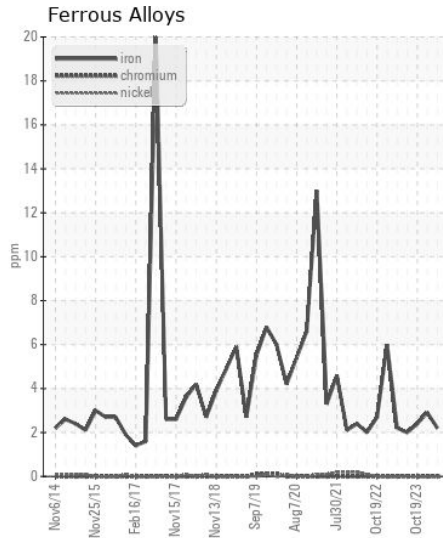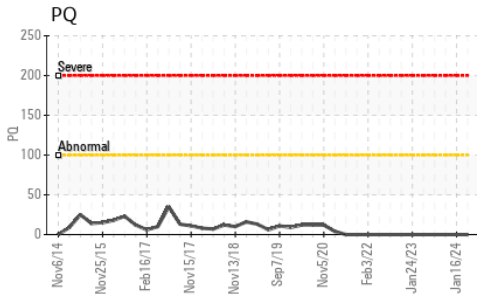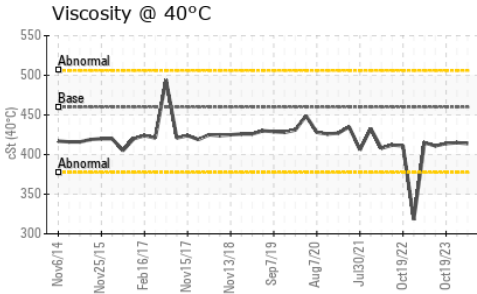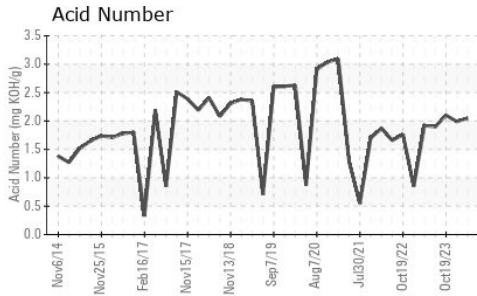

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0912757
Lab Number : 02630399
Unique Number : 5763531
Test Package : IND 2 (Additional Tests: TAN Man)

Received : 19 Apr 2024
Tested : 23 Apr 2024
Diagnosed : 23 Apr 2024 - Kevin Marson

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Cargill Meat Solutions

165 Dunlop Drive
 Guelph, ON
 CA N1L 1P4
 Contact: Jakub Posluszny
 jakub_posluszny@cargill.com
 T: (519)823-5200
 F: (519)823-5893