



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

| | |
|-----------------|---------------|
| WEAR | NORMAL |
| CONTAMINATION | NORMAL |
| FLUID CONDITION | NORMAL |

Machine Id
VOLVO PENTA 2P0617861
Component
Diesel Engine
Fluid
SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

| Test | UOM | Method | Limit/Abn | Current | History1 | History2 |
|----------------|-----|-------------|-----------|--------------------|----------|----------|
| Sample Number | | Client Info | | WA0020872 | --- | --- |
| Sample Date | | Client Info | | 13 Apr 2024 | --- | --- |
| Machine Age | hrs | Client Info | | 296 | --- | --- |
| Oil Age | hrs | Client Info | | 0 | --- | --- |
| Filter Age | hrs | Client Info | | 0 | --- | --- |
| Oil Changed | | Client Info | | Not Changd | --- | --- |
| Filter Changed | | Client Info | | Not Changd | --- | --- |
| Sample Status | | | | NORMAL | --- | --- |

WEAR

Metal levels are typical for a new component breaking in.

| | | | | | | |
|----------|-----|---------------|-----|--------------|-----|-----|
| Iron | ppm | ASTM D5185(m) | >80 | 5 | --- | --- |
| Chromium | ppm | ASTM D5185(m) | >6 | 0 | --- | --- |
| Nickel | ppm | ASTM D5185(m) | >2 | <1 | --- | --- |
| Titanium | ppm | ASTM D5185(m) | >2 | 0 | --- | --- |
| Silver | ppm | ASTM D5185(m) | >2 | 0 | --- | --- |
| Aluminum | ppm | ASTM D5185(m) | >20 | 2 | --- | --- |
| Lead | ppm | ASTM D5185(m) | >95 | 0 | --- | --- |
| Copper | ppm | ASTM D5185(m) | >85 | 1 | --- | --- |
| Tin | ppm | ASTM D5185(m) | >9 | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185(m) | | 0 | --- | --- |

CONTAMINATION











There is no indication of any contamination in the oil.

| | | | | | | |
|------------------|----------|---------------|------|----------------|-----|-----|
| Silicon | ppm | ASTM D5185(m) | >25 | 2 | --- | --- |
| Potassium | ppm | ASTM D5185(m) | >20 | 1 | --- | --- |
| Fuel | | WC Method | >4.0 | <1.0 | --- | --- |
| Water | | WC Method | >0.1 | NEG | --- | --- |
| Glycol | | WC Method | | NEG | --- | --- |
| Soot % | % | ASTM D7844* | | 0 | --- | --- |
| Nitration | Abs/cm | ASTM D7624* | >20 | 4.8 | --- | --- |
| Sulfation | Abs/.1mm | ASTM D7415* | >30 | 17.8 | --- | --- |
| Emulsified Water | scalar | Visual* | >0.1 | NEG | --- | --- |

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

| | | | | | | |
|--------------|----------|---------------|------|-------------|-----|-----|
| Sodium | ppm | ASTM D5185(m) | >57 | 1 | --- | --- |
| Boron | ppm | ASTM D5185(m) | | 23 | --- | --- |
| Barium | ppm | ASTM D5185(m) | | 0 | --- | --- |
| Molybdenum | ppm | ASTM D5185(m) | | 50 | --- | --- |
| Manganese | ppm | ASTM D5185(m) | | 0 | --- | --- |
| Magnesium | ppm | ASTM D5185(m) | | 844 | --- | --- |
| Calcium | ppm | ASTM D5185(m) | | 1168 | --- | --- |
| Phosphorus | ppm | ASTM D5185(m) | | 987 | --- | --- |
| Zinc | ppm | ASTM D5185(m) | | 1132 | --- | --- |
| Sulfur | ppm | ASTM D5185(m) | | 2590 | --- | --- |
| Oxidation | Abs/.1mm | ASTM D7414* | >25 | 13.1 | --- | --- |
| Visc @ 100°C | cSt | ASTM D7279(m) | 14.5 | 15.0 | --- | --- |

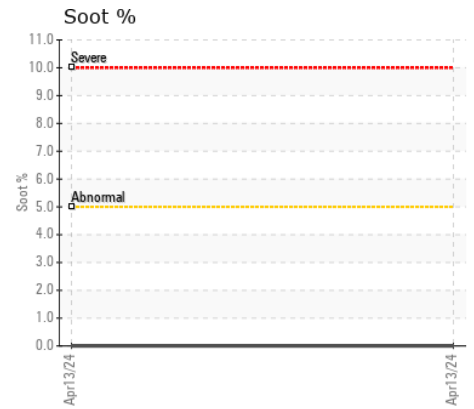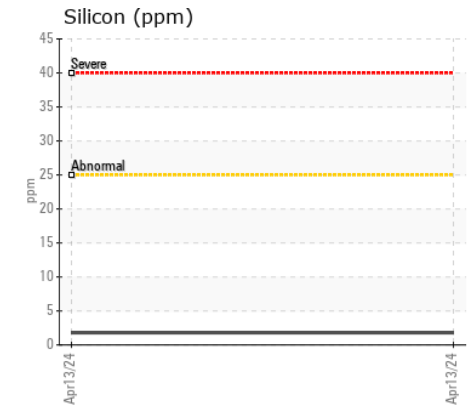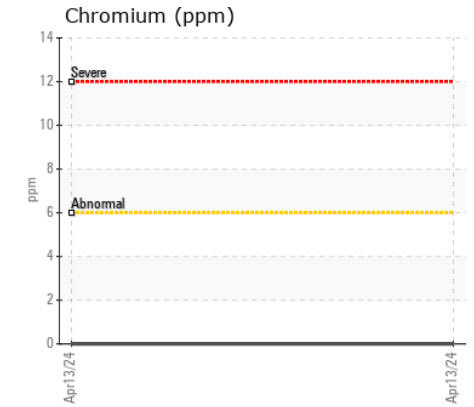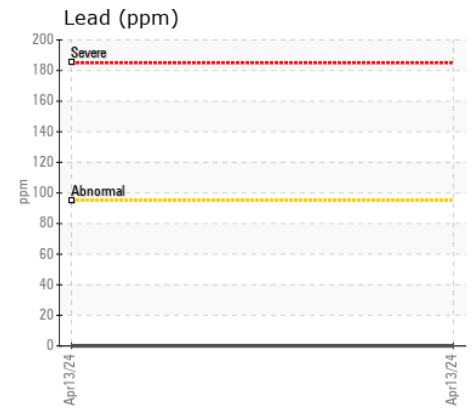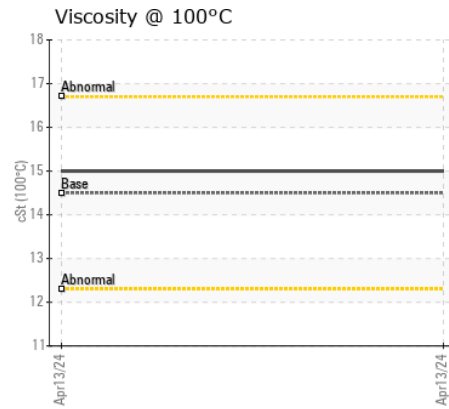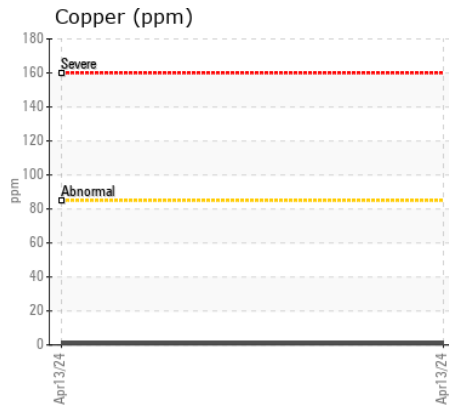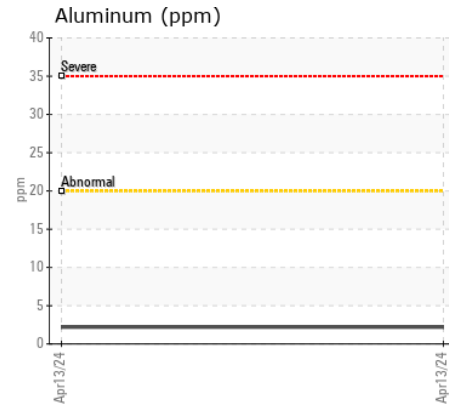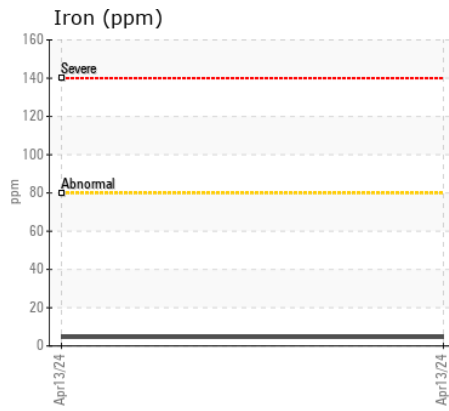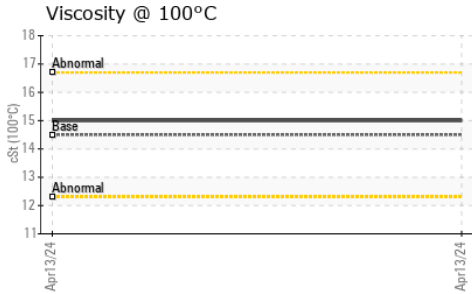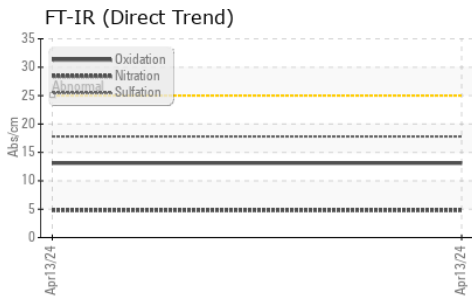

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0020872 **Received** : 22 Apr 2024
Lab Number : 02630533 **Tested** : 22 Apr 2024
Unique Number : 5763665 **Diagnosed** : 22 Apr 2024 - Kevin Marson
Test Package : MOB 1

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Wajax Power Systems
 70 Raddall Avenue
 Dartmouth, NS
 CA B3B 1T7
 Contact: Danelle Hoffman
 dhoffman@wajax.com
 T: (902)468-6200
 F: (902)468-3325