



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**DG #3 (S/N 12310)**  
 Component  
**3 Main Engine**  
 Fluid  
**CASTROL MHP 154 (1900 LTR)**

## RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using MAR 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. this testkit includes BN to determine the suitability of the oil for continued use.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WC0872089</b>	WC0872103	WC0773472
Sample Date		Client Info		<b>08 Apr 2024</b>	09 Jan 2024	05 Jul 2023
Machine Age	hrs	Client Info		<b>30767</b>	29309	27291
Oil Age	hrs	Client Info		<b>0</b>	7251	0
Filter Age	hrs	Client Info		<b>0</b>	4486	0
Oil Changed		Client Info		<b>N/A</b>	Not Changd	Not Changd
Filter Changed		Client Info		<b>N/A</b>	Not Changd	Not Changd
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

## WEAR

Component wear rates appear to be normal (unconfirmed).

Iron	ppm	ASTM D5185(m)	>75	<b>4</b>	3	4
Chromium	ppm	ASTM D5185(m)	>8	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>2	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185(m)	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>15	<b>1</b>	2	1
Lead	ppm	ASTM D5185(m)	>18	<b>0</b>	<1	0
Copper	ppm	ASTM D5185(m)	>80	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m)	>14	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE

## CONTAMINATION

There is no indication of any contamination in the oil.


Silicon	ppm	ASTM D5185(m)	>20	<b>8</b>	5	5
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	<1	<1
Fuel		WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	ASTM D7844*		<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>8.9</b>	9.3	9.5
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>13.9</b>	14.1	14.5
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	<b>NEG</b>	NEG	NEG

## FLUID CONDITION


The condition of the oil is acceptable for the time in service (unconfirmed).

Sodium	ppm	ASTM D5185(m)	>75	<b>&lt;1</b>	<1	<1
Boron	ppm	ASTM D5185(m)		<b>2</b>	2	2
Barium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Manganese	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185(m)		<b>24</b>	27	19
Calcium	ppm	ASTM D5185(m)		<b>5406</b>	5082	5252
Phosphorus	ppm	ASTM D5185(m)		<b>865</b>	879	946
Zinc	ppm	ASTM D5185(m)		<b>960</b>	976	996
Sulfur	ppm	ASTM D5185(m)		<b>8291</b>	9361	8913
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>7.1</b>	7.6	7.5
Visc @ 100°C	cSt	ASTM D7279(m)	13.5	<b>13.5</b>	13.4	13.6


**FT-IR (Direct Trend)**

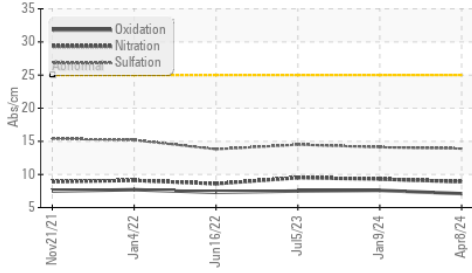


**Ferrous Alloys**

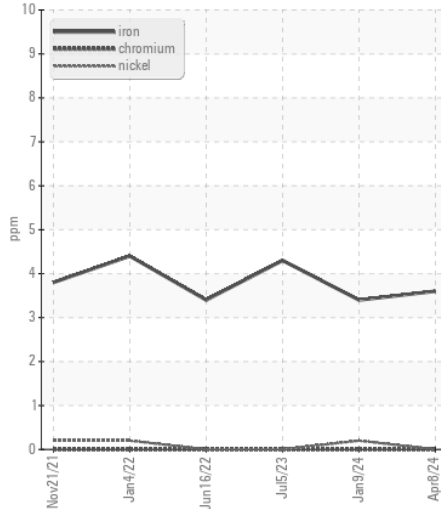


**Viscosity @ 100°C**

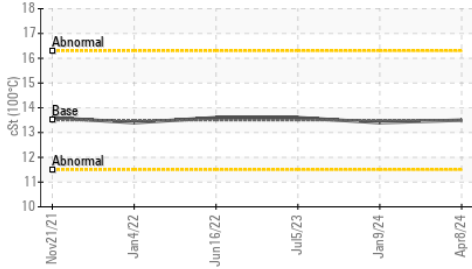

**Non-ferrous Metals**

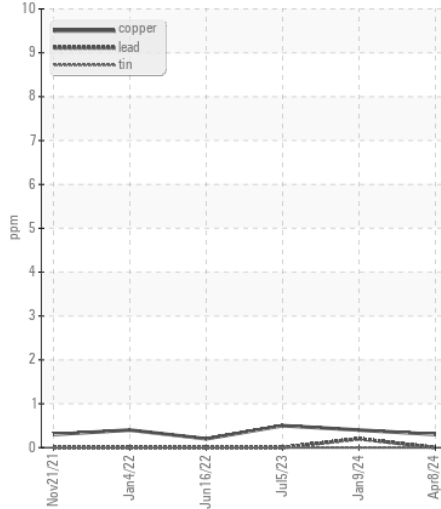

**Viscosity @ 100°C**

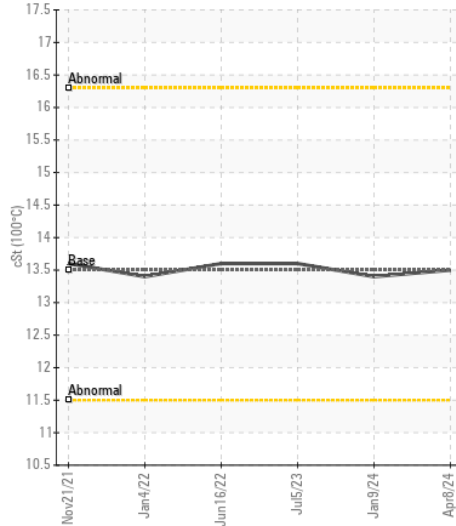

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0872089  
**Lab Number** : 02630859  
**Unique Number** : 5772012  
**Test Package** : MAR 1

**Horizon Maritime Services Ltd. - Horizon Arctic**  
 87 WATER STREET,, 2ND FLOOR  
 ST.JOHNS, NL  
 CA A1C 1A5  
 Contact: Horizon Arctic Chief Engineer  
 chiefeng.arctic@horizonvessel.com  
 T: (709)702-4447  
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.