

## Machine Id OJ028374 Component Front Diesel Engine Fluid SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

 _	
ΕΛ	D

Metal levels are typical for a new component breaking in.

## CONTAMINATION

There is no indication of any contamination in the oil.


## **FLUID CONDITION**

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

\_\_\_\_\_

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0617259		
Sample Date		Client Info		21 Feb 2024		
Machine Age	hrs	Client Info		300		
Oil Age	hrs	Client Info		30		
Filter Age	hrs	Client Info		30		
Oil Changed		Client Info		Changed		
Filter Changed		Client Info		Changed		
Sample Status				NORMAL		
Iron	ppm	ASTM D5185(m)	>100	4		
Chromium	ppm	ASTM D5185(m)	>20	0		
Nickel	ppm	ASTM D5185(m)	>4	0		
Titanium	ppm	ASTM D5185(m)		85		
Silver	ppm	ASTM D5185(m)	>3	0		
Aluminum	ppm	ASTM D5185(m)	>20	2		
Lead	ppm	ASTM D5185(m)	>40	3		
Copper	ppm	ASTM D5185(m)	>330	2		
Tin	ppm	ASTM D5185(m)	>15	<1		
Vanadium	ppm	ASTM D5185(m)		<1		
Silicon	ppm	ASTM D5185(m)	>25	3		
Potassium	ppm	ASTM D5185(m)	>20	2		
Fuel		WC Method	>5	<1.0		
Water		WC Method	>0.2	NEG		
Glycol		WC Method		NEG		
Soot %	%	ASTM D7844*	>3	0		
Nitration	Abs/cm	ASTM D7624*	>20	6.8		
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.9		
Emulsified Water	scalar	Visual*	>0.2	NEG		
Sodium	ppm	ASTM D5185(m)	>57	4		
Boron	ppm	ASTM D5185(m)		122		
Barium	ppm	ASTM D5185(m)		0		
Molybdenum	ppm	ASTM D5185(m)		4		
Manganese	ppm	ASTM D5185(m)		0		
Magnesium	ppm	ASTM D5185(m)		392		
Calcium	ppm	ASTM D5185(m)		1771		
Phosphorus	ppm	ASTM D5185(m)		990		
Zinc	ppm	ASTM D5185(m)		1129		
Sulfur	ppm	ASTM D5185(m)		3169		
Oxidation	Abs/.1mm	ASTM D7414*	>25	14.0		
Base Number (BN)	mg KOH/g	ASTM D2896*		9.65		
Visc @ 100°C	cSt	ASTM D7279(m)	14.5	14.3		
		_				

Contact/Location: Carmen Lavryssen - GENNEP

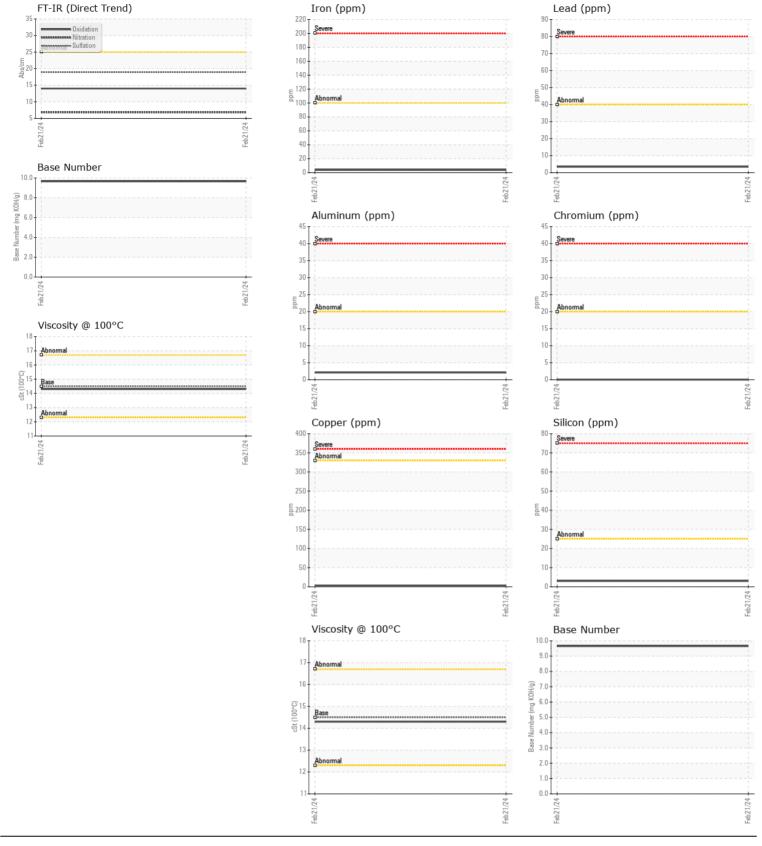

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **GENREP LIMITED** CALA Sample No. Received 25 GIFFORD STREET : WC0617259 : 24 Apr 2024 Lab Number : 02631092 Tested NEPEAN, ON : 24 Apr 2024 ISO 17025:2017 Accredited Laboratory Diagnosed Unique Number : 5772245 : 24 Apr 2024 - Wes Davis CA K2E 7S3 Test Package : MOB 2 Contact: Carmen Lavryssen To discuss this sample report, contact Customer Service at 1-800-268-2131. servicedesk@genrep.com T: (613)225-9244 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied. F: (613)225-4690

Contact/Location: Carmen Lavryssen - GENNEP Page 2 of 2