



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>ABNORMAL</b>
FLUID CONDITION	<b>ABNORMAL</b>

Area  
**QC Engine**  
Machine Id  
**QC230725MOB2**  
Component  
**Diesel Engine**  
Fluid  
**DIESEL ENGINE OIL SAE 40 (--- GAL)**

## RECOMMENDATION

No corrective action is recommended at this time. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WC0925452</b>	WC0925451	WC0925450
Sample Date		Client Info		<b>24 Apr 2024</b>	23 Apr 2024	22 Apr 2024
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	<b>19</b>	19	19
Chromium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185(m)	>4	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185(m)		<b>3</b>	3	3
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<b>4</b>	4	4
Lead	ppm	ASTM D5185(m)	>40	<b>&lt;1</b>	<1	2
Copper	ppm	ASTM D5185(m)	>330	<b>9</b>	9	9
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0

## CONTAMINATION














Light fuel dilution occurring. There is a trace of moisture present in the oil. No other contaminants were detected in the oil.

Silicon	ppm	ASTM D5185(m)	>25	<b>5</b>	5	5
Potassium	ppm	ASTM D5185(m)	>20	<b>▲ 16</b>	▲ 14	▲ 14
Fuel	%	ASTM D7593*	>5	<b>▲ 4.9</b>	▲ 4.9	▲ 5.1
Water	%	ASTM D6304*	>0.2	<b>▲ 0.162</b>	▲ 0.183	▲ 0.182
ppm Water	ppm	ASTM D6304*	>2000	<b>▲ 1626</b>	▲ 1834	▲ 1825
Glycol	%	ASTM D7922*		<b>NEG</b>	NEG	NEG
Soot %	%	ASTM D7844*	>3	<b>0.3</b>	0.3	0.3
Nitration	Abs/cm	ASTM D7624*	>20	<b>9.8</b>	9.8	9.9
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>20.7</b>	20.7	20.8
Emulsified Water	scalar	Visual*	>0.2	<b>▲ .2%</b>	▲ .2%	NEG

## FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. Viscosity of sample indicates oil is within SAE 10W30 range, advise investigate.

Sodium	ppm	ASTM D5185(m)	>216	<b>● 63</b>	● 62	● 61
Boron	ppm	ASTM D5185(m)	250	<b>37</b>	38	28
Barium	ppm	ASTM D5185(m)	10	<b>&lt;1</b>	<1	<1
Molybdenum	ppm	ASTM D5185(m)	100	<b>46</b>	47	46
Manganese	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185(m)	450	<b>612</b>	616	615
Calcium	ppm	ASTM D5185(m)	3000	<b>1472</b>	1467	1467
Phosphorus	ppm	ASTM D5185(m)	1150	<b>833</b>	842	835
Zinc	ppm	ASTM D5185(m)	1350	<b>993</b>	997	997
Sulfur	ppm	ASTM D5185(m)	4250	<b>2565</b>	2525	2507
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>16.2</b>	16.3	16.0
Base Number (BN)	mg KOH/g	ASTM D2896*	8.5	<b>8.77</b>	8.59	8.21
Visc @ 40°C	cSt	ASTM D7279(m)	138	<b>▲ 75.3</b>	▲ 75.3	▲ 75.3
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	<b>▲ 11.3</b>	▲ 11.4	▲ 11.4
Viscosity Index (VI)	Scale	ASTM D2270*	102	<b>141</b>	143	143

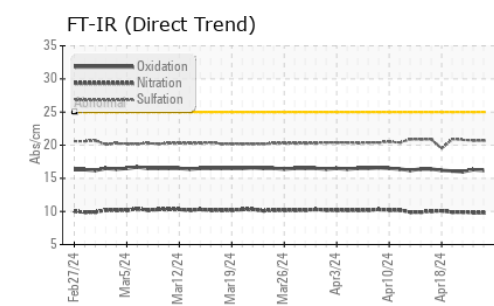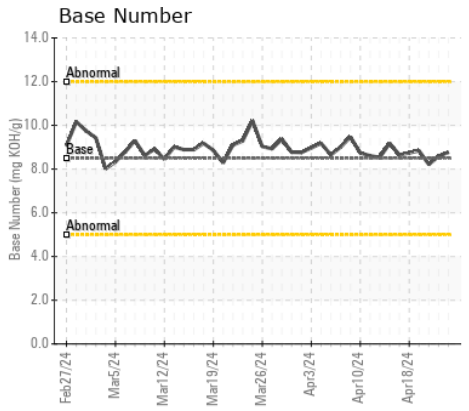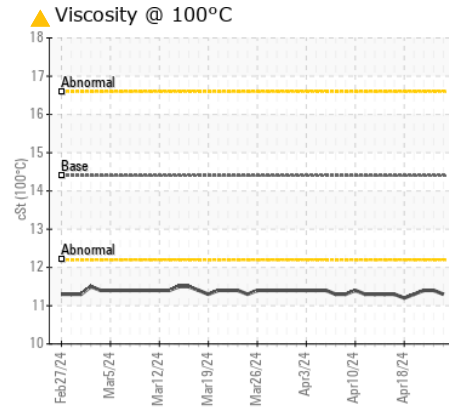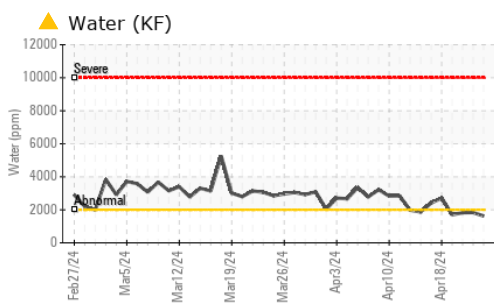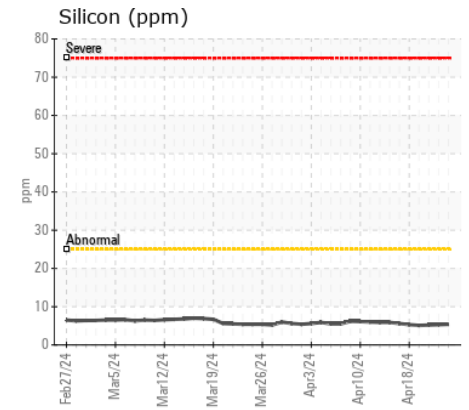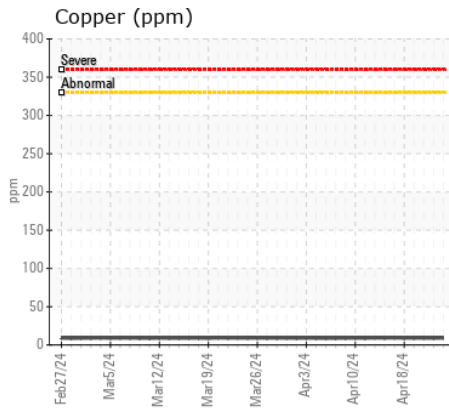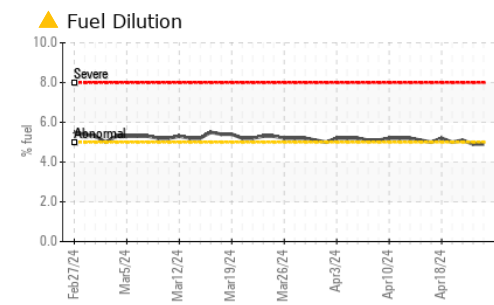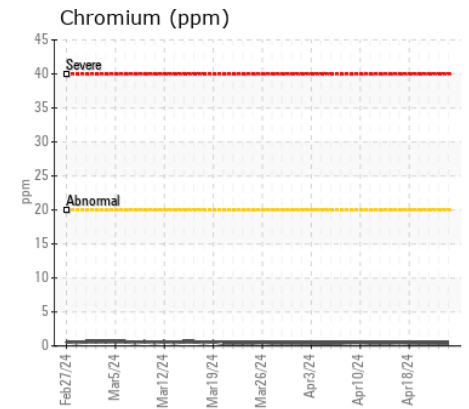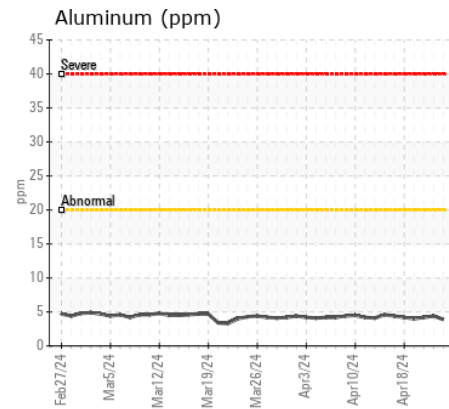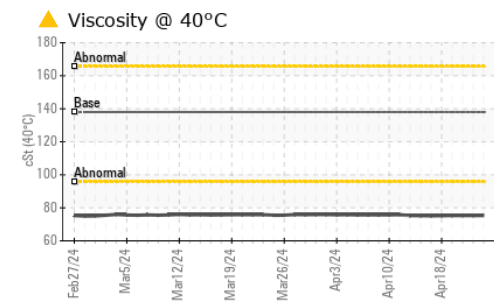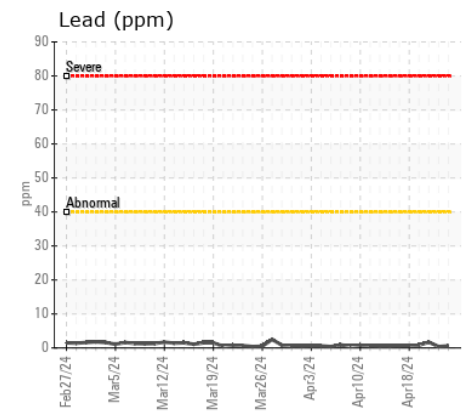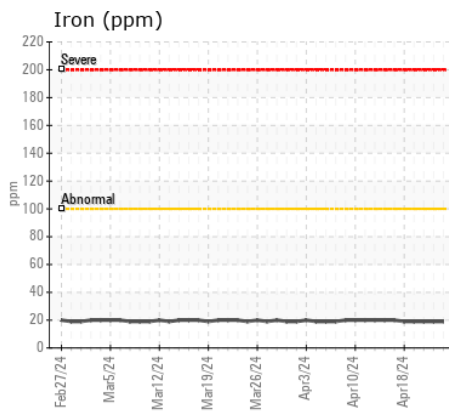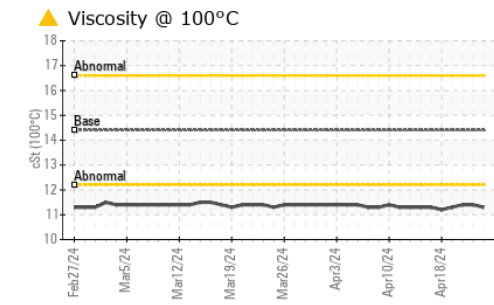

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0925452 **Received** : 24 Apr 2024  
**Lab Number** : 02631238 **Tested** : 25 Apr 2024  
**Unique Number** : 5772391 **Diagnosed** : 25 Apr 2024 - Kevin Marson  
**Test Package** : MOB 2 ( Additional Tests: Glycol, KF, KV40, PercentFuel, VI )

**WearCheck Quality Control Sample Results**

Burlington, ON  
 CA  
 Contact: Dorian Anderson  
 dorian.anderson@wearcheck.com  
 T: (289)291-4652  
 F: (905)569-8605

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.