



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ATTENTION
FLUID CONDITION	NORMAL

Area
SOBEYS WHITBY [4501246281]
 Machine Id
FRICK COMP #6 (S/N F0180XFMNTHAC03)
 Component
Screw Compressor
 Fluid
CIMCO TYPE A (95 GAL)

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0924796	WC0639027	---
Sample Date		Client Info		17 Apr 2024	21 Dec 2021	---
Machine Age	hrs	Client Info		17897	8324	---
Oil Age	hrs	Client Info		17897	8324	---
Filter Age	hrs	Client Info		7000	8324	---
Oil Changed		Client Info		Filtered	Filtered	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				ATTENTION	NORMAL	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>60	3	2	---
Chromium	ppm	ASTM D5185(m)	>4	0	0	---
Nickel	ppm	ASTM D5185(m)		0	<1	---
Titanium	ppm	ASTM D5185(m)		0	0	---
Silver	ppm	ASTM D5185(m)		0	<1	---
Aluminum	ppm	ASTM D5185(m)	>5	0	0	---
Lead	ppm	ASTM D5185(m)	>10	0	0	---
Copper	ppm	ASTM D5185(m)	>30	0	<1	---
Tin	ppm	ASTM D5185(m)	>15	0	0	---
Vanadium	ppm	ASTM D5185(m)		0	0	---
White Metal	scalar	Visual*	NONE	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	---

CONTAMINATION











There is a light amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible.

Silicon	ppm	ASTM D5185(m)	>50	0	1	---
Potassium	ppm	ASTM D5185(m)	>20	0	<1	---
Water	%	ASTM D6304*	>0.1	0.001	0.001	---
ppm Water	ppm	ASTM D6304*	>1000	6	6.1	---
Particles >4µm		ASTM D7647	>10000	10940	6327	---
Particles >6µm		ASTM D7647	>2500	2931	2169	---
Particles >14µm		ASTM D7647	>320	106	231	---
Particles >21µm		ASTM D7647	>80	18	57	---
Particles >38µm		ASTM D7647	>20	0	4	---
Particles >71µm		ASTM D7647	>4	0	0	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	21/19/14	20/18/15	---
Silt	scalar	Visual*	NONE	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	VLITE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185(m)		0	0	---
Boron	ppm	ASTM D5185(m)		0	<1	---
Barium	ppm	ASTM D5185(m)		<1	<1	---
Molybdenum	ppm	ASTM D5185(m)		0	0	---
Manganese	ppm	ASTM D5185(m)		0	0	---
Magnesium	ppm	ASTM D5185(m)		0	0	---
Calcium	ppm	ASTM D5185(m)		0	<1	---
Phosphorus	ppm	ASTM D5185(m)		0	<1	---
Zinc	ppm	ASTM D5185(m)		<1	<1	---
Sulfur	ppm	ASTM D5185(m)		4	2	---
Acid Number (AN)	mg KOH/g	ASTM D974*	0.05	0.02	0.04	---
Visc @ 40°C	cSt	ASTM D7279(m)	58	57.3	57.3	---

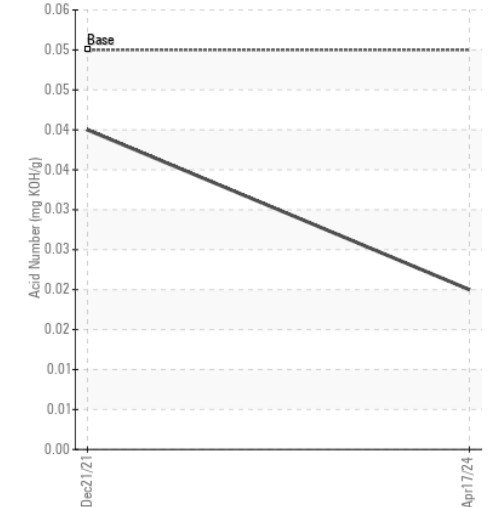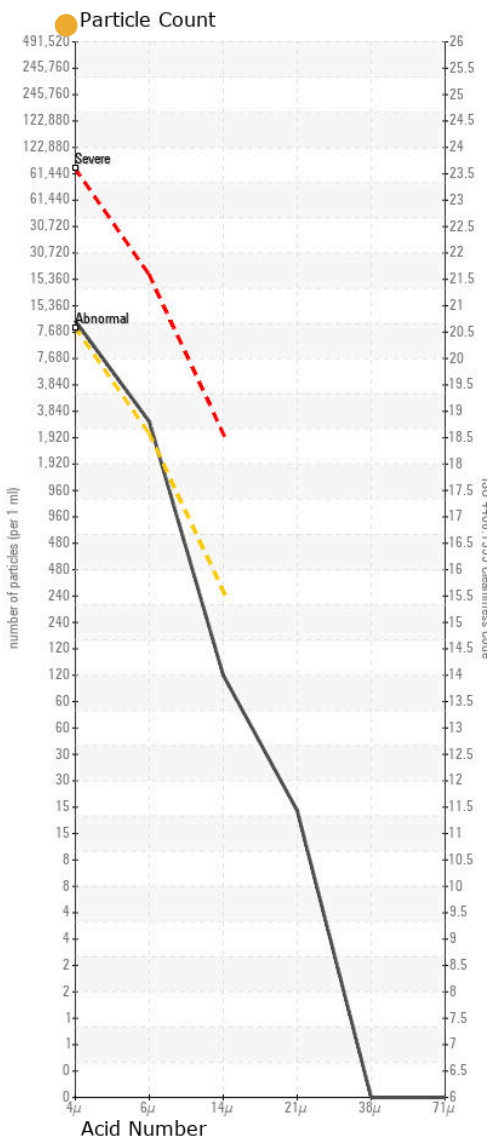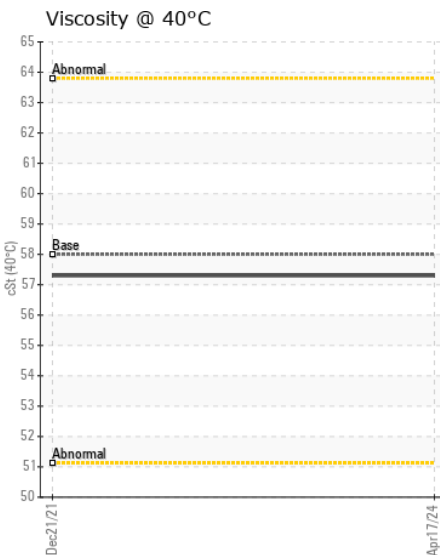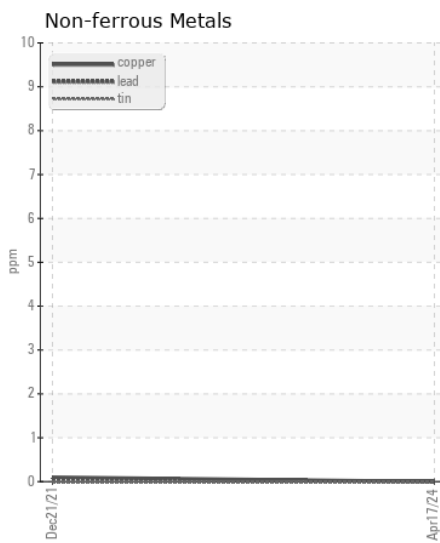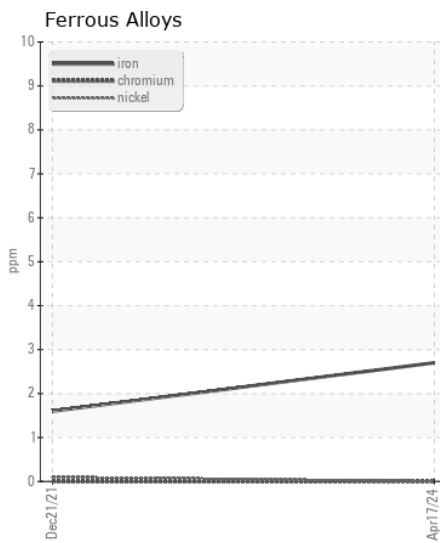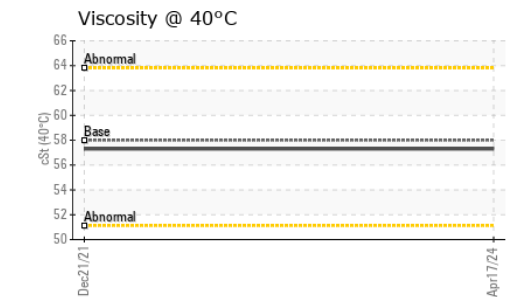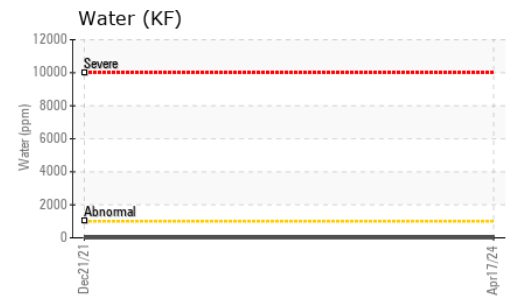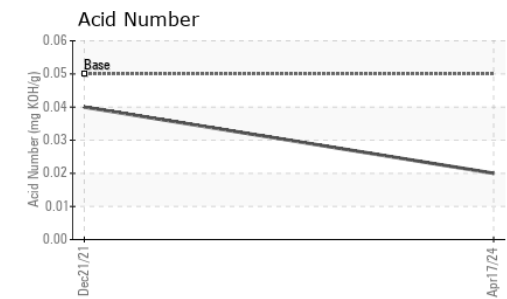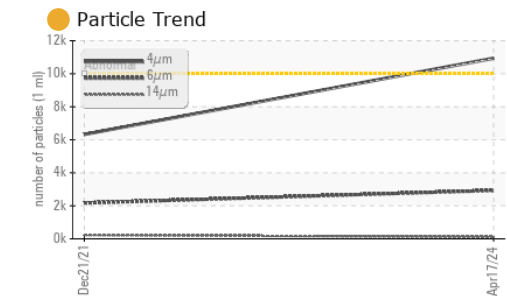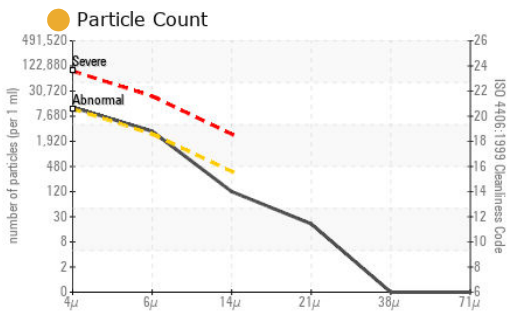

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0924796 **Received** : 25 Apr 2024
Lab Number : 02631339 **Tested** : 29 Apr 2024
Unique Number : 5772492 **Diagnosed** : 29 Apr 2024 - Wes Davis
Test Package : IND 2 (Additional Tests: KF, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

CIMCO Refrigeration
 1551 Corporate Drive
 Burlington, ON
 CA L7L 6M3
 Contact: DAVID PARISE
 DPARISE@ToROMONT.COM
 T: (416)465-7581
 F: (416)465-8815