



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[85705]

Machine Id

6300 STEELES AVE W, VAUGHAN 407 ETR UNIT 6 OR V

Component

Right Diesel Engine

Fluid

ESSO XD-3 EXTRA 15W40 (20 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0006007	PN0004797	PN0003590
Sample Date		Client Info		19 Apr 2024	03 May 2023	05 May 2022
Machine Age	hrs	Client Info		1392	1366	1323
Oil Age	hrs	Client Info		0	43	0
Filter Age	hrs	Client Info		0	43	0
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>51	2	2	1
Chromium	ppm	ASTM D5185(m)	>11	0	0	0
Nickel	ppm	ASTM D5185(m)	>5	0	<1	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>31	1	2	2
Lead	ppm	ASTM D5185(m)	>26	0	0	<1
Copper	ppm	ASTM D5185(m)	>26	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>4	0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>22	2	5	8
Potassium	ppm	ASTM D5185(m)	>20	0	0	<1
Fuel		WC Method	>2.1	<1.0	<1.0	<1.0
Water		WC Method	>0.21	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	4.3	5.1	7.2
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.0	19.2	19.0
Emulsified Water	scalar	Visual*	>0.21	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	1	2	2
Boron	ppm	ASTM D5185(m)		12	39	82
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		58	58	85
Manganese	ppm	ASTM D5185(m)		0	<1	0
Magnesium	ppm	ASTM D5185(m)		895	599	25
Calcium	ppm	ASTM D5185(m)	3780	1133	1564	1808
Phosphorus	ppm	ASTM D5185(m)	1370	1002	1003	1051
Zinc	ppm	ASTM D5185(m)	1500	1150	1051	1158
Sulfur	ppm	ASTM D5185(m)	3800	2635	2647	3254
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.3	15.1	12.9
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	14.5	13.1	14.6

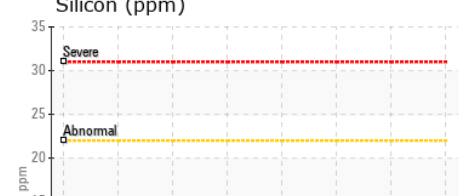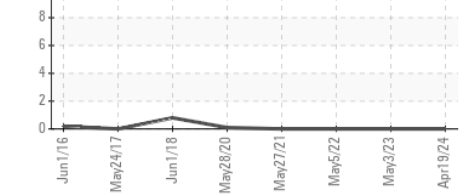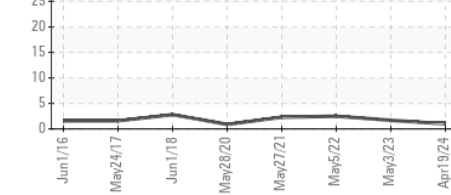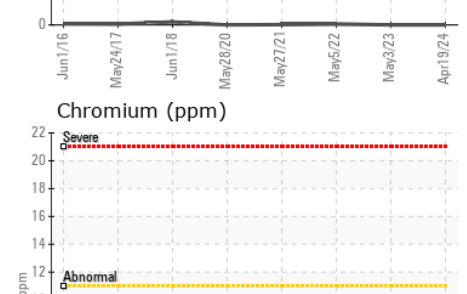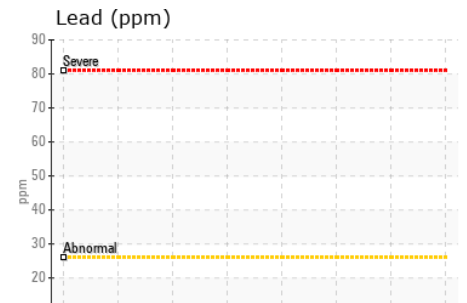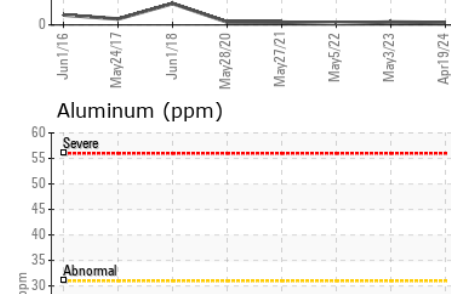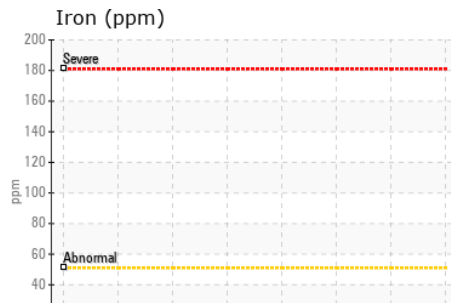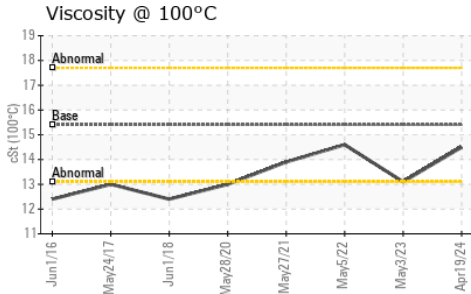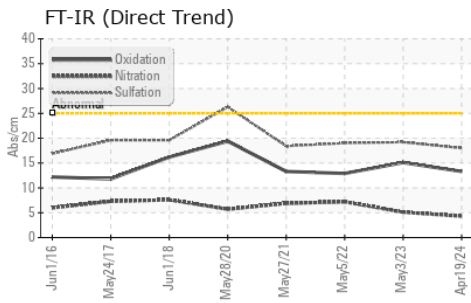

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0006007
Lab Number : 02631481
Unique Number : 5772634
Test Package : MOB 1
Received : 26 Apr 2024
Tested : 26 Apr 2024
Diagnosed : 26 Apr 2024 - Wes Davis

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)665-8544

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.