WEAR CONTAMINATION FLUID CONDITION


NORMAL NORMAL

[85517]

735 HYDE PARK RD LONDON BELL CANADA BELL CANADA

Front Diesel Engine

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		PN0005966	-	PN000325
	Sample Date		Client Info		24 Apr 2024	13 Feb 2023	10 Feb 202
	Machine Age	hrs	Client Info		341	326	303
	Oil Age	hrs	Client Info		0	0	0
	Filter Age	hrs	Client Info		0	0	0
	Oil Changed		Client Info		Changed	Changed	Changed
	Filter Changed		Client Info		Changed	Changed	Changed
	Sample Status				NORMAL	NORMAL	NORMAI
WEAR	Iron	ppm	ASTM D5185(m)	>100	<1	1	1
Metal levels are typical for a new component breaking in.	Chromium	ppm	ASTM D5185(m)	>20	0	0	0
	Nickel	ppm	ASTM D5185(m)	>4	0	0	0
	Titanium	ppm	ASTM D5185(m)		0	0	0
	Silver	ppm	ASTM D5185(m)	>3	0	0	0
	Aluminum	ppm	ASTM D5185(m)	>20	1	3	2
	Lead	ppm	ASTM D5185(m)	>40	0	<1	0
	Copper	ppm	ASTM D5185(m)		<1	<1	<1
	Tin	ppm	ASTM D5185(m)	>15	0	0	<1
	Vanadium	ppm	ASTM D5185(m)		0	0	0
CONTAMINATION	Silicon	ppm	ASTM D5185(m)	>25	4	6	4
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185(m)	>20	<1	0	<1
	Fuel		WC Method	>5	<1.0	<1.0	<1.0
	Water		WC Method	>0.2	NEG	NEG	NEG
	Glycol		WC Method		NEG	NEG	NEG
	Soot %	%	ASTM D7844*	>3	0	0	0
	Nitration	Abs/cm	ASTM D7624*	>20	6.3	7.3	4.2
	Sulfation	Abs/.1mm	ASTM D7415*	>30	16.6	19.1	12.7
	Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG
FLUID CONDITION	Sodium	ppm	ASTM D5185(m)	>192	1	2	3
The condition of the oil is acceptable for the time in service.	Boron	ppm	ASTM D5185(m)		64	74	75
	Barium	ppm	ASTM D5185(m)		0	0	0
	Molybdenum	ppm	ASTM D5185(m)		29	83	73
	Manganese	ppm	ASTM D5185(m)		0	0	0
	Magnesium	ppm	ASTM D5185(m)		220	31	103
	Calcium	ppm	ASTM D5185(m)		1887	2187	1955
	Phosphorus	ppm	ASTM D5185(m)	1370	971	1080	1018
	Zinc	ppm	ASTM D5185(m)	1500	1091	1110	1101
	Sulfur	ppm	ASTM D5185(m)		3113	3197	3136
	Oxidation	Abs/.1mm	ASTM D7414*		12.0	13.3	7.8
	Visc @ 100°C	cSt	ASTM D7279(m)	15.4	14.0	14.1	14.2

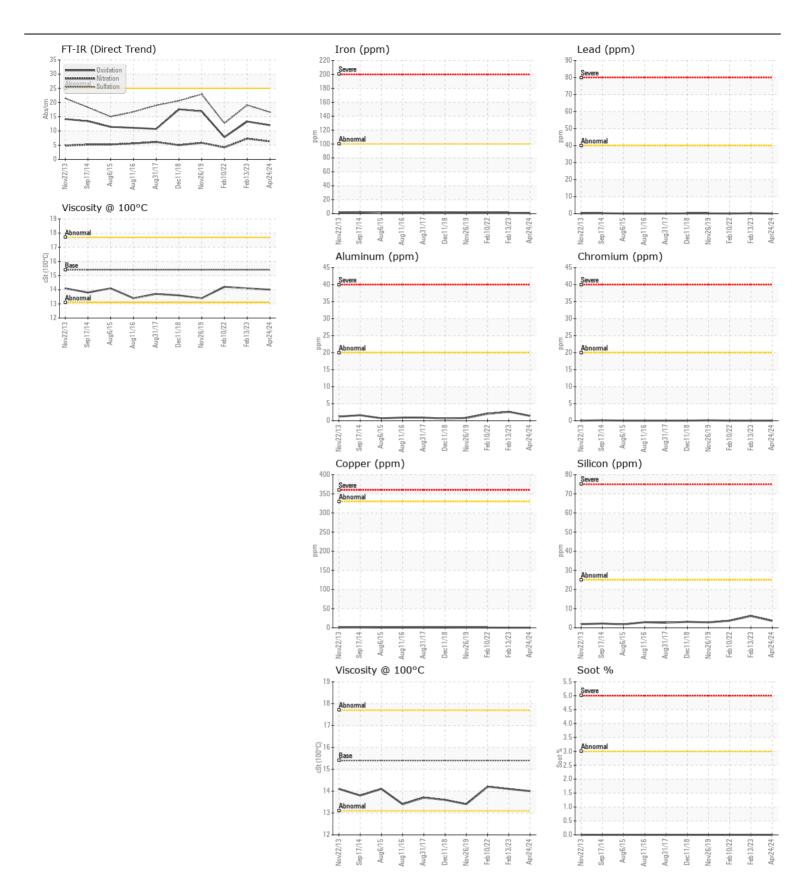



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No.

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 : PN0005966 Lab Number : 02631488 Unique Number : 5772641

Test Package : MOB 1

Received : 26 Apr 2024 **Tested** : 26 Apr 2024 Diagnosed

: 26 Apr 2024 - Wes Davis

POWER STATION INC.

1050 JAYSON COURT MISSISSAUGA, ON CA L4W 2V5 Contact: Brett Kinkley Bkinkley@pwrstn.com

F: (905)565-8544