



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[85528]

Machine Id

479 CLARENCE ST LONDON BELL CANADA UNIT 2

Component

Right Diesel Engine

Fluid

ESSO XD-3 EXTRA SAE 30 (120 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005969	PN0001879	PN0000587
Sample Date		Client Info		22 Apr 2024	15 Dec 2020	28 Nov 2019
Machine Age	hrs	Client Info		323	260	235
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	9	10	7
Chromium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Nickel	ppm	ASTM D5185(m)	>4	<1	<1	<1
Titanium	ppm	ASTM D5185(m)		0	<1	<1
Silver	ppm	ASTM D5185(m)	>3	0	<1	0
Aluminum	ppm	ASTM D5185(m)	>20	2	2	2
Lead	ppm	ASTM D5185(m)	>40	2	2	2
Copper	ppm	ASTM D5185(m)	>330	9	10	7
Tin	ppm	ASTM D5185(m)	>15	<1	1	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	<1	2	2
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	7.0	6.8	7.1
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.5	18.5	23.0
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>16	4	5	3
Boron	ppm	ASTM D5185(m)		33	35	34
Barium	ppm	ASTM D5185(m)		<1	<1	<1
Molybdenum	ppm	ASTM D5185(m)		16	11	11
Manganese	ppm	ASTM D5185(m)		<1	<1	<1
Magnesium	ppm	ASTM D5185(m)		193	179	177
Calcium	ppm	ASTM D5185(m)	2550	2031	2114	2073
Phosphorus	ppm	ASTM D5185(m)	1000	948	957	912
Zinc	ppm	ASTM D5185(m)	1120	1092	1150	1106
Sulfur	ppm	ASTM D5185(m)		3100	3320	3113
Oxidation	Abs/.1mm	ASTM D7414*	>25	15.4	15.8	17.8
Visc @ 100°C	cSt	ASTM D7279(m)	12.0	12.3	12.0	12.5

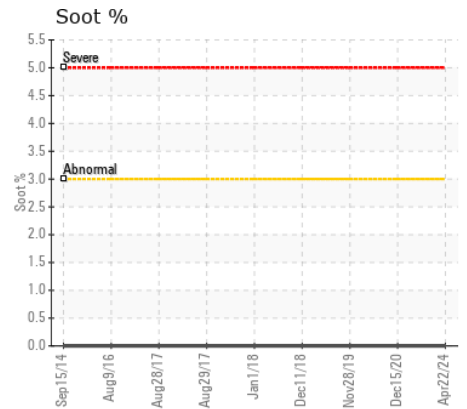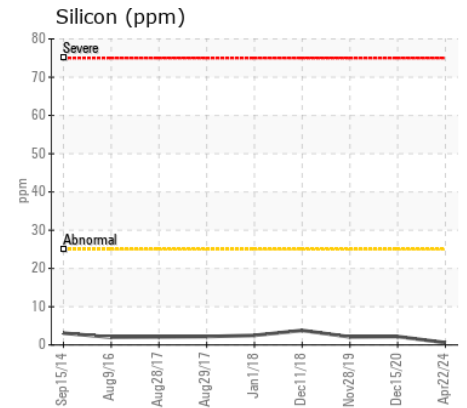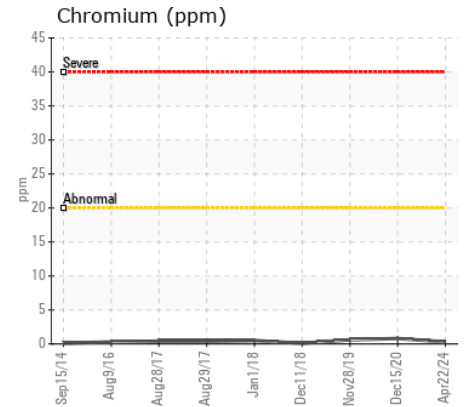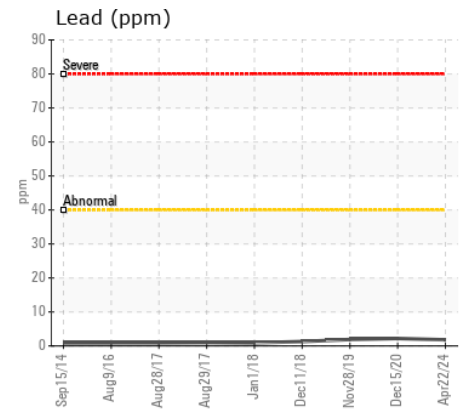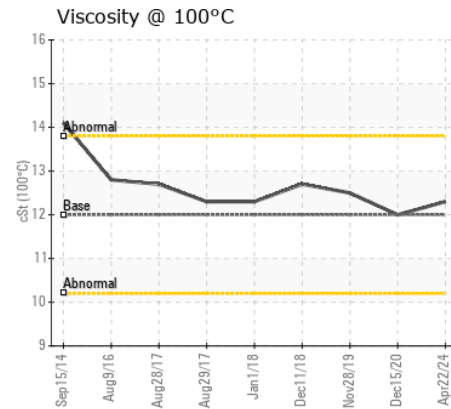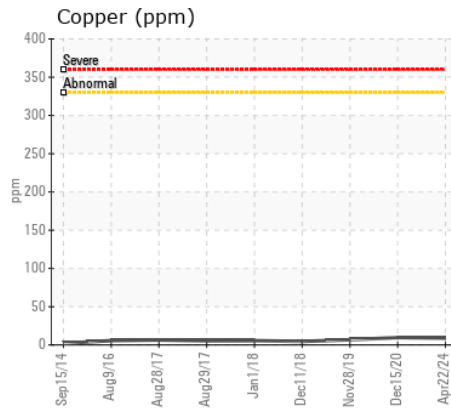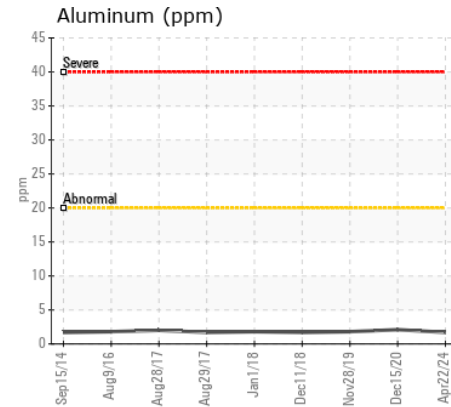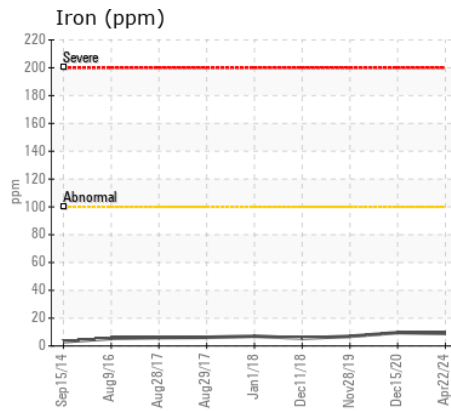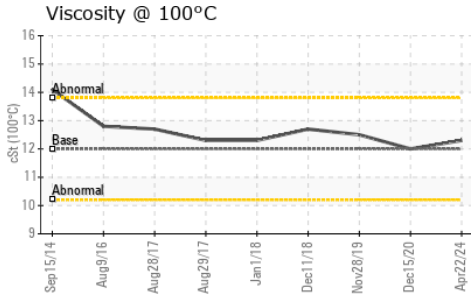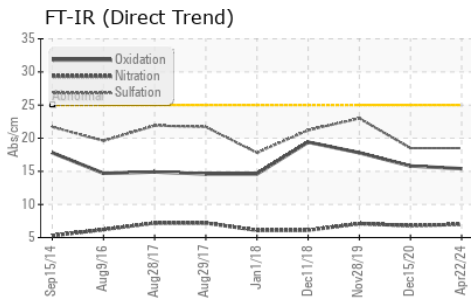

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005969
Lab Number : 02631490
Unique Number : 5772643
Test Package : MOB 1

Received : 26 Apr 2024
Tested : 26 Apr 2024
Diagnosed : 26 Apr 2024 - Wes Davis

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)665-8544

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.