



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**EQUINIX [154819]**  
 Machine Id  
**BLUE (B)**  
 Component  
**Diesel Engine**  
 Fluid  
**VALVOLINE 15W40 (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>CU0022664</b>	---	---
Sample Date		Client Info		<b>01 Apr 2024</b>	---	---
Machine Age	hrs	Client Info		<b>546</b>	---	---
Oil Age	hrs	Client Info		<b>58</b>	---	---
Filter Age	hrs	Client Info		<b>18</b>	---	---
Oil Changed		Client Info		<b>Not Chngd</b>	---	---
Filter Changed		Client Info		<b>Changed</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

## WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	<b>3</b>	---	---
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m)	>2	<b>0</b>	---	---
Titanium	ppm	ASTM D5185(m)	>2	<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)	>2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m)	>25	<b>1</b>	---	---
Lead	ppm	ASTM D5185(m)	>40	<b>0</b>	---	---
Copper	ppm	ASTM D5185(m)	>330	<b>6</b>	---	---
Tin	ppm	ASTM D5185(m)	>15	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	---	---
White Metal	scalar	Visual*	NONE	<b>VLITE</b>	---	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---

## CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	<b>5</b>	---	---
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	---	---
Fuel		WC Method	>6	<b>&lt;1.0</b>	---	---
Water		WC Method	>0.2	<b>NEG</b>	---	---
Glycol		WC Method		<b>NEG</b>	---	---
Soot %	%	ASTM D7844*	>3	<b>0</b>	---	---
Nitration	Abs/cm	ASTM D7624*	>20	<b>5.9</b>	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>21.1</b>	---	---
Silt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Debris	scalar	Visual*	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	---	---

## FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		<b>2</b>	---	---
Boron	ppm	ASTM D5185(m)	39	<b>170</b>	---	---
Barium	ppm	ASTM D5185(m)	1	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m)	49	<b>53</b>	---	---
Manganese	ppm	ASTM D5185(m)	1	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m)	616	<b>490</b>	---	---
Calcium	ppm	ASTM D5185(m)	1554	<b>1617</b>	---	---
Phosphorus	ppm	ASTM D5185(m)	899	<b>924</b>	---	---
Zinc	ppm	ASTM D5185(m)	1069	<b>1056</b>	---	---
Sulfur	ppm	ASTM D5185(m)	2624	<b>2542</b>	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>18.2</b>	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	13.6	<b>12.1</b>	---	---

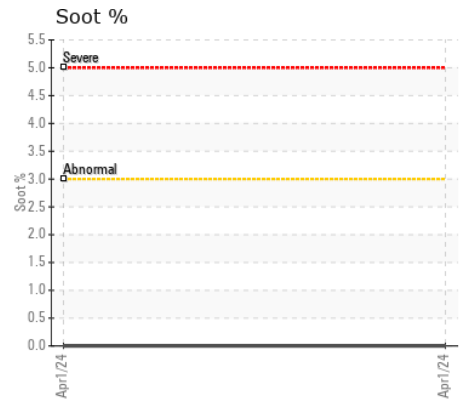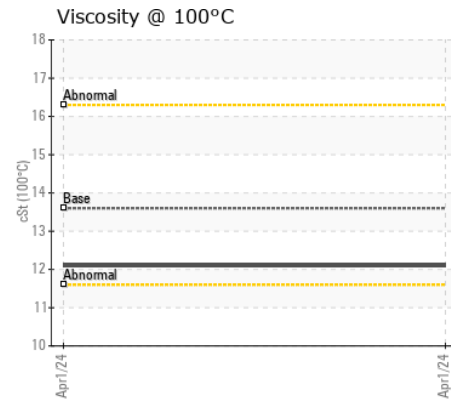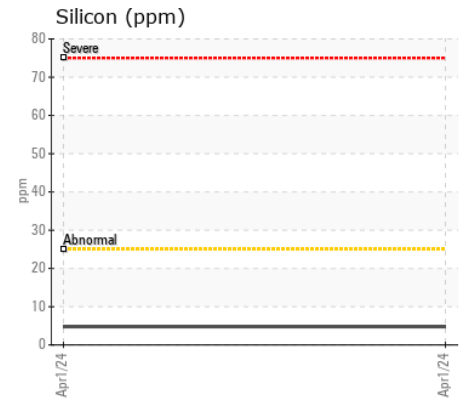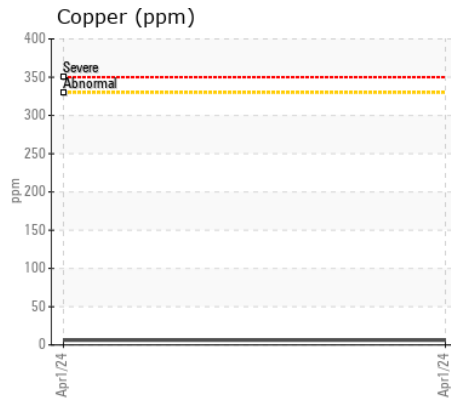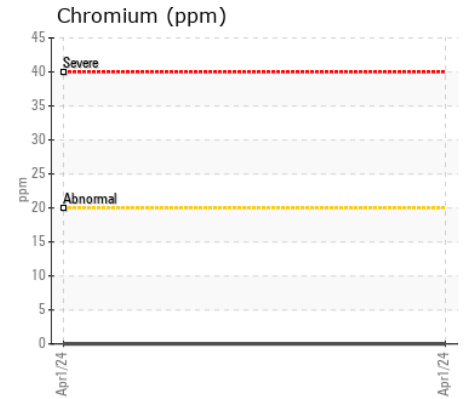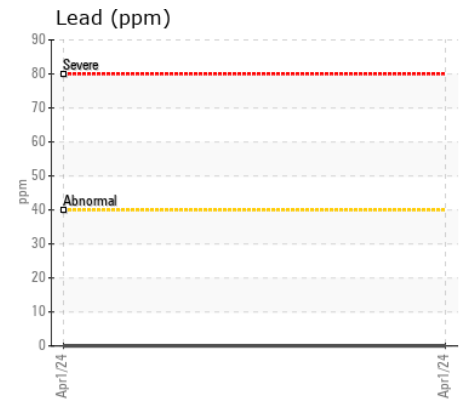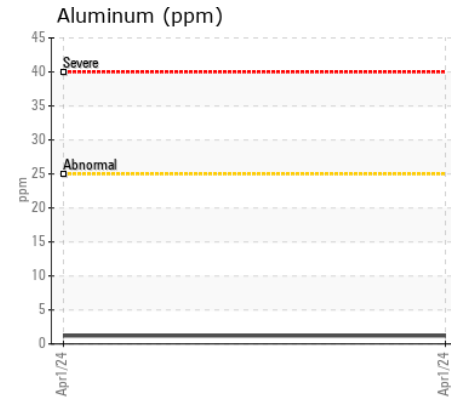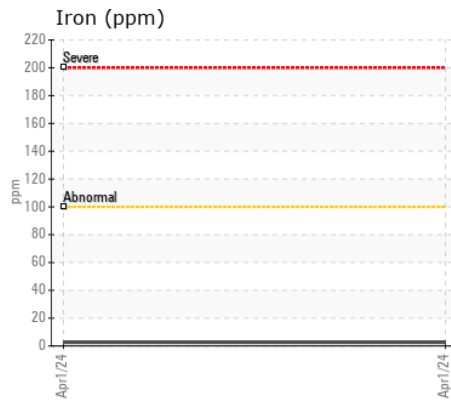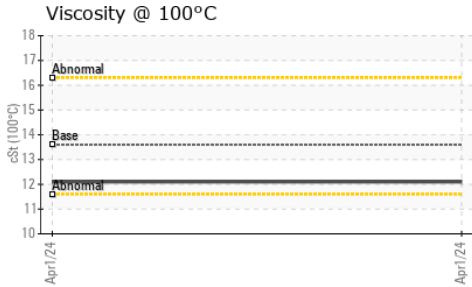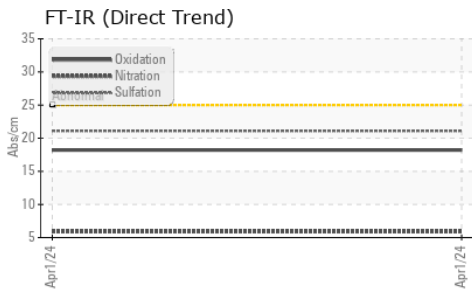

ISO 17025:2017  
Accredited  
Laboratory

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : CU0022664  
**Lab Number** : 02631884  
**Unique Number** : 5773037  
**Test Package** : MOB 1 ( Additional Tests: Visual )

**CUMMINS CANADA ULC - GENERATOR DIVISION**  
 7175 PACIFIC CIRCLE  
 MISSISSAUGA, ON  
 CA L5T 2A5  
 Contact: Elisia Johnson  
 elisia.johnson@cummins.com  
 T: (905)795-0050  
 F: (905)795-9252

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.