



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**EQUINIX [154220]**  
 Machine Id  
**GENERATOR D (S/N 33144703)**  
 Component  
**Diesel Engine**  
 Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>CU0022669</b>	CU0020865	CU0018492
Sample Date		Client Info		<b>02 Apr 2024</b>	29 Mar 2023	23 Sep 2021
Machine Age	hrs	Client Info		<b>515</b>	497	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>17</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	Changed
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

## WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>65	<b>2</b>	2	3
Chromium	ppm	ASTM D5185(m)	>3	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>2	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185(m)	>2	<b>0</b>	<1	<1
Silver	ppm	ASTM D5185(m)	>2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185(m)	>6	<b>&lt;1</b>	<1	2
Lead	ppm	ASTM D5185(m)	>13	<b>2</b>	<1	<1
Copper	ppm	ASTM D5185(m)	>65	<b>140</b>	35	2
Tin	ppm	ASTM D5185(m)	>2	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	<1

## CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	<b>3</b>	4	5
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	1
Fuel		WC Method	>3.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	ASTM D7844*	>6	<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>7.3</b>	7.2	5.6
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>19.9</b>	22.9	20.3
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG

## FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>158	<b>3</b>	3	2
Boron	ppm	ASTM D5185(m)	250	<b>76</b>	81	380
Barium	ppm	ASTM D5185(m)	10	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)	100	<b>51</b>	51	76
Manganese	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185(m)	450	<b>761</b>	755	389
Calcium	ppm	ASTM D5185(m)	3000	<b>1264</b>	1312	1556
Phosphorus	ppm	ASTM D5185(m)	1150	<b>758</b>	824	1046
Zinc	ppm	ASTM D5185(m)	1350	<b>861</b>	867	1196
Sulfur	ppm	ASTM D5185(m)	4250	<b>2064</b>	2184	3023
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>18.3</b>	17.5	14.8
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	<b>13.9</b>	13.8	13.6

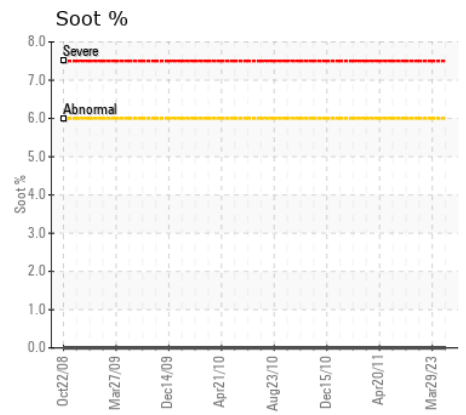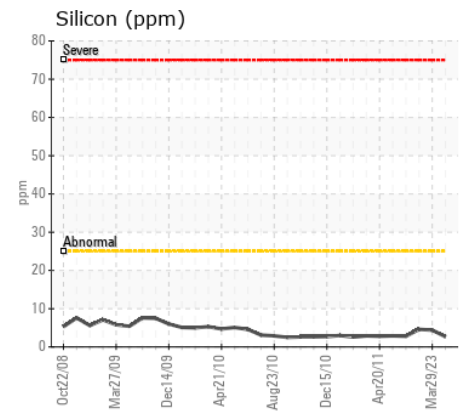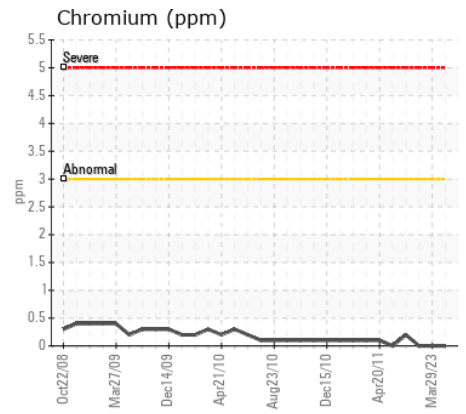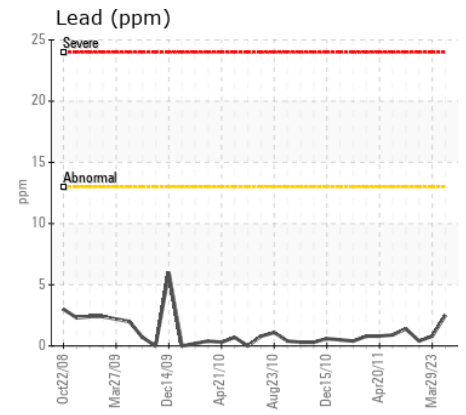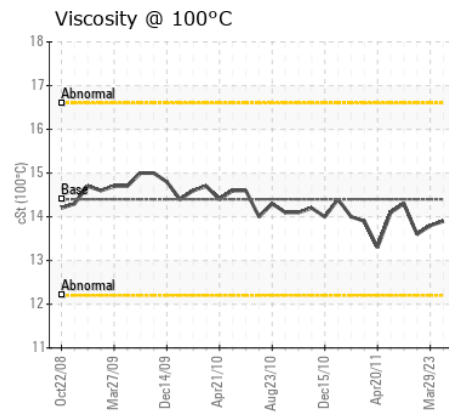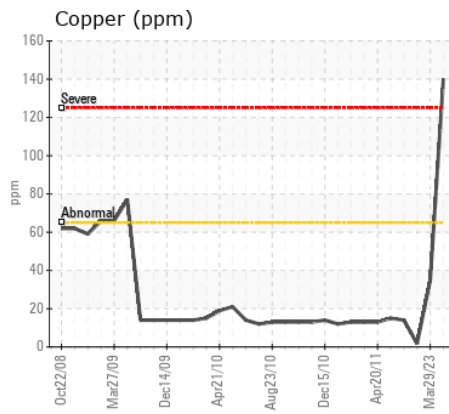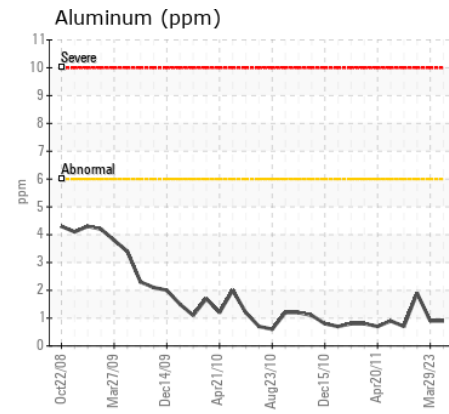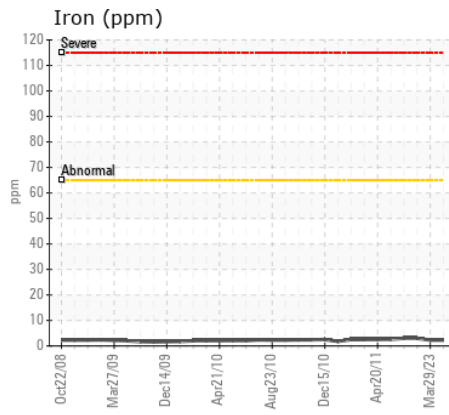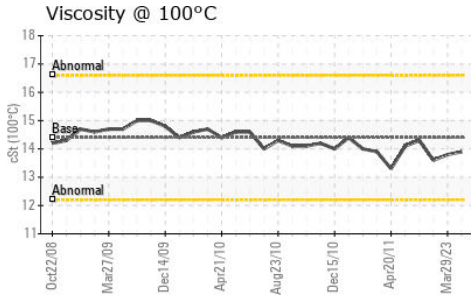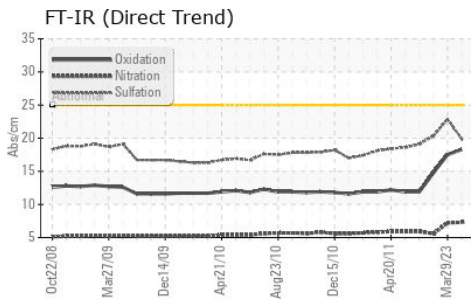

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : CU0022669  
**Lab Number** : 02631890  
**Unique Number** : 5773043  
**Test Package** : MOB 1  
**Received** : 29 Apr 2024  
**Tested** : 29 Apr 2024  
**Diagnosed** : 29 Apr 2024 - Wes Davis

**CUMMINS CANADA ULC - GENERATOR DIVISION**  
 7175 PACIFIC CIRCLE  
 MISSISSAUGA, ON  
 CA L5T 2A5  
 Contact: Elisia Johnson  
 elisia.johnson@cummins.com  
 T: (905)795-0050  
 F: (905)795-9252

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.