



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
SOBEYS VAUGHAN [4501238207]
 Machine Id
FRICK COMP #4 (S/N 1024IE53800312)
 Component
4 Screw Compressor
 Fluid
FRICK COMPRESSOR OIL #3 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0902705	WC0749625	---
Sample Date		Client Info		27 Mar 2024	08 Nov 2022	---
Machine Age	hrs	Client Info		41788	33845	---
Oil Age	hrs	Client Info		0	12216	---
Filter Age	hrs	Client Info		0	12216	---
Oil Changed		Client Info		N/A	Not Changd	---
Filter Changed		Client Info		N/A	Not Changd	---
Sample Status				NORMAL	NORMAL	---

WEAR

All component wear rates are normal.

PQ		ASTM D8184*		0	0	---
Iron	ppm	ASTM D5185(m)	>60	2	4	---
Chromium	ppm	ASTM D5185(m)	>4	0	0	---
Nickel	ppm	ASTM D5185(m)		0	0	---
Titanium	ppm	ASTM D5185(m)		0	0	---
Silver	ppm	ASTM D5185(m)		0	0	---
Aluminum	ppm	ASTM D5185(m)	>5	0	0	---
Lead	ppm	ASTM D5185(m)	>10	0	0	---
Copper	ppm	ASTM D5185(m)	>30	0	0	---
Tin	ppm	ASTM D5185(m)	>15	0	0	---
Vanadium	ppm	ASTM D5185(m)		0	0	---
White Metal	scalar	Visual*	NONE	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	---

CONTAMINATION










The water content is negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>50	<1	2	---
Potassium	ppm	ASTM D5185(m)	>20	0	<1	---
Water	%	ASTM D6304*	>0.1	0.00	0.001	---
ppm Water	ppm	ASTM D6304*	>1000	0	3.8	---
Silt	scalar	Visual*	NONE	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185(m)		0	<1	---
Boron	ppm	ASTM D5185(m)		0	<1	---
Barium	ppm	ASTM D5185(m)		2	4	---
Molybdenum	ppm	ASTM D5185(m)		0	0	---
Manganese	ppm	ASTM D5185(m)		0	0	---
Magnesium	ppm	ASTM D5185(m)		0	<1	---
Calcium	ppm	ASTM D5185(m)		0	0	---
Phosphorus	ppm	ASTM D5185(m)		0	0	---
Zinc	ppm	ASTM D5185(m)		2	2	---
Sulfur	ppm	ASTM D5185(m)		20	21	---
Acid Number (AN)	mg KOH/g	ASTM D974*		0.02	0.00	---
Visc @ 40°C	cSt	ASTM D7279(m)	73	71.9	69.8	---

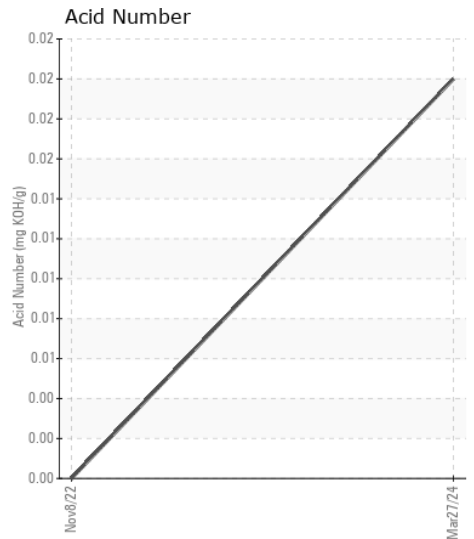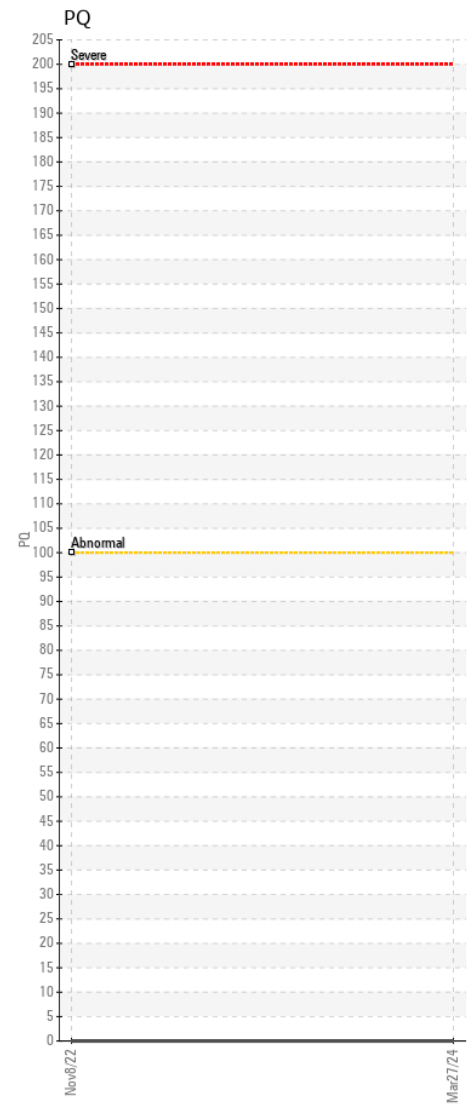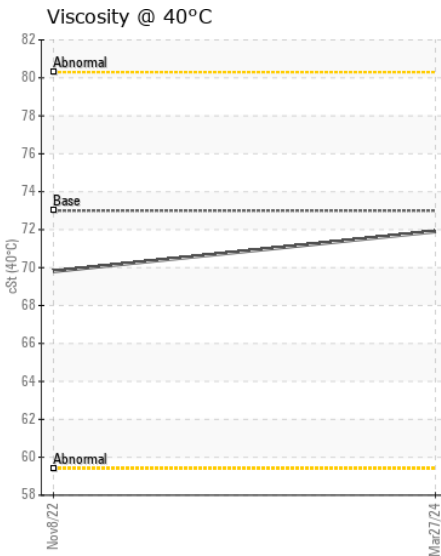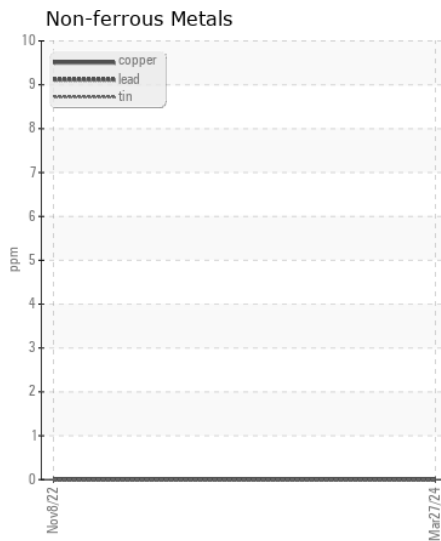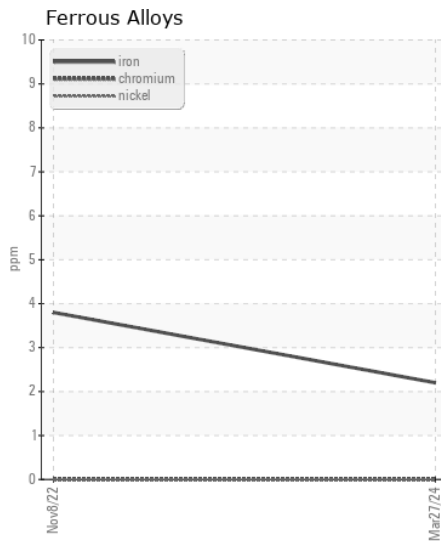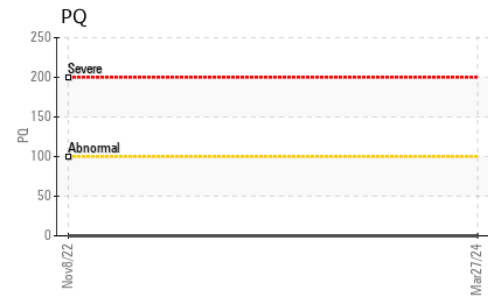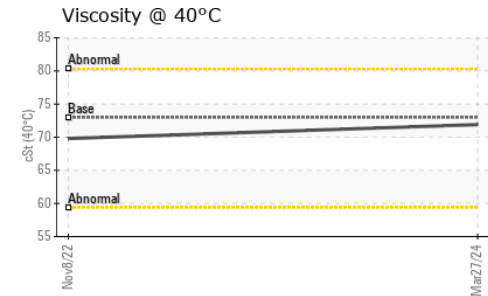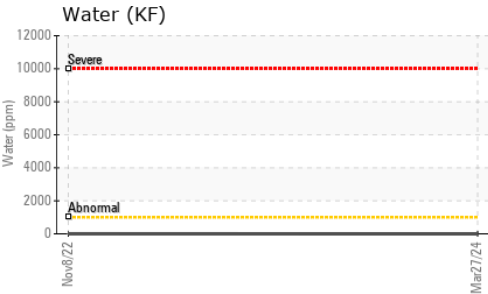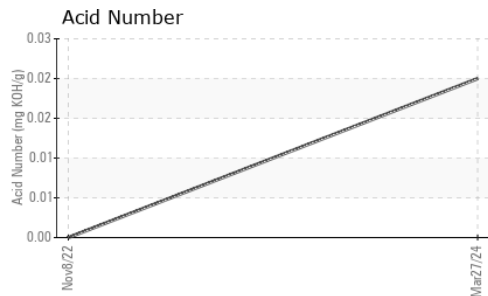

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0902705 **Received** : 29 Apr 2024
Lab Number : 02631974 **Tested** : 01 May 2024
Unique Number : 5773127 **Diagnosed** : 01 May 2024 - Wes Davis
Test Package : IND 2 (Additional Tests: KF, TAN Man)

CIMCO Refrigeration
 1551 Corporate Drive
 Burlington, ON
 CA L7L 6M3
 Contact: DAVID PARISE
 DPARISE@ToROMONT.COM
 T: (416)465-7581
 F: (416)465-8815

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.