

Area
[1249904]
Machine Id
913141
Component
Diesel Engine
Fluid
PETRO CANADA 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		GFL0113083	GFL0096677	GFL0096680
Sample Date		Client Info		30 Apr 2024	26 Dec 2023	20 Dec 2023
Machine Age	kms	Client Info		0	0	0
Oil Age	kms	Client Info		0	0	0
Filter Age	kms	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	23	6	14
Chromium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Nickel	ppm	ASTM D5185(m)	>4	4	1	3
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)	>3	0	<1	<1
Aluminum	ppm	ASTM D5185(m)	>20	2	1	2
Lead	ppm	ASTM D5185(m)	>40	0	0	<1
Copper	ppm	ASTM D5185(m)	>330	2	1	10
Tin	ppm	ASTM D5185(m)	>15	<1	<1	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	2	2	3
Potassium	ppm	ASTM D5185(m)	>20	3	2	4
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>3	0.6	0.2	0.4
Nitration	Abs/cm	ASTM D7624*	>20	10.4	6.4	8.4
Sulfation	Abs/.1mm	ASTM D7415*	>30	21.1	18.5	20.4
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		2	1	1
Boron	ppm	ASTM D5185(m)		4	5	4
Barium	ppm	ASTM D5185(m)		0	0	<1
Molybdenum	ppm	ASTM D5185(m)		62	58	60
Manganese	ppm	ASTM D5185(m)		<1	0	0
Magnesium	ppm	ASTM D5185(m)		975	946	967
Calcium	ppm	ASTM D5185(m)		1065	1040	1062
Phosphorus	ppm	ASTM D5185(m)		994	1003	996
Zinc	ppm	ASTM D5185(m)		1188	1160	1178
Sulfur	ppm	ASTM D5185(m)		2375	2701	2541
Oxidation	Abs/.1mm	ASTM D7414*	>25	16.9	13.8	15.6
Visc @ 100°C	cSt	ASTM D7279(m)		13.7	14.0	13.7

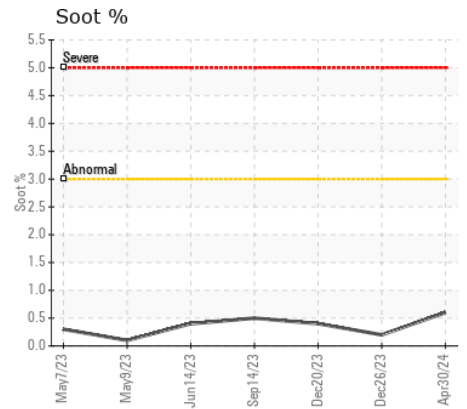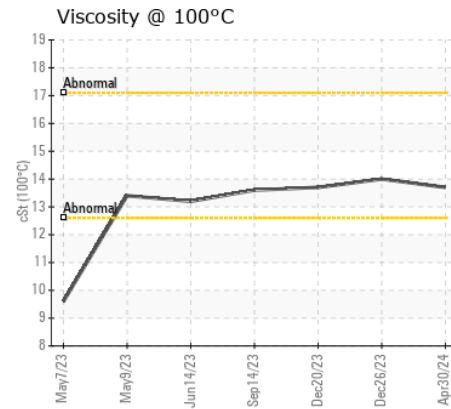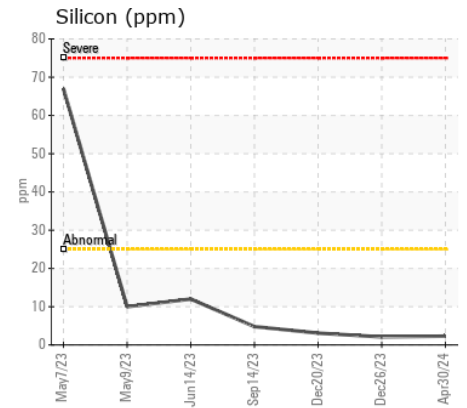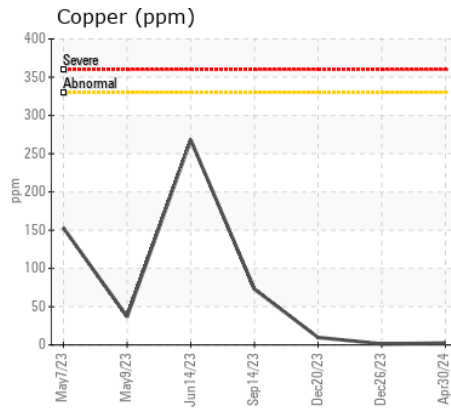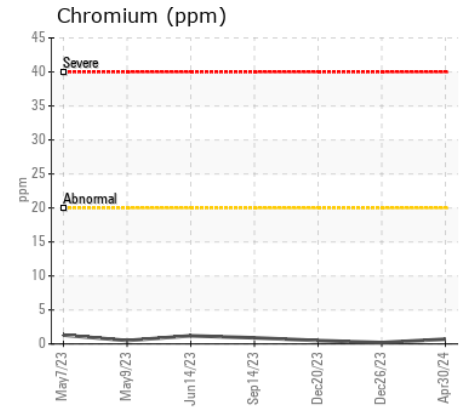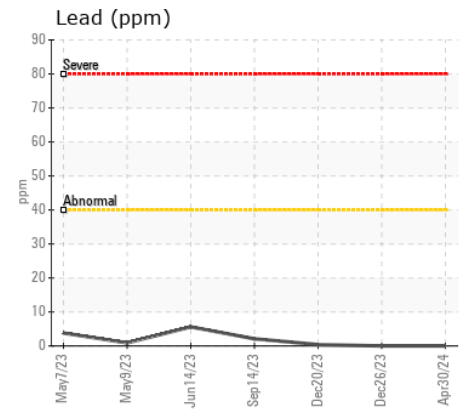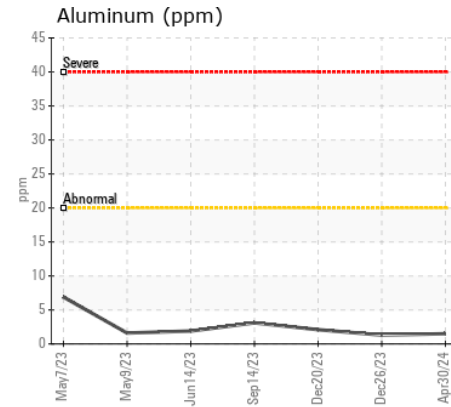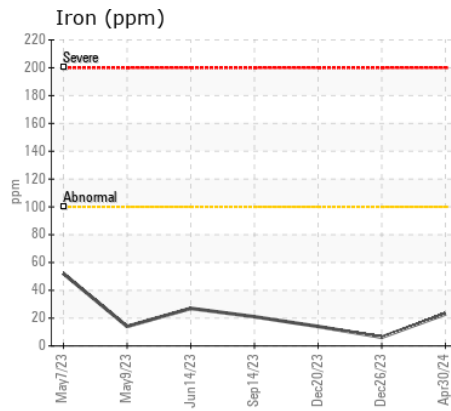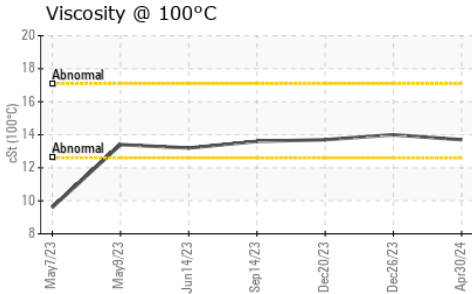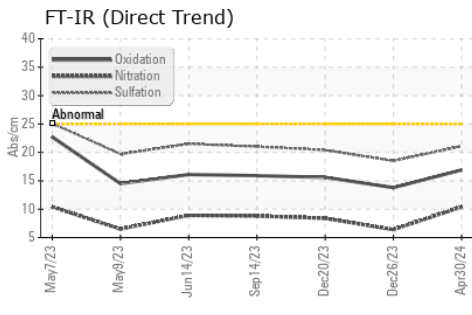

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : GFL0113083
Lab Number : 02632502
Unique Number : 5773655
Test Package : MOB 1 (Additional Tests: Visual)
Received : 01 May 2024
Tested : 01 May 2024
Diagnosed : 01 May 2024 - Wes Davis

GFL Environmental - 851 - New Glasgow
 108 ACHERON COURT
 STELLARTON, NS
 CA B0K 1S0
 Contact: Lloyd Kenny
 lkenny@gflenv.com
 T: (902)755-5300
 F: (902)752-2301

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.