



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[01-26842]

Machine Id

7009177094

Component

Diesel Engine

Fluid

DIESEL ENGINE OIL SAE 40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) DIESEL ENGINE OIL SAE 40. Please confirm.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WA0019420	---	---
Sample Date		Client Info		26 Apr 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		200	---	---
Filter Age	hrs	Client Info		200	---	---
Oil Changed		Client Info		Not Chngd	---	---
Filter Changed		Client Info		Not Chngd	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	12	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	2	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	2	---	---
Lead	ppm	ASTM D5185(m)	>40	2	---	---
Copper	ppm	ASTM D5185(m)	>330	16	---	---
Tin	ppm	ASTM D5185(m)	>15	<1	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	11	---	---
Potassium	ppm	ASTM D5185(m)	>20	4	---	---
Fuel		WC Method	>5	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	7.2	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.5	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185(m)	>216	3	---	---
Boron	ppm	ASTM D5185(m)	250	18	---	---
Barium	ppm	ASTM D5185(m)	10	0	---	---
Molybdenum	ppm	ASTM D5185(m)	100	8	---	---
Manganese	ppm	ASTM D5185(m)		<1	---	---
Magnesium	ppm	ASTM D5185(m)	450	165	---	---
Calcium	ppm	ASTM D5185(m)	3000	1993	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	918	---	---
Zinc	ppm	ASTM D5185(m)	1350	1084	---	---
Sulfur	ppm	ASTM D5185(m)	4250	2862	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	15.4	---	---
Base Number (BN)	mg KOH/g	ASTM D2896*	8.5	8.68	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	13.7	---	---

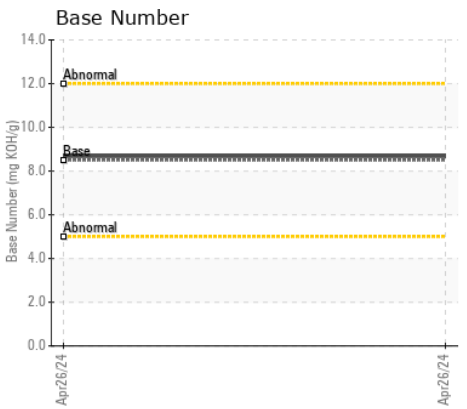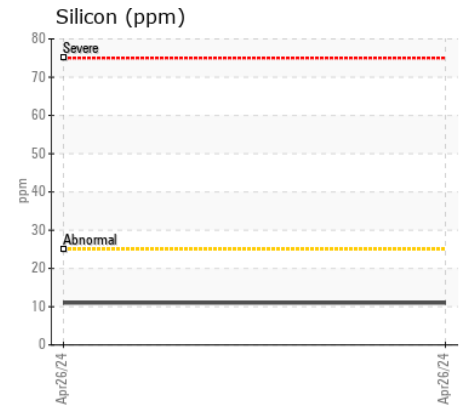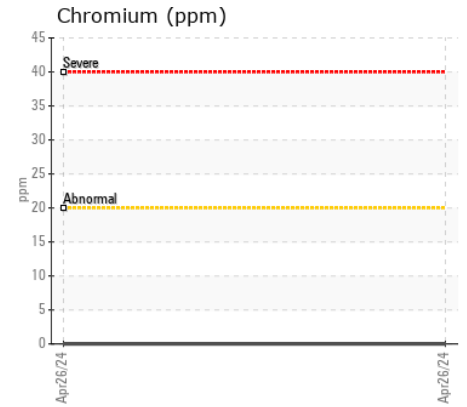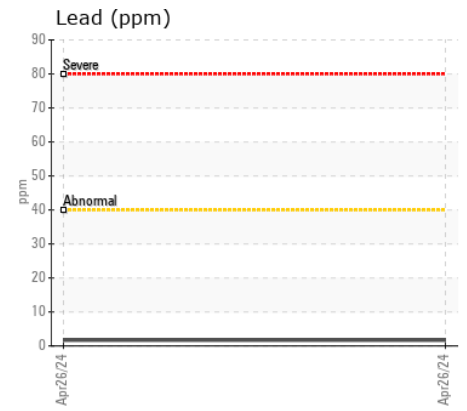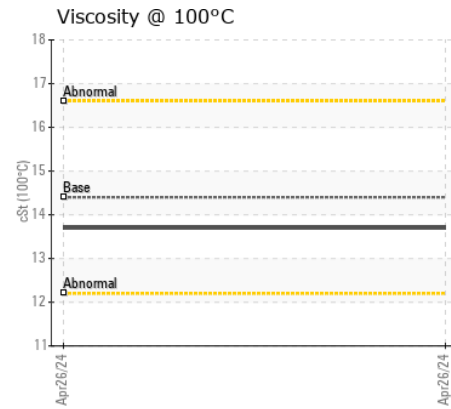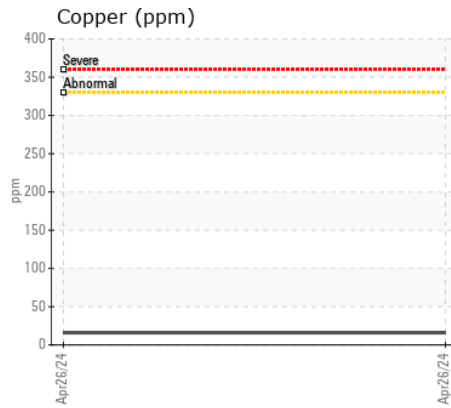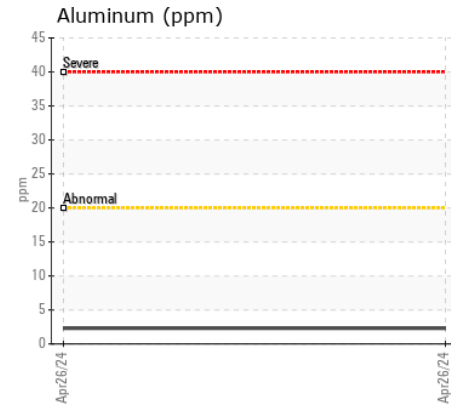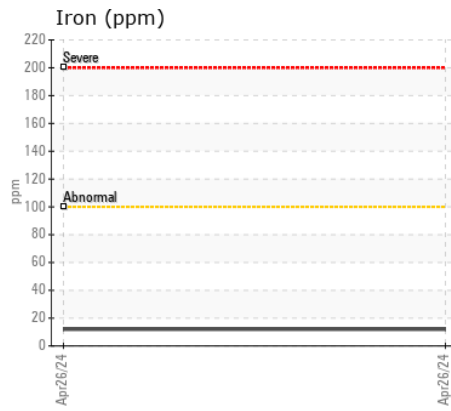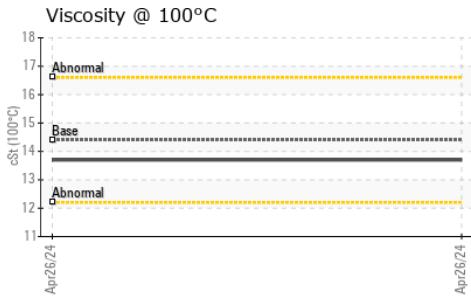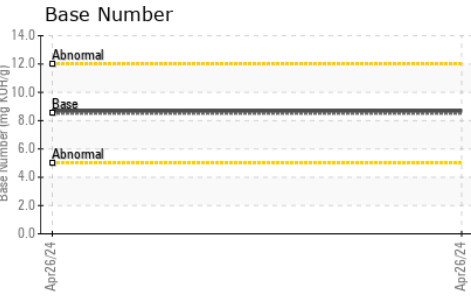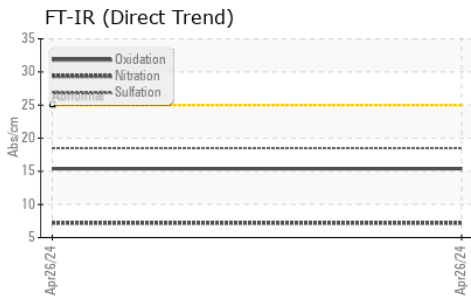

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0019420
Lab Number : 02632738
Unique Number : 5773891
Test Package : MOB 2
Received : 02 May 2024
Tested : 03 May 2024
Diagnosed : 03 May 2024 - Kevin Marson

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

CHANTIER BLYACHT
 1225 BOUL. CHAMPLAIN
 QUEBEC, QC
 CA G1K 0A2
 Contact: Service Manager
 rboulet@chantierblyacht.com
 T: (514)961-2206
 F: