



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[01-26842]

Machine Id

C100106202

Component

Diesel Engine

Fluid

DIESEL ENGINE OIL SAE 40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) DIESEL ENGINE OIL SAE 40. Please confirm.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WA0018730	---	---
Sample Date		Client Info		26 Apr 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		100	---	---
Filter Age	hrs	Client Info		100	---	---
Oil Changed		Client Info		Not Changd	---	---
Filter Changed		Client Info		Not Changd	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>90	13	---	---
Chromium	ppm	ASTM D5185(m)	>20	<1	---	---
Nickel	ppm	ASTM D5185(m)	>2	0	---	---
Titanium	ppm	ASTM D5185(m)	>2	0	---	---
Silver	ppm	ASTM D5185(m)	>2	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	1	---	---
Lead	ppm	ASTM D5185(m)	>40	<1	---	---
Copper	ppm	ASTM D5185(m)	>330	4	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	17	---	---
Potassium	ppm	ASTM D5185(m)	>20	1	---	---
Fuel		WC Method	>3.0	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>6	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	6.4	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	16.1	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>216	6	---	---
Boron	ppm	ASTM D5185(m)	250	4	---	---
Barium	ppm	ASTM D5185(m)	10	<1	---	---
Molybdenum	ppm	ASTM D5185(m)	100	38	---	---
Manganese	ppm	ASTM D5185(m)		<1	---	---
Magnesium	ppm	ASTM D5185(m)	450	704	---	---
Calcium	ppm	ASTM D5185(m)	3000	1289	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	949	---	---
Zinc	ppm	ASTM D5185(m)	1350	1129	---	---
Sulfur	ppm	ASTM D5185(m)	4250	2796	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	12.6	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	13.0	---	---

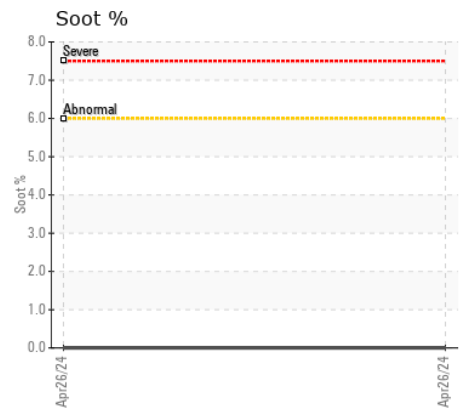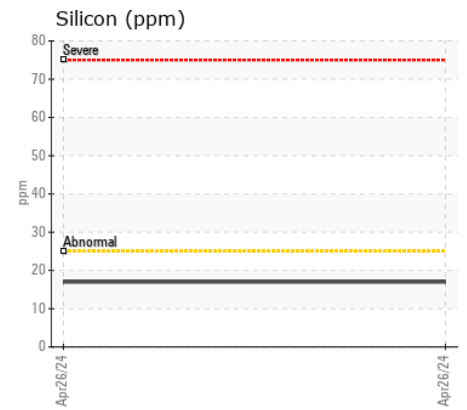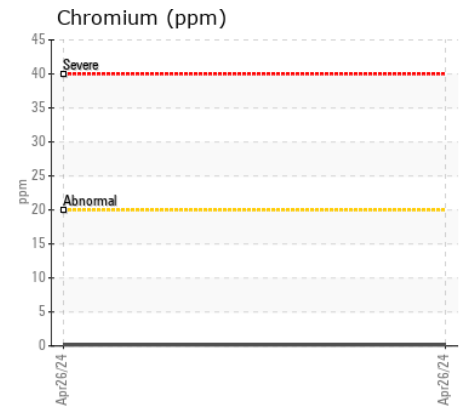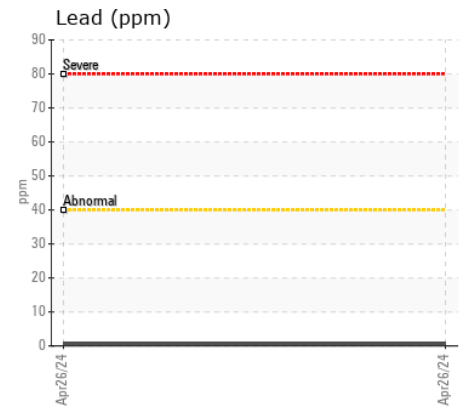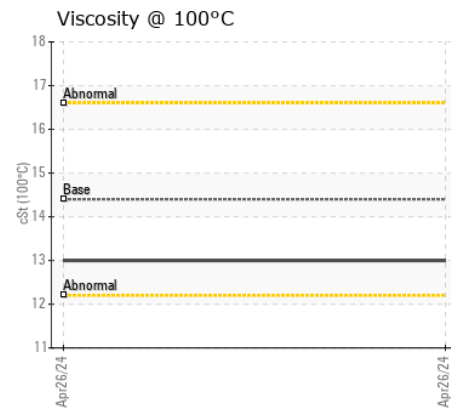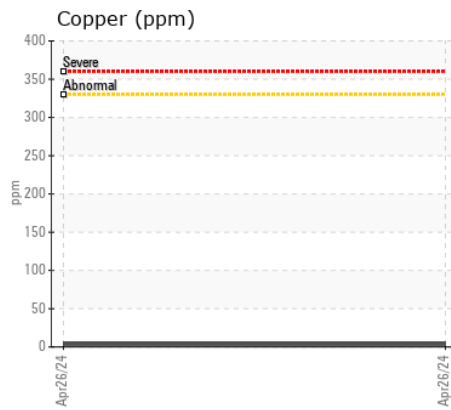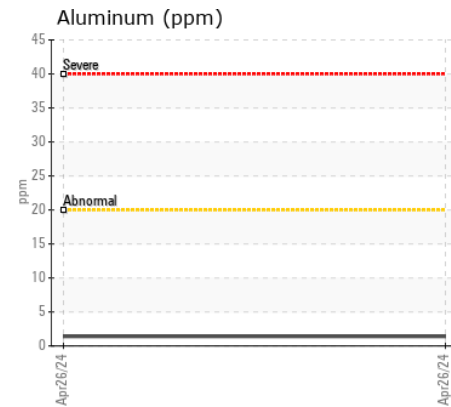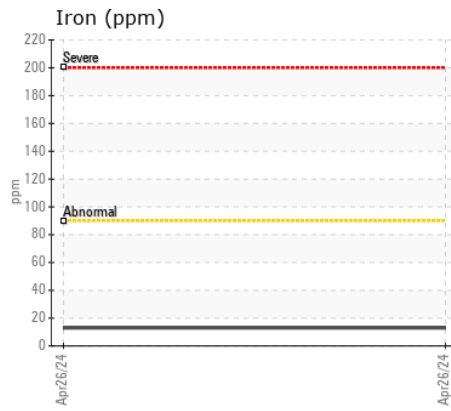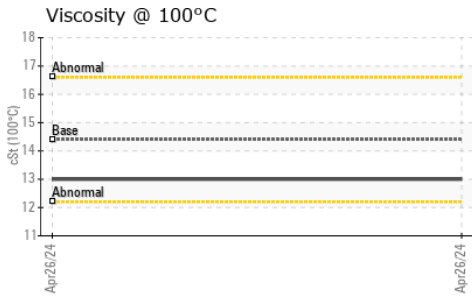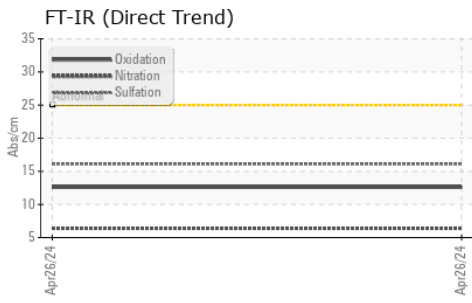

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0018730 **Received** : 02 May 2024
Lab Number : 02632740 **Tested** : 02 May 2024
Unique Number : 5773893 **Diagnosed** : 02 May 2024 - Wes Davis
Test Package : MOB 1

CHANTIER BLYACHT
 1225 BOUL. CHAMPLAIN
 QUEBEC, QC
 CA G1K 0A2
 Contact: Service Manager
 rboulet@chantierblyacht.com
 T: (514)961-2206
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.