



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ATTENTION
FLUID CONDITION	NORMAL

Area
1 White Oil/028 #1HTU/P Pump/201B 1 Stage HTU Charge

Machine Id
N/A 28P201B (RECIP)

Component
Pump

Fluid
PETRO CANADA COMPRO COMPRESSOR OIL 150 (150 LTR)

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0873650	WC0902157	WC0783256
Sample Date		Client Info		29 Apr 2024	25 Feb 2024	17 Feb 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				ATTENTION	ABNORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>90	<1	<1	<1
Chromium	ppm	ASTM D5185(m)	>5	0	0	0
Nickel	ppm	ASTM D5185(m)	>5	0	<1	0
Titanium	ppm	ASTM D5185(m)	>3	0	0	0
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>7	0	<1	<1
Lead	ppm	ASTM D5185(m)	>12	0	0	<1
Copper	ppm	ASTM D5185(m)	>30	1	2	2
Tin	ppm	ASTM D5185(m)	>9	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE

CONTAMINATION










There is a light amount of silt (particulates < 14 microns in size) present in the oil.

Silicon	ppm	ASTM D5185(m)	>60	16	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	0
Water		WC Method	>.1	NEG	NEG	NEG
Particles >4µm		ASTM D7647	>5000	5306	▲ 11427	2294
Particles >6µm		ASTM D7647	>1300	1335	▲ 2940	697
Particles >14µm		ASTM D7647	>160	79	● 245	20
Particles >21µm		ASTM D7647	>40	21	● 62	5
Particles >38µm		ASTM D7647	>10	3	6	0
Particles >71µm		ASTM D7647	>3	2	3	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	20/18/13	▲ 21/19/15	18/17/11
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	VLITE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>.1	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185(m)		<1	0	0
Boron	ppm	ASTM D5185(m)	0	<1	0	<1
Barium	ppm	ASTM D5185(m)	0	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)	70	<1	<1	0
Calcium	ppm	ASTM D5185(m)	0	0	0	0
Phosphorus	ppm	ASTM D5185(m)	60	1	1	<1
Zinc	ppm	ASTM D5185(m)	2	<1	<1	1
Sulfur	ppm	ASTM D5185(m)	5300	3023	3445	3231
Acid Number (AN)	mg KOH/g	ASTM D974*	0.3	0.07	0.09	0.10
Visc @ 40°C	cSt	ASTM D7279(m)	150	141	141	149

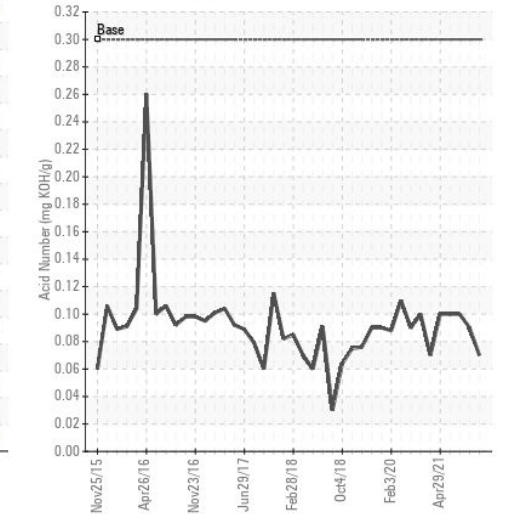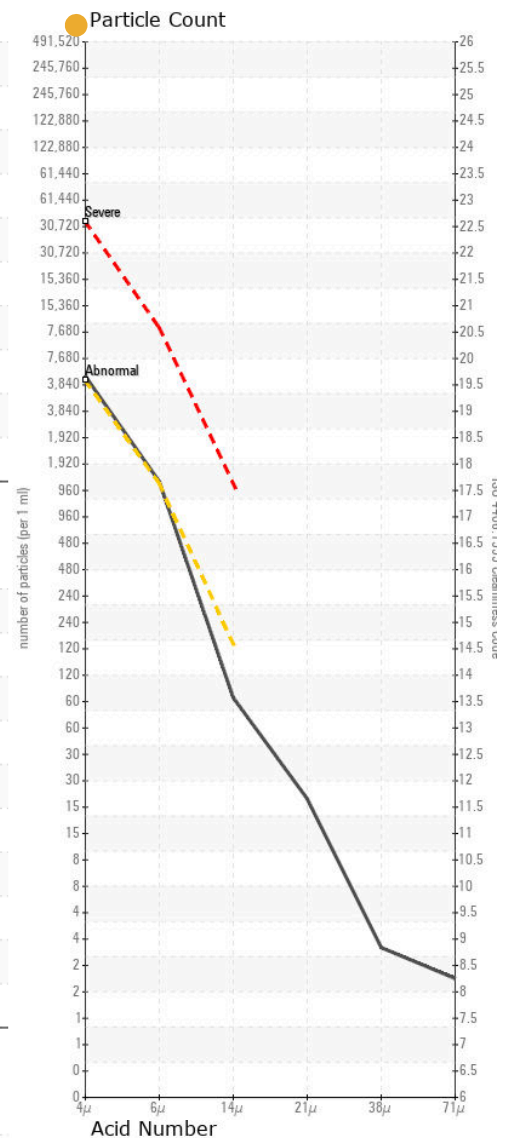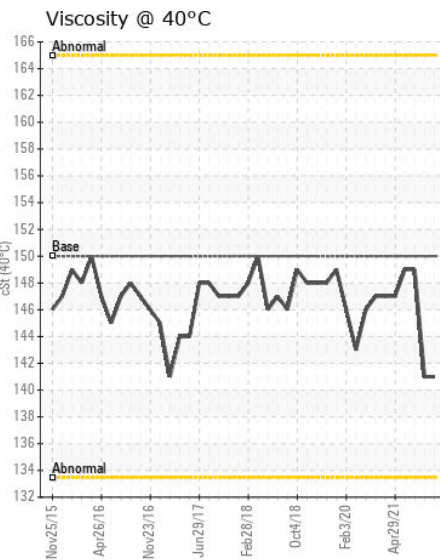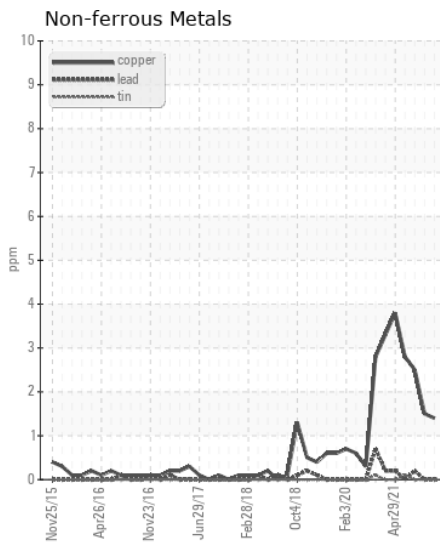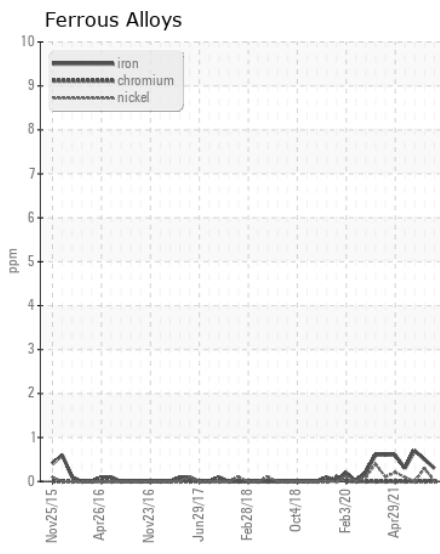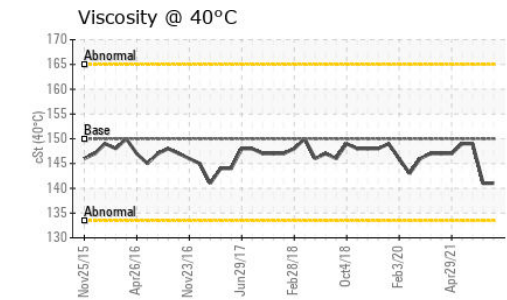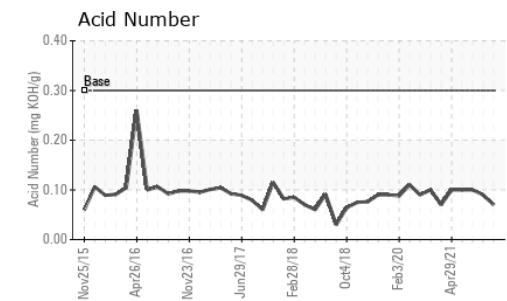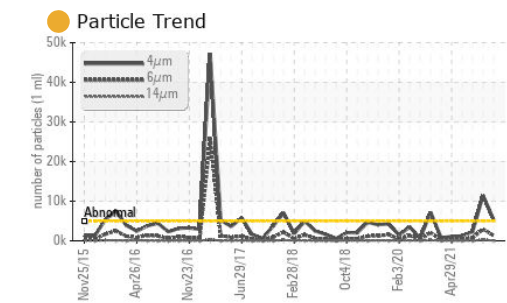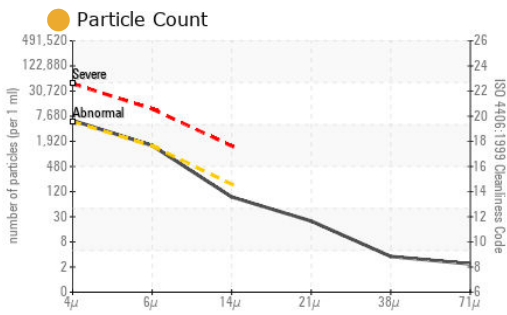

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0873650 **Received** : 02 May 2024
Lab Number : 02632756 **Tested** : 03 May 2024
Unique Number : 5773909 **Diagnosed** : 03 May 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Petro Canada Lubricants Inc.
 385 Southdown Road
 Mississauga, ON
 CA L5J 2Y3
 Contact: Kyle Blezard
 kyle.blezard@HFSinclair.com
 T: (905)403-6768
 F: (905)822-6025