



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
398 EGLINTON AVE E
 Component
Diesel Engine
 Fluid
PETRO CANADA XR 4 SAE 15W40 (--- LTR)

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0915449	WC0647850	WC0515842
Sample Date		Client Info		19 Apr 2024	03 Mar 2022	01 Mar 2021
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	7	4	6
Chromium	ppm	ASTM D5185(m)	>20	0	0	<1
Nickel	ppm	ASTM D5185(m)	>4	0	0	0
Titanium	ppm	ASTM D5185(m)		0	<1	0
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	<1	1
Lead	ppm	ASTM D5185(m)	>40	1	1	2
Copper	ppm	ASTM D5185(m)	>330	4	2	3
Tin	ppm	ASTM D5185(m)	>15	4	2	2
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION












Light fuel dilution occurring. No other contaminants were detected in the oil.

Silicon	ppm	ASTM D5185(m)	>25	23	19	▲ 29
Potassium	ppm	ASTM D5185(m)	>20	<1	0	<1
Fuel	%	ASTM D7593*	>5	1.7	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	5.0	5.0	4.7
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.9	19.4	19.2
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	VLITE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		1	1	2
Boron	ppm	ASTM D5185(m)	1	5	4	22
Barium	ppm	ASTM D5185(m)	1	0	0	0
Molybdenum	ppm	ASTM D5185(m)	1	60	58	60
Manganese	ppm	ASTM D5185(m)		<1	<1	<1
Magnesium	ppm	ASTM D5185(m)	10	986	959	959
Calcium	ppm	ASTM D5185(m)	3032	1053	1075	1085
Phosphorus	ppm	ASTM D5185(m)	1054	1009	1039	1013
Zinc	ppm	ASTM D5185(m)	1332	1168	1217	1252
Sulfur	ppm	ASTM D5185(m)	3985	2619	2916	2986
Oxidation	Abs/.1mm	ASTM D7414*	>25	14.1	14.4	14.0
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	12.1	12.7	12.8

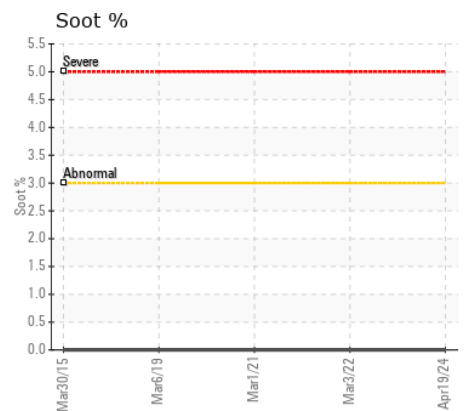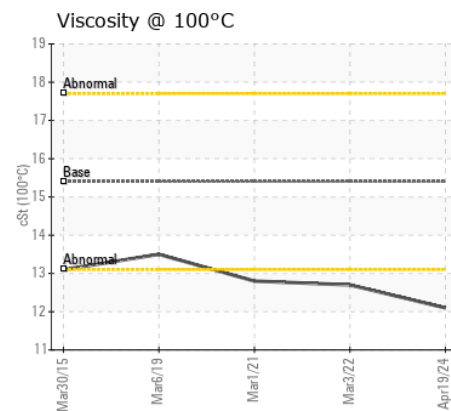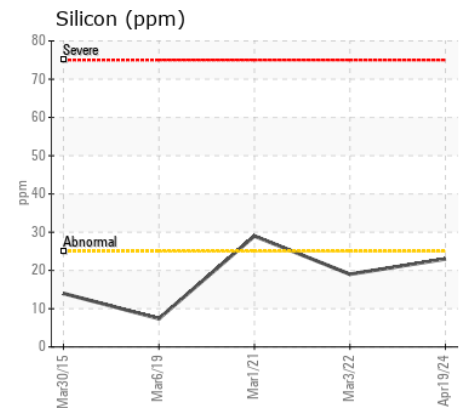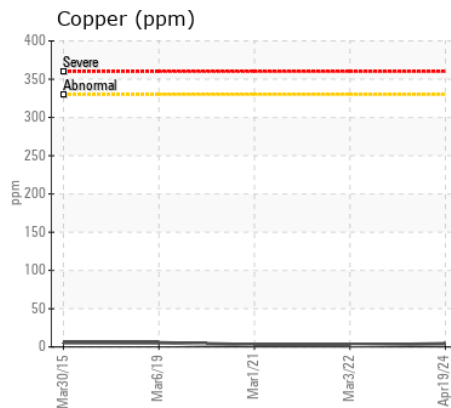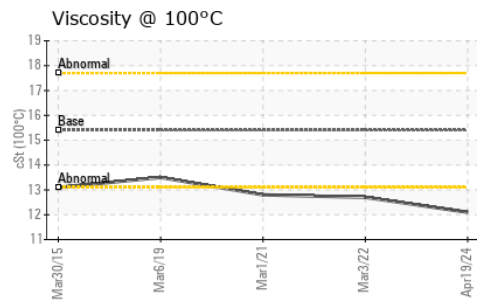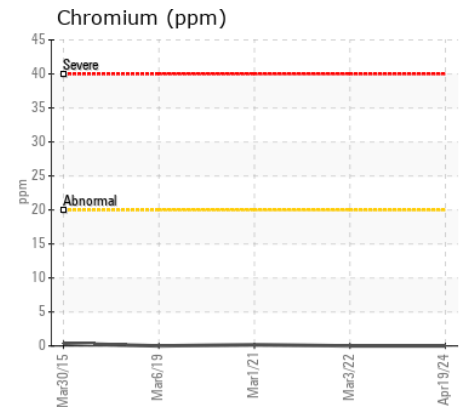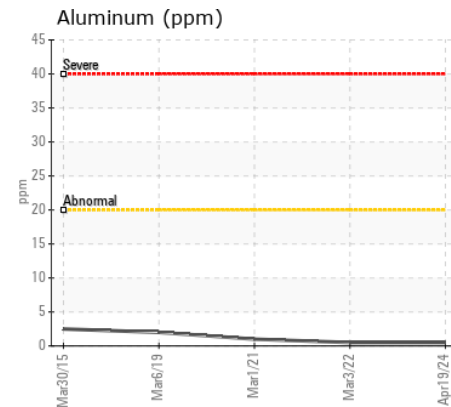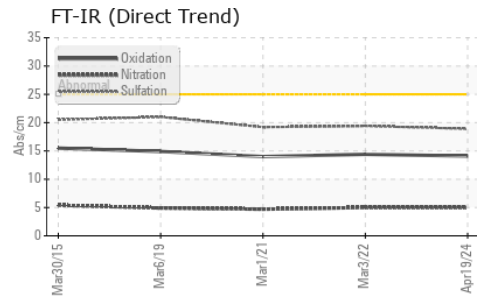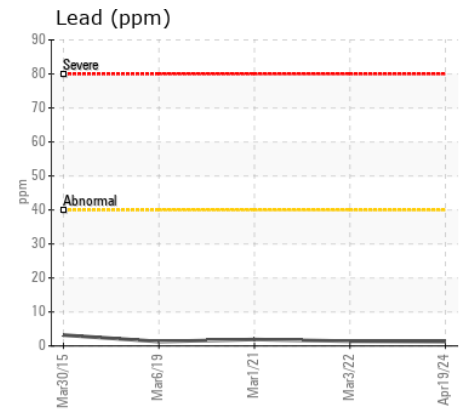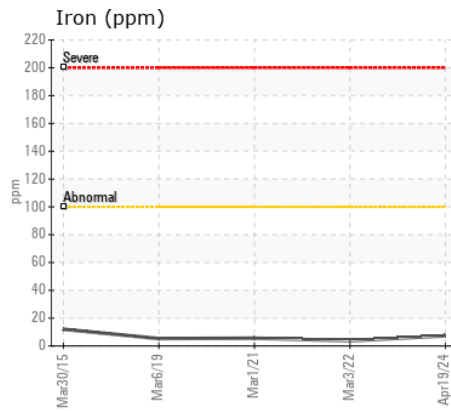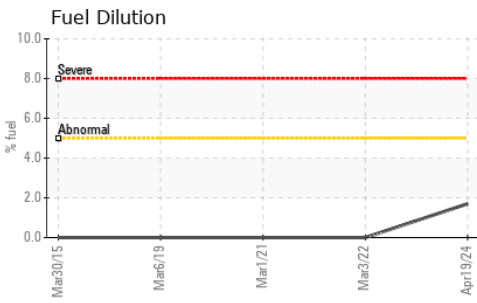

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0915449 **Received** : 03 May 2024
Lab Number : 02633024 **Tested** : 06 May 2024
Unique Number : 5774177 **Diagnosed** : 06 May 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: FuelDilution, PercentFuel, Visual)

NORTHERN GENERATOR CO. LTD.
 80 ASHBRIDGE CIRCLE., UNIT #1 & 2
 WOODBRIDGE, ON
 CA L4L 3R5
 Contact: Selome Afework
 selome@northerngenerator.com
 T: (905)264-9744
 F: (905)264-9714

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.