# B POWER GENERATION PRODUCTS

OIL ANALYSIS REPORT

#### Area [85485] Machine Id

# **1025 ELLESMERE RD SCARBOROUGH TTC SUBWAY TTC SUBWAY**

### **Rear Diesel Engine**

## ESSO XD-3 EXTRA 15W40 (20 LTR)


ESSU XD-3 EXTRA 15W40 (20 LTR)							
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		PN0006106		
	Sample Date		Client Info		25 Apr 2024		
	Machine Age	hrs	Client Info		437		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		Changed		
	Filter Changed		Client Info		Not Changd		
	Sample Status				NORMAL		
WEAR	Iron	ppm	ASTM D5185(m)	>80	2		
Metal levels are typical for a new component breaking in.	Chromium	ppm	ASTM D5185(m)	>6	0		
	Nickel	ppm	ASTM D5185(m)	>2	0		
	Titanium	ppm	ASTM D5185(m)	>2	0		
	Silver	ppm	ASTM D5185(m)	>2	0		
	Aluminum	ppm	ASTM D5185(m)	>20	<1		
	Lead	ppm	ASTM D5185(m)	>95	<1		
	Copper	ppm	ASTM D5185(m)	>85	<1		
	Tin	ppm	ASTM D5185(m)	>9	0		
	Vanadium	ppm	ASTM D5185(m)		0		
CONTAMINATION	Silicon	ppm	ASTM D5185(m)	>25	<1		
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185(m)	>20	11		
	Fuel		WC Method	>4.0	<1.0		
	Water		WC Method	>0.1	NEG		
	Glycol	%	ASTM D7922*		0.0		
	Soot %	%	ASTM D7844*		0		
	Nitration	Abs/cm	ASTM D7624*	>20	5.8		
	Sulfation	Abs/.1mm	ASTM D7415*	>30	15.4		
	Emulsified Water	scalar	Visual*	>0.1	NEG		
FLUID CONDITION	Sodium	ppm	ASTM D5185(m)	>192	2		
The condition of the oil is acceptable for the time in service.	Boron	ppm	ASTM D5185(m)		2		
	Barium	ppm	ASTM D5185(m)		0		
	Molybdenum	ppm	ASTM D5185(m)		0		
	Manganese	ppm	ASTM D5185(m)		0		
	Magnesium	ppm	ASTM D5185(m)		8		
	Calcium	ppm	ASTM D5185(m)		2207		
	Phosphorus	ppm	ASTM D5185(m)		843		
	Zinc	ppm	ASTM D5185(m)		927		
	Sulfur	ppm	ASTM D5185(m)		2897		
	Oxidation	Abs/.1mm	ASTM D7414*	>25	9.4		

Visc @ 100°C cSt

ASTM D7279(m) 15.4

Contact/Location: Brett Kinkley - POWMIS

13.3

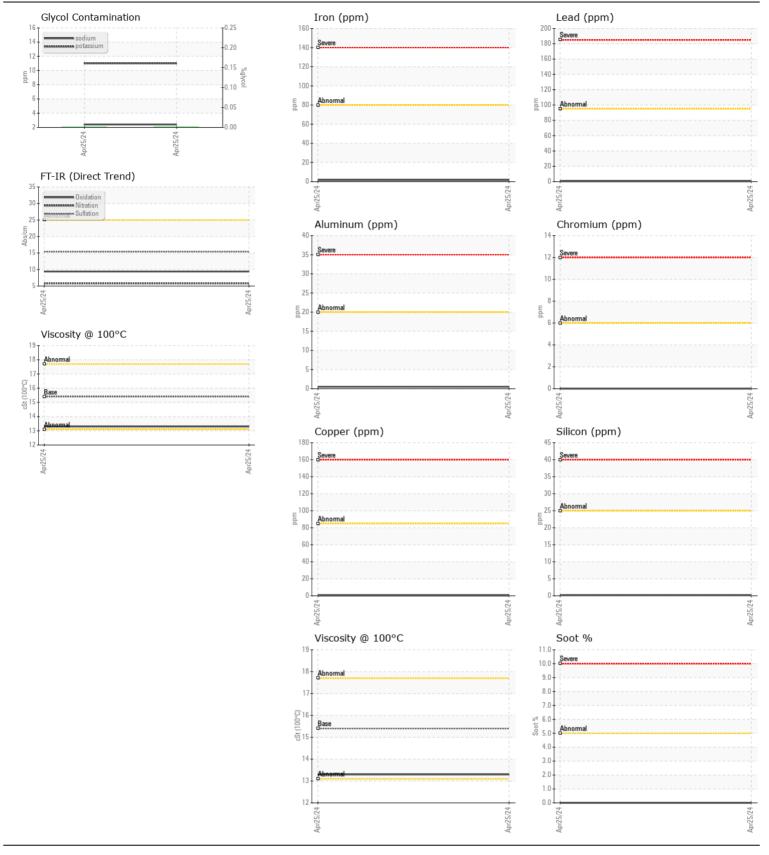

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 CALA Sample No. : PN0006106 Received :06 May 2024 Lab Number : 02633444 Tested :06 May 2024 ISO 17025:2017 Accredited : 06 May 2024 - Wes Davis Unique Number : 5774597 Diagnosed Laboratory Test Package : MOB 1 (Additional Tests: Glycol) To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

POWER STATION INC. 1050 JAYSON COURT MISSISSAUGA, ON CA L4W 2V5 Contact: Brett Kinkley Bkinkley@pwrstn.com T: F: (905)565-8544

Contact/Location: Brett Kinkley - POWMIS Page 2 of 2