



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
TORONTO EATON CENTRE [263440]

Machine Id
358782

Component
Diesel Engine

Fluid
SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WA0021148	---	---
Sample Date		Client Info		23 Mar 2024	---	---
Machine Age	hrs	Client Info		5162	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	2	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<1	---	---
Lead	ppm	ASTM D5185(m)	>40	0	---	---
Copper	ppm	ASTM D5185(m)	>330	<1	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	2	---	---
Potassium	ppm	ASTM D5185(m)	>20	<1	---	---
Fuel		WC Method	>5	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	5.2	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	15.6	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>57	1	---	---
Boron	ppm	ASTM D5185(m)		4	---	---
Barium	ppm	ASTM D5185(m)		0	---	---
Molybdenum	ppm	ASTM D5185(m)		2	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)		41	---	---
Calcium	ppm	ASTM D5185(m)		2236	---	---
Phosphorus	ppm	ASTM D5185(m)		870	---	---
Zinc	ppm	ASTM D5185(m)		986	---	---
Sulfur	ppm	ASTM D5185(m)		2939	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	8.6	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.5	14.6	---	---

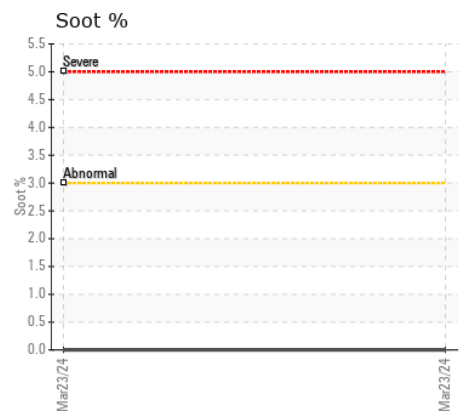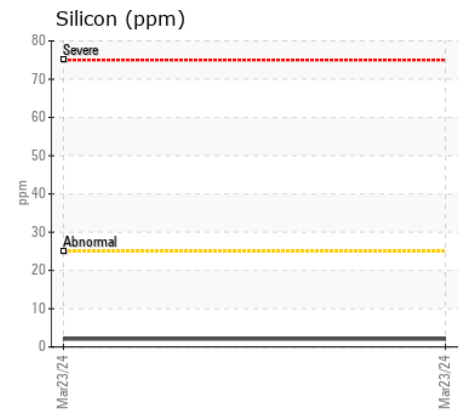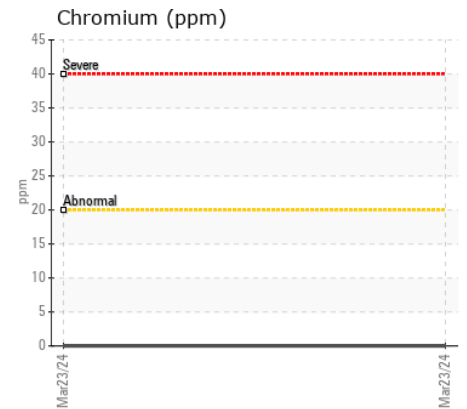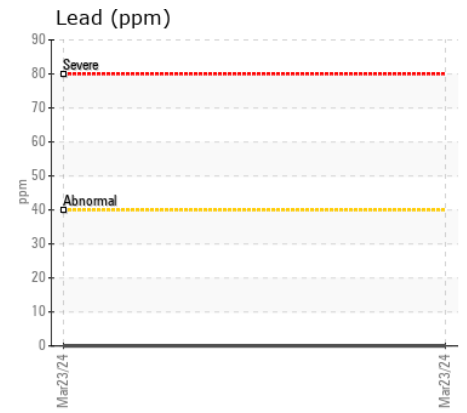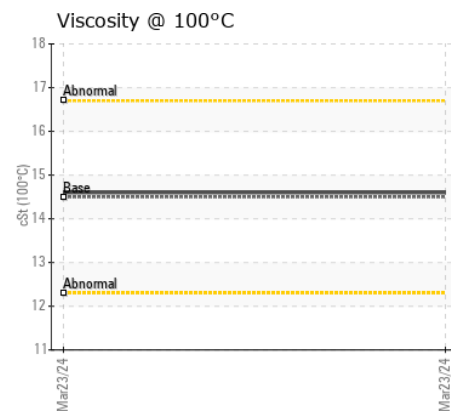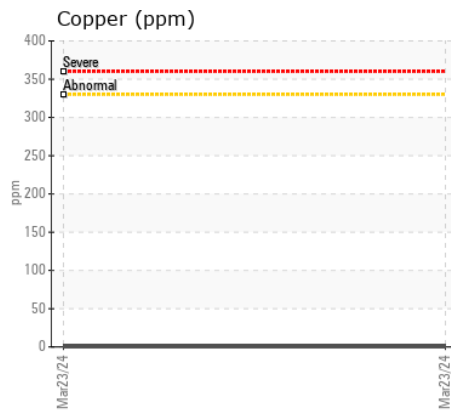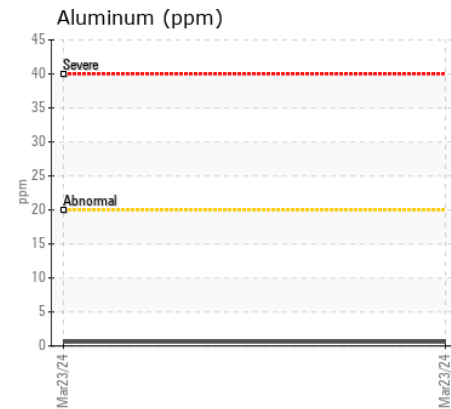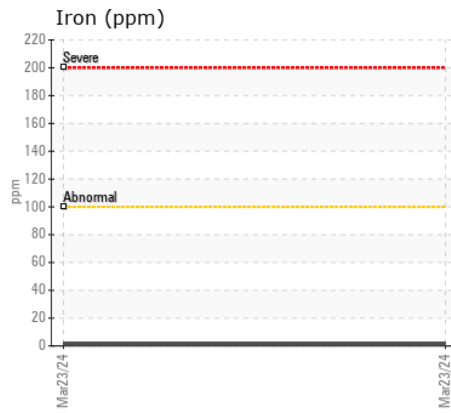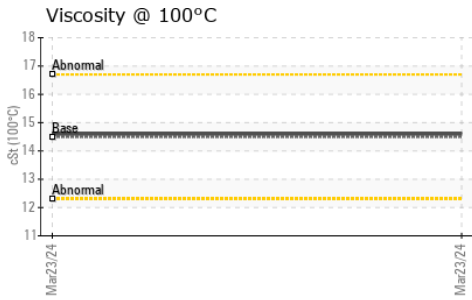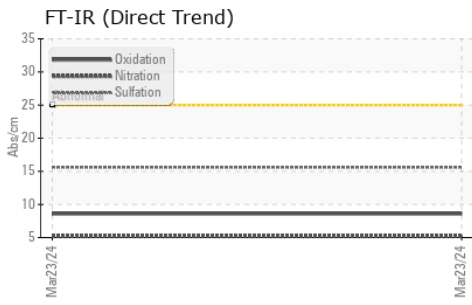

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0021148 **Received** : 06 May 2024
Lab Number : 02633718 **Tested** : 06 May 2024
Unique Number : 5774871 **Diagnosed** : 06 May 2024 - Wes Davis
Test Package : MOB 1

Wajax Power Systems
 10 Diesel Drive
 Toronto, ON
 CA M8W 2T8
 Contact: David Gilkes
 dgilkes@wajax.com
 T: (416)259-3281
 F: (416)251-6191

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.