



**POWER SYSTEMS**  
**SYSTÈMES DE PUISSANCE**

OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area

**BENNET HEALTH CARE [285647]**

Machine Id

**MTU 159523-0408 THE BENNETT VILLAGE**

Component

**Diesel Engine**

Fluid

**CASTROL 15W40 (40 LTR)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WA0021442</b>	WA0019752	WA0018115
Sample Date		Client Info		<b>01 May 2024</b>	12 May 2023	27 May 2022
Machine Age	hrs	Client Info		<b>218</b>	214	192
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>Changed</b>	Changed	Changed
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	<b>1</b>	2	2
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>4	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185(m)	>40	<b>0</b>	<1	0
Copper	ppm	ASTM D5185(m)	>330	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0

**CONTAMINATION**











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	<b>3</b>	4	5
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	<1	2
Fuel		WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	ASTM D7844*	>3	<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>4.2</b>	4.8	5.5
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>17.6</b>	17.2	18.2
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>406	<b>1</b>	1	2
Boron	ppm	ASTM D5185(m)		<b>5</b>	6	6
Barium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)		<b>55</b>	40	10
Manganese	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185(m)		<b>913</b>	648	153
Calcium	ppm	ASTM D5185(m)		<b>1059</b>	1540	2088
Phosphorus	ppm	ASTM D5185(m)		<b>980</b>	1079	974
Zinc	ppm	ASTM D5185(m)		<b>1126</b>	1141	1079
Sulfur	ppm	ASTM D5185(m)		<b>2514</b>	2891	3055
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>12.2</b>	11.4	9.8
Visc @ 100°C	cSt	ASTM D7279(m)		<b>15.1</b>	14.4	14.3

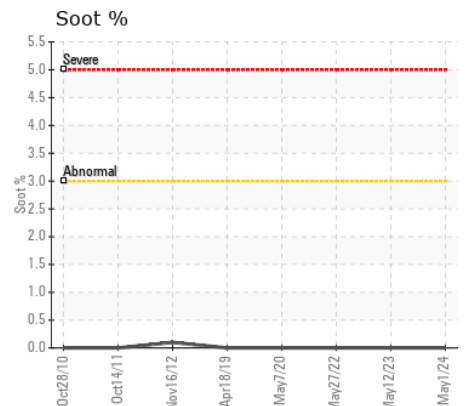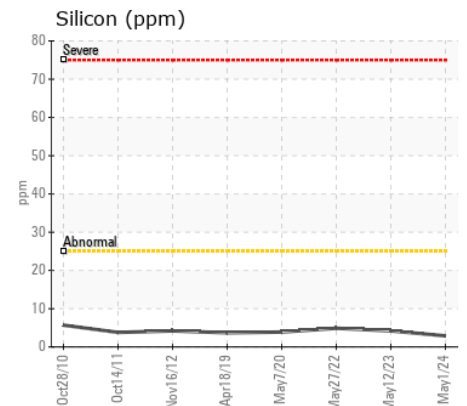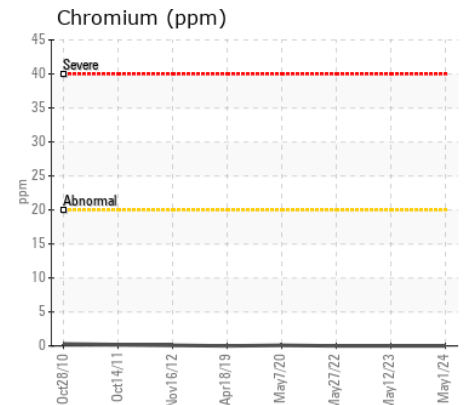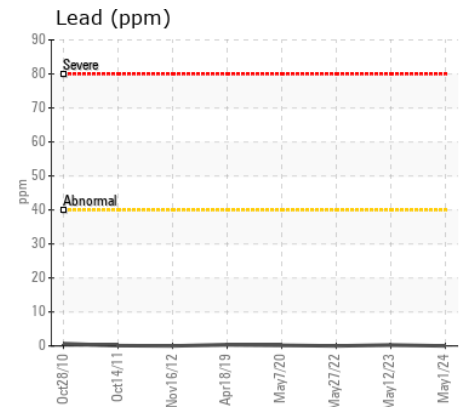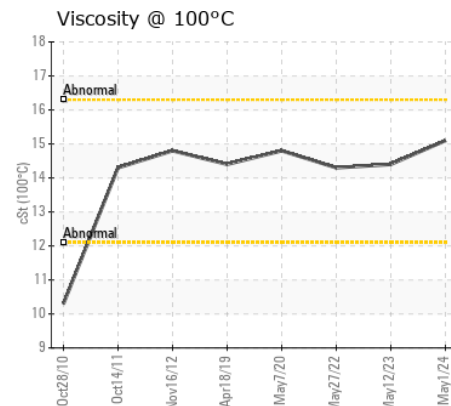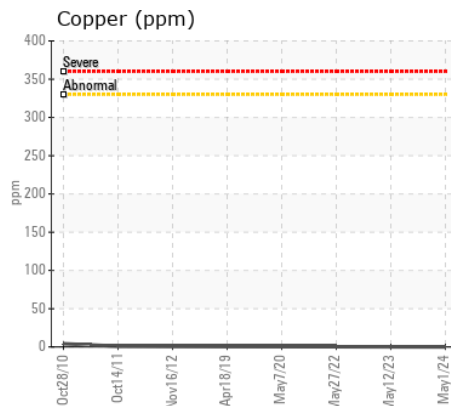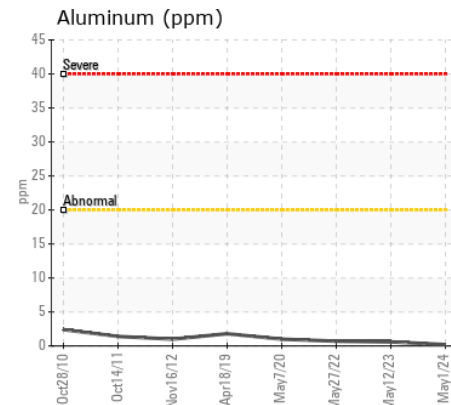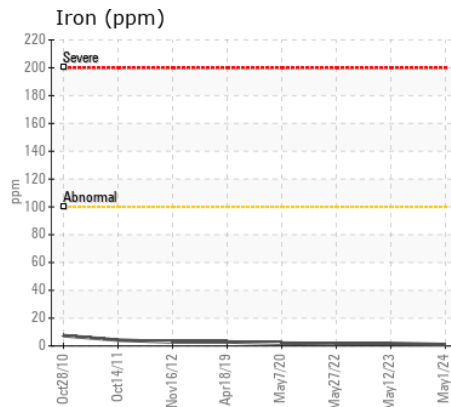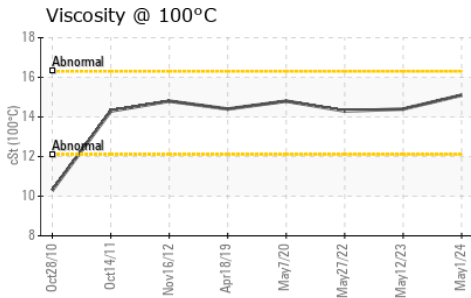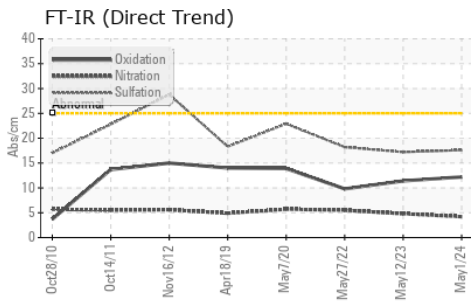

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WA0021442 **Received** : 06 May 2024  
**Lab Number** : 02633720 **Tested** : 06 May 2024  
**Unique Number** : 5774873 **Diagnosed** : 06 May 2024 - Wes Davis  
**Test Package** : MOB 1

**Wajax Power Systems**  
 10 Diesel Drive  
 Toronto, ON  
 CA M8W 2T8  
 Contact: David Gilkes  
 dgilkes@wajax.com  
 T: (416)259-3281  
 F: (416)251-6191

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.