
WEAR CONTAMINATION FLUID CONDITION **NORMAL NORMAL NORMAL**

Machine Id

37 CAMPBELL AVE CAMPBELLVILLE, 64-R05266 BELL CANADA 64-R05266

Left Diesel Engine

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		PN0006164	PN0003714	PN000228
	Sample Date		Client Info		30 Apr 2024	20 Jun 2022	26 Feb 202
	Machine Age	hrs	Client Info		413	367	337
	Oil Age	hrs	Client Info		45	0	4
	Filter Age	hrs	Client Info		45	0	4
	Oil Changed		Client Info		Changed	Changed	Changed
	Filter Changed		Client Info		Changed	Changed	Changed
	Sample Status				NORMAL	NORMAL	NORMAI
WEAR	Iron	ppm	ASTM D5185(m)	>250	3	2	2
Metal levels are typical for a new component breaking in.	Chromium	ppm	ASTM D5185(m)	>10	0	0	0
	Nickel	ppm	ASTM D5185(m)	>5	<1	0	<1
	Titanium	ppm	ASTM D5185(m)		0	<1	0
	Silver	ppm	ASTM D5185(m)	>3	0	0	0
	Aluminum	ppm	ASTM D5185(m)	>35	2	3	2
	Lead	ppm	ASTM D5185(m)	>100	0	0	<1
	Copper	ppm	ASTM D5185(m)	>60	<1	<1	<1
	Tin	ppm	ASTM D5185(m)	>5	0	0	0
	Vanadium	ppm	ASTM D5185(m)		0	0	0
CONTAMINATION	Silicon	ppm	ASTM D5185(m)	>35	2	5	8
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
	Fuel		WC Method	>5	<1.0	<1.0	<1.0
	Water		WC Method	>0.2	NEG	NEG	NEG
	Glycol		WC Method		NEG	NEG	NEG
	Soot %	%	ASTM D7844*	>3	0	0	0
	Nitration	Abs/cm	ASTM D7624*	>20	7.0	7.8	6.6
	Sulfation	Abs/.1mm	ASTM D7415*		17.5	19.4	18.2
	Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG
FLUID CONDITION	Sodium	ppm	ASTM D5185(m)	>192	2	4	4
The condition of the oil is acceptable for the time in service.	Boron	ppm	ASTM D5185(m)		54	72	67
	Barium	ppm	ASTM D5185(m)		<1	0	0
	Molybdenum	ppm	ASTM D5185(m)		38	84	72
	Manganese	ppm	ASTM D5185(m)		0	<1	<1
	Magnesium	ppm	ASTM D5185(m)		237	56	129
	Calcium	ppm	ASTM D5185(m)	3780	1997	2228	1976
	Phosphorus	ppm	ASTM D5185(m)	1370	980	983	923
	Zinc	ppm	ASTM D5185(m)	1500	1141	1122	1098
	Sulfur	ppm	ASTM D5185(m)	3800	2976	3251	3131
	Oxidation	Abs/.1mm	ASTM D7414*	>25	13.0	13.7	13.8
	Visc @ 100°C	cSt	ASTM D7279(m)	15.4	13.8	14.2	14.1

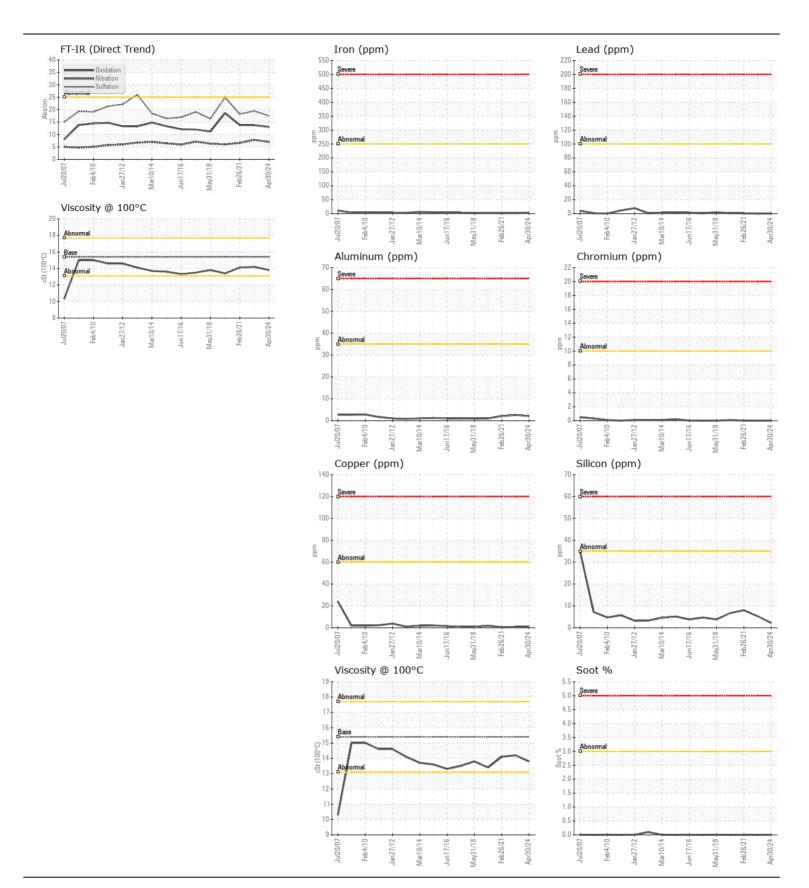



CALA ISO 17025:2017 Accredited

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Sample No. : PN0006164 Received Lab Number : 02633783 **Tested**

Unique Number : 5774936 Laboratory Test Package : MOB 1

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

: 07 May 2024

: 07 May 2024

Diagnosed

: 07 May 2024 - Kevin Marson

POWER STATION INC.

1050 JAYSON COURT MISSISSAUGA, ON CA L4W 2V5 Contact: Ryan Udall rudall@pwrstn.com T: (905)565-1621

F: (905)629-1499