



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[6100276637]

Machine Id

IVECO 019012

Component

Diesel Engine

Fluid

PETRO CANADA DURON SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WA0021305	WA0019241	WA0018453
Sample Date		Client Info		01 May 2024	18 Apr 2023	13 Sep 2022
Machine Age	hrs	Client Info		1265	1263	1263
Oil Age	hrs	Client Info		0	40	20
Filter Age	hrs	Client Info		0	40	20
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	1	1	2
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>4	0	0	<1
Titanium	ppm	ASTM D5185(m)		0	<1	<1
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>40	0	0	<1
Copper	ppm	ASTM D5185(m)	>330	<1	<1	1
Tin	ppm	ASTM D5185(m)	>15	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	VLITE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	7	4	2
Potassium	ppm	ASTM D5185(m)	>20	1	2	6
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	0.0
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	4.6	4.9	2.4
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.9	18.6	9.9
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	VLITE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		1	2	3
Boron	ppm	ASTM D5185(m)	1	25	57	182
Barium	ppm	ASTM D5185(m)	1	0	0	0
Molybdenum	ppm	ASTM D5185(m)	60	50	40	0
Manganese	ppm	ASTM D5185(m)	1	0	0	0
Magnesium	ppm	ASTM D5185(m)	1010	841	648	11
Calcium	ppm	ASTM D5185(m)	1070	1158	1430	2134
Phosphorus	ppm	ASTM D5185(m)	1150	963	1049	1020
Zinc	ppm	ASTM D5185(m)	1270	1124	1126	1088
Sulfur	ppm	ASTM D5185(m)	2060	2554	2785	3018
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.8	14.9	5.3
Visc @ 100°C	cSt	ASTM D7279(m)	15.6	14.5	14.8	13.9

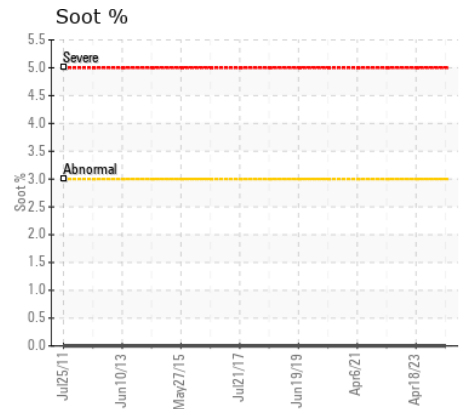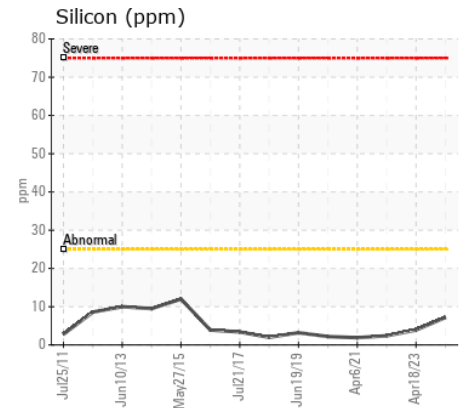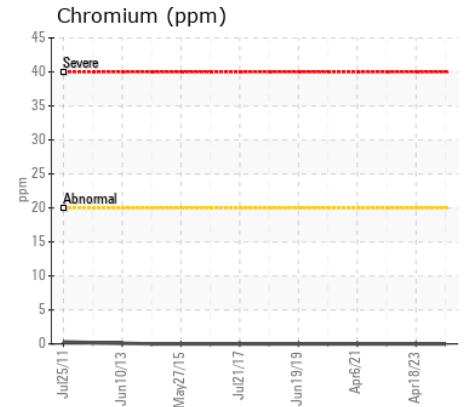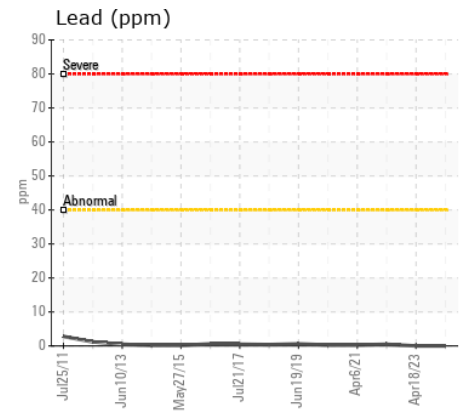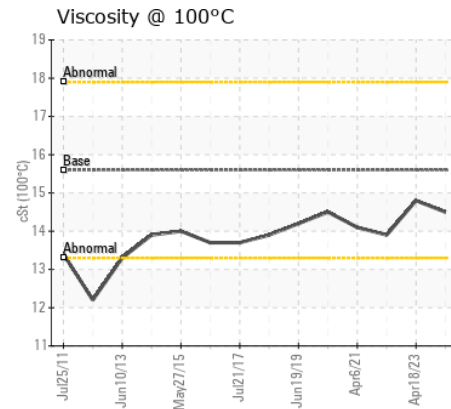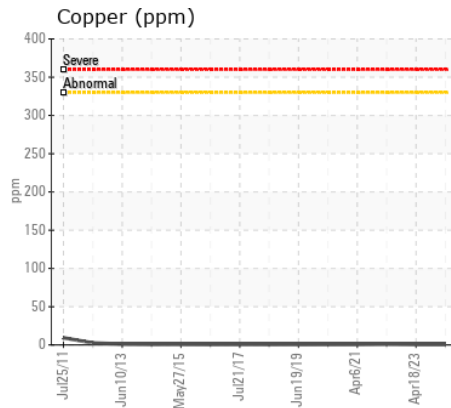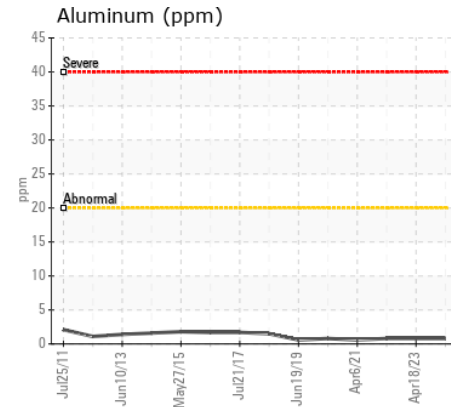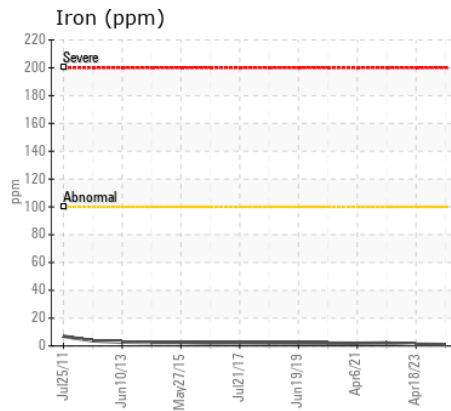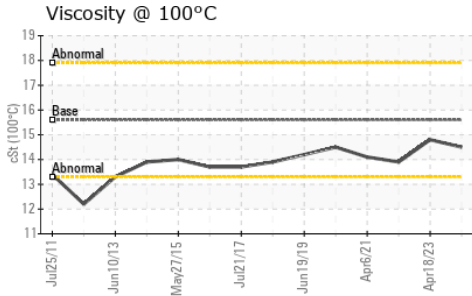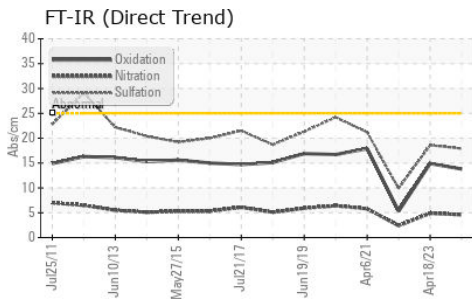

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0021305 **Received** : 07 May 2024
Lab Number : 02633842 **Tested** : 07 May 2024
Unique Number : 5774995 **Diagnosed** : 07 May 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: Visual)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Wajax Power Systems
 70 Raddall Avenue
 Dartmouth, NS
 CA B3B 1T7
 Contact: Danelle Hoffman
 dhoffman@wajax.com
 T: (902)468-6200
 F: (902)468-3325