



Machine Id
730000
Component
Natural Gas Engine
Fluid
PETRO CANADA DURON GEO LD 15W40 (--- LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		GFL0112491	GFL0077981	GFL0057741
Sample Date		Client Info		29 Apr 2024	21 Apr 2023	07 Sep 2022
Machine Age	hrs	Client Info		9087	7678	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	N/A	Changed
Filter Changed		Client Info		Changed	N/A	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>50	18	18	21
Chromium	ppm	ASTM D5185(m)	>4	<1	2	2
Nickel	ppm	ASTM D5185(m)	>2	<1	<1	<1
Titanium	ppm	ASTM D5185(m)		0	<1	<1
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>9	2	2	2
Lead	ppm	ASTM D5185(m)	>30	2	3	10
Copper	ppm	ASTM D5185(m)	>35	2	1	2
Tin	ppm	ASTM D5185(m)	>4	1	<1	1
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>+100	12	5	5
Potassium	ppm	ASTM D5185(m)	>20	3	0	<1
Water		WC Method	>0.1	NEG	NEG	NEG
Soot %	%	ASTM D7844*		0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	11.0	12.6	13.0
Sulfation	Abs/.1mm	ASTM D7415*	>30	21.7	25.7	28.5
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		18	9	10
Boron	ppm	ASTM D5185(m)	50	8	10	9
Barium	ppm	ASTM D5185(m)	5	2	0	0
Molybdenum	ppm	ASTM D5185(m)	50	52	60	59
Manganese	ppm	ASTM D5185(m)	0	1	1	1
Magnesium	ppm	ASTM D5185(m)	560	504	633	672
Calcium	ppm	ASTM D5185(m)	1510	1591	1917	1780
Phosphorus	ppm	ASTM D5185(m)	780	634	819	904
Zinc	ppm	ASTM D5185(m)	870	875	1017	1055
Sulfur	ppm	ASTM D5185(m)	2040	1983	2181	2152
Oxidation	Abs/.1mm	ASTM D7414*	>25	17.7	20.6	23.6
Visc @ 100°C	cSt	ASTM D7279(m)	15.1	14.8	15.1	14.6

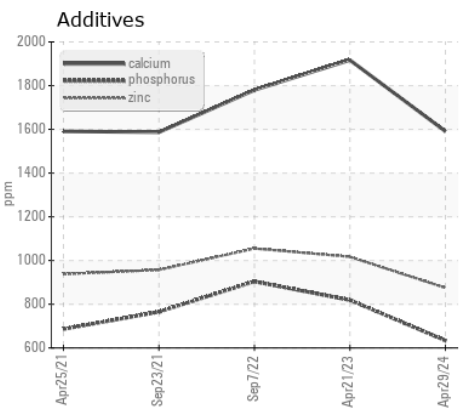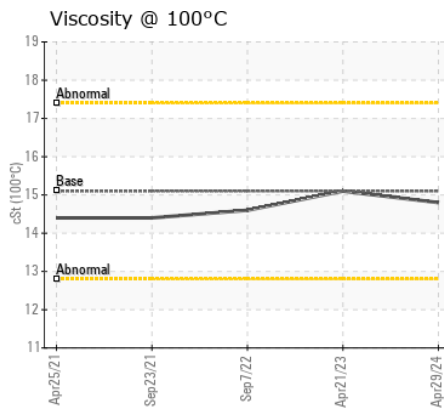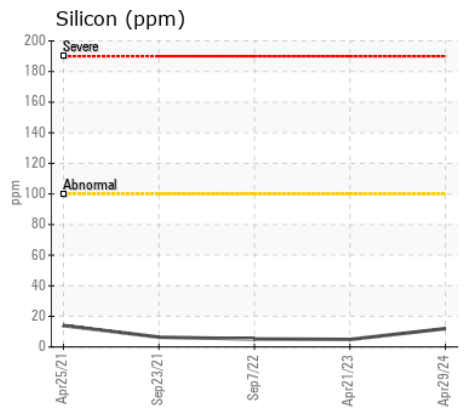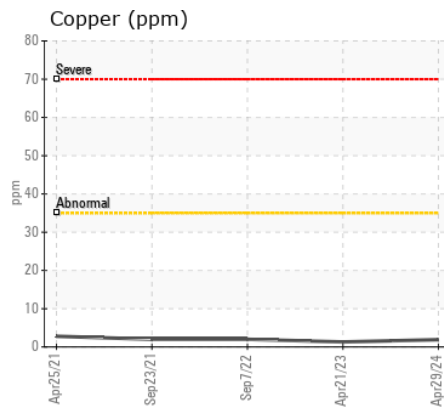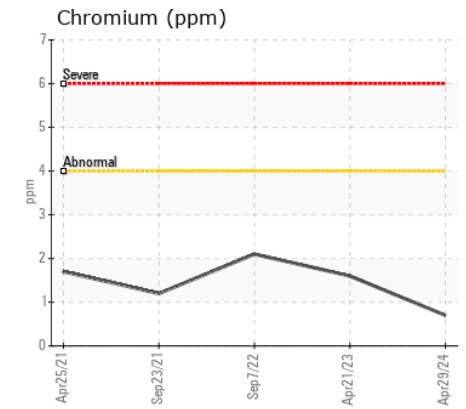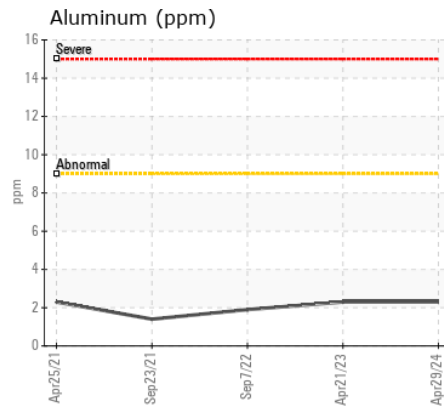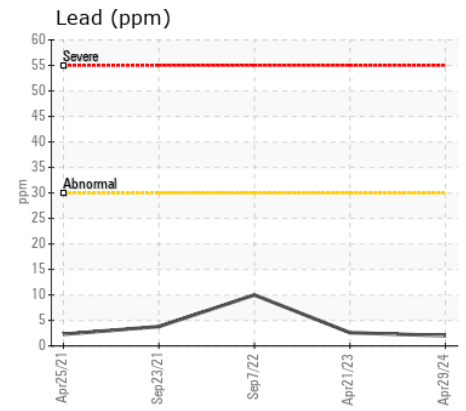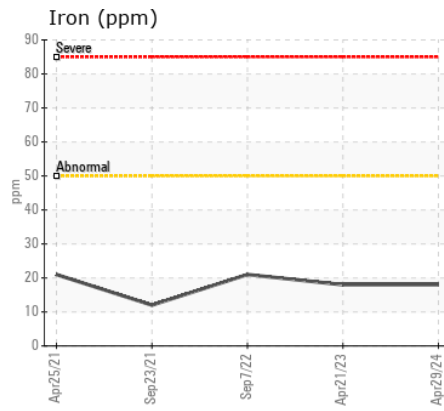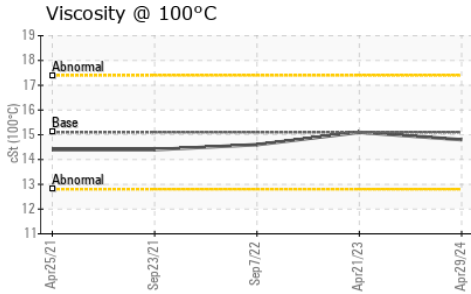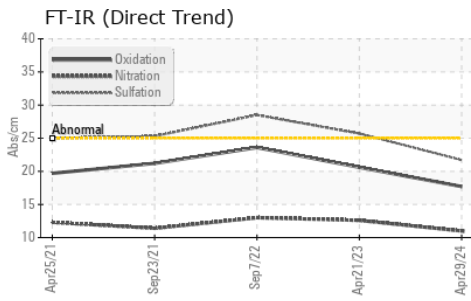

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : GFL0112491
Lab Number : 02634079
Unique Number : 5775232
Test Package : MOB 1

GFL Environmental - 554 - Edmonton SW
 8409 -15th Street NW
 Edmonton, AB
 CA T6P 0B8
 Contact: Tim Greig
 tgreig@gflenv.com
 T: (780)231-0521
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.