



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
[86172]

Machine Id
351 CALDARI RD. CONCORD, PACTIV VIKING FIRE PROTECTION U944141

Component
Rear Diesel Engine

Fluid
ESSO XD-3 EXTRA 15W40 (12 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0006179	PN0004777	PN908252
Sample Date		Client Info		06 May 2024	18 May 2023	19 Dec 2013
Machine Age	hrs	Client Info		430	421	196
Oil Age	hrs	Client Info		421	0	24
Filter Age	hrs	Client Info		421	0	24
Oil Changed		Client Info		Not Changed	Changed	Changed
Filter Changed		Client Info		Not Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>250	2	6	3
Chromium	ppm	ASTM D5185(m)	>10	0	0	<1
Nickel	ppm	ASTM D5185(m)	>5	0	<1	<1
Titanium	ppm	ASTM D5185(m)		0	<1	0
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>35	<1	1	1
Lead	ppm	ASTM D5185(m)	>100	0	<1	<1
Copper	ppm	ASTM D5185(m)	>60	<1	3	2
Tin	ppm	ASTM D5185(m)	>5	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>35	2	7	4
Potassium	ppm	ASTM D5185(m)	>20	<1	6	1
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	4.9	7.1	6.6
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.6	20.9	20.0
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	1	2	6
Boron	ppm	ASTM D5185(m)		23	160	8
Barium	ppm	ASTM D5185(m)		0	0	<1
Molybdenum	ppm	ASTM D5185(m)		52	5	38
Manganese	ppm	ASTM D5185(m)		0	<1	<1
Magnesium	ppm	ASTM D5185(m)		849	98	781
Calcium	ppm	ASTM D5185(m)	3780	1212	2259	1375
Phosphorus	ppm	ASTM D5185(m)	1370	1023	1055	1055
Zinc	ppm	ASTM D5185(m)	1500	1208	1168	1316
Sulfur	ppm	ASTM D5185(m)	3800	2707	3038	3572
Oxidation	Abs/.1mm	ASTM D7414*	>25	14.1	17.4	13.6
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	14.8	14.2	13.4

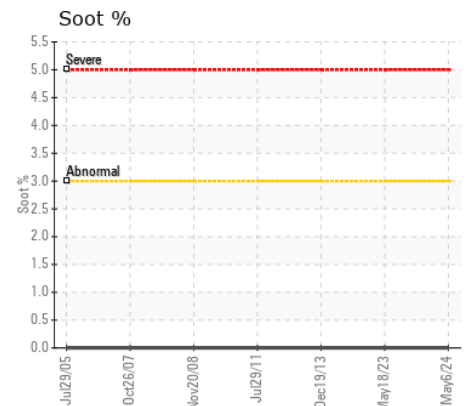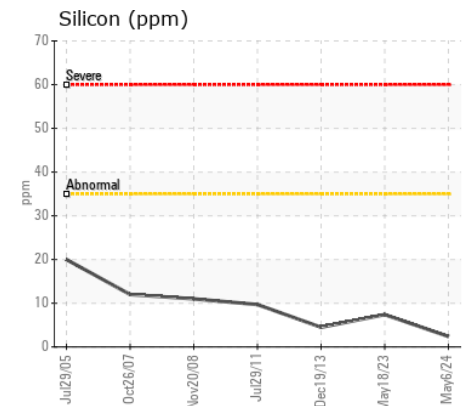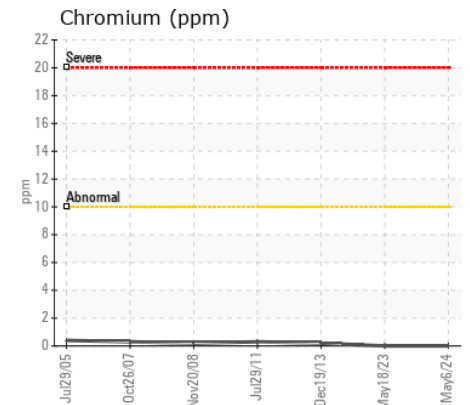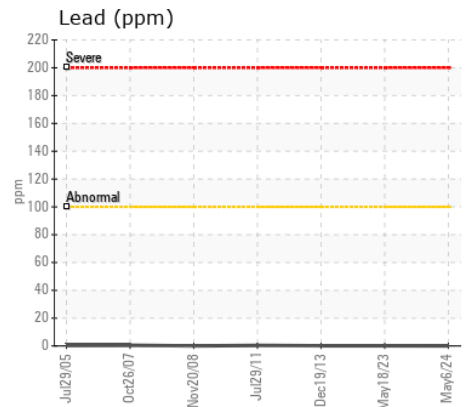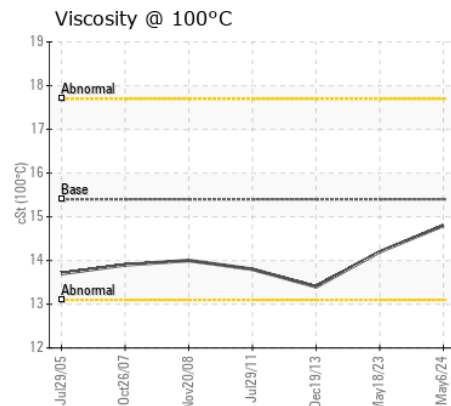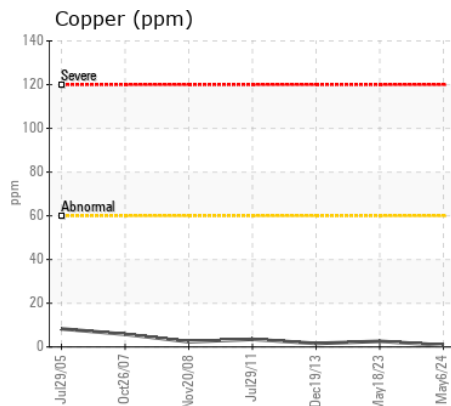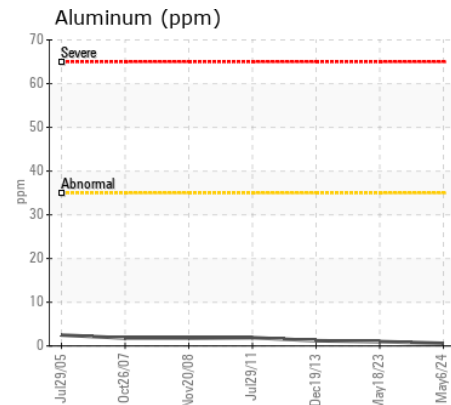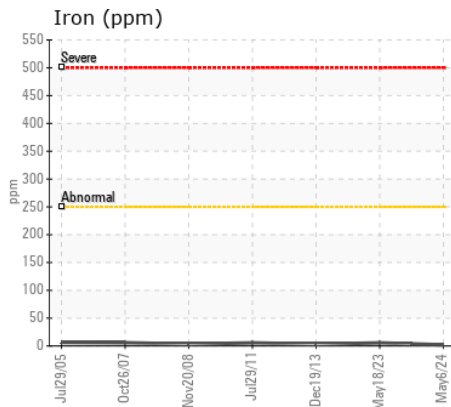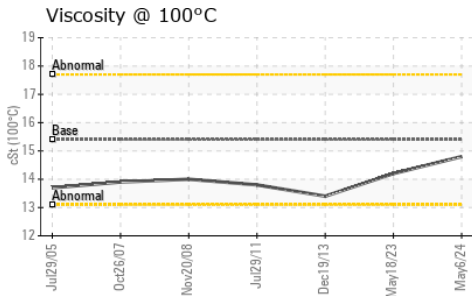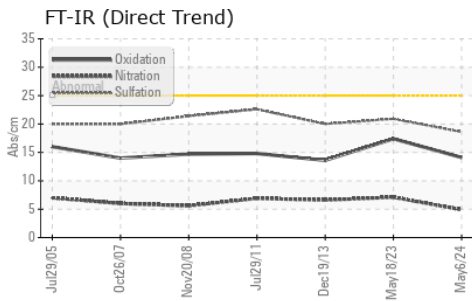

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0006179
Lab Number : 02634889
Unique Number : 5776042
Test Package : MOB 1

Received : 13 May 2024
Tested : 13 May 2024
Diagnosed : 13 May 2024 - Wes Davis

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Ryan Udall
 rudall@pwrstn.com
 T: (905)565-1621
 F: (905)629-1499

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.