



**POWER SYSTEMS**  
**SYSTÈMES DE PUISSANCE**

OIL ANALYSIS REPORT

|                 |               |
|-----------------|---------------|
| WEAR            | <b>NORMAL</b> |
| CONTAMINATION   | <b>NORMAL</b> |
| FLUID CONDITION | <b>NORMAL</b> |

Area

**AGROPUR COOPERATIVE [6100276537]**

Machine Id

**RG6081H189684**

Component

**Diesel Engine**

Fluid

**PETRO CANADA DURON SAE 15W40 (--- GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

| Test           | UOM | Method      | Limit/Abn | Current            | History1    | History2    |
|----------------|-----|-------------|-----------|--------------------|-------------|-------------|
| Sample Number  |     | Client Info |           | <b>WA0021289</b>   | WA0017268   | WA0015932   |
| Sample Date    |     | Client Info |           | <b>09 May 2024</b> | 06 Jan 2022 | 29 Dec 2020 |
| Machine Age    | hrs | Client Info |           | <b>593</b>         | 431         | 388         |
| Oil Age        | hrs | Client Info |           | <b>0</b>           | 0           | 0           |
| Filter Age     | hrs | Client Info |           | <b>0</b>           | 0           | 0           |
| Oil Changed    |     | Client Info |           | <b>Changed</b>     | Changed     | Changed     |
| Filter Changed |     | Client Info |           | <b>Changed</b>     | Changed     | Changed     |
| Sample Status  |     |             |           | <b>NORMAL</b>      | NORMAL      | NORMAL      |

**WEAR**

Metal levels are typical for a new component breaking in.

|          |     |               |     |              |    |    |
|----------|-----|---------------|-----|--------------|----|----|
| Iron     | ppm | ASTM D5185(m) | >51 | <b>15</b>    | 5  | 4  |
| Chromium | ppm | ASTM D5185(m) | >11 | <b>0</b>     | 0  | 0  |
| Nickel   | ppm | ASTM D5185(m) | >5  | <b>0</b>     | <1 | <1 |
| Titanium | ppm | ASTM D5185(m) |     | <b>0</b>     | 0  | 0  |
| Silver   | ppm | ASTM D5185(m) | >3  | <b>0</b>     | <1 | <1 |
| Aluminum | ppm | ASTM D5185(m) | >31 | <b>&lt;1</b> | 1  | <1 |
| Lead     | ppm | ASTM D5185(m) | >26 | <b>0</b>     | 0  | <1 |
| Copper   | ppm | ASTM D5185(m) | >26 | <b>1</b>     | <1 | <1 |
| Tin      | ppm | ASTM D5185(m) | >4  | <b>0</b>     | <1 | <1 |
| Vanadium | ppm | ASTM D5185(m) |     | <b>0</b>     | 0  | 0  |

**CONTAMINATION**











There is no indication of any contamination in the oil.

|                  |          |               |       |                |      |      |
|------------------|----------|---------------|-------|----------------|------|------|
| Silicon          | ppm      | ASTM D5185(m) | >22   | <b>2</b>       | 2    | 3    |
| Potassium        | ppm      | ASTM D5185(m) | >20   | <b>2</b>       | 7    | 7    |
| Fuel             |          | WC Method     | >2.1  | <b>&lt;1.0</b> | <1.0 | <1.0 |
| Water            |          | WC Method     | >0.21 | <b>NEG</b>     | NEG  | NEG  |
| Glycol           |          | WC Method     |       | <b>NEG</b>     | 0.0  | 0.0  |
| Soot %           | %        | ASTM D7844*   | >3    | <b>0.4</b>     | 0    | 0    |
| Nitration        | Abs/cm   | ASTM D7624*   | >20   | <b>7.4</b>     | 6.5  | 6.0  |
| Sulfation        | Abs/.1mm | ASTM D7415*   | >30   | <b>19.9</b>    | 21.6 | 20.5 |
| Emulsified Water | scalar   | Visual*       | >0.21 | <b>NEG</b>     | NEG  | NEG  |

**FLUID CONDITION**

The condition of the oil is acceptable for the time in service.

|              |          |               |      |              |      |      |
|--------------|----------|---------------|------|--------------|------|------|
| Sodium       | ppm      | ASTM D5185(m) | >31  | <b>2</b>     | 2    | 2    |
| Boron        | ppm      | ASTM D5185(m) | 1    | <b>37</b>    | 177  | 168  |
| Barium       | ppm      | ASTM D5185(m) | 1    | <b>0</b>     | <1   | <1   |
| Molybdenum   | ppm      | ASTM D5185(m) | 60   | <b>45</b>    | 1    | 3    |
| Manganese    | ppm      | ASTM D5185(m) | 1    | <b>&lt;1</b> | <1   | <1   |
| Magnesium    | ppm      | ASTM D5185(m) | 1010 | <b>711</b>   | 18   | 52   |
| Calcium      | ppm      | ASTM D5185(m) | 1070 | <b>1359</b>  | 2042 | 2057 |
| Phosphorus   | ppm      | ASTM D5185(m) | 1150 | <b>966</b>   | 965  | 981  |
| Zinc         | ppm      | ASTM D5185(m) | 1270 | <b>1162</b>  | 1119 | 1169 |
| Sulfur       | ppm      | ASTM D5185(m) | 2060 | <b>2530</b>  | 2930 | 3205 |
| Oxidation    | Abs/.1mm | ASTM D7414*   | >25  | <b>15.4</b>  | 17.2 | 16.7 |
| Visc @ 100°C | cSt      | ASTM D7279(m) | 15.6 | <b>13.7</b>  | 13.8 | 13.5 |

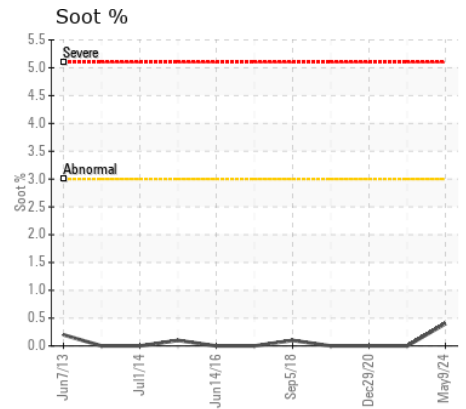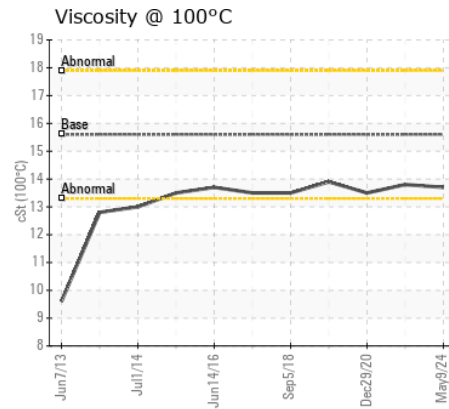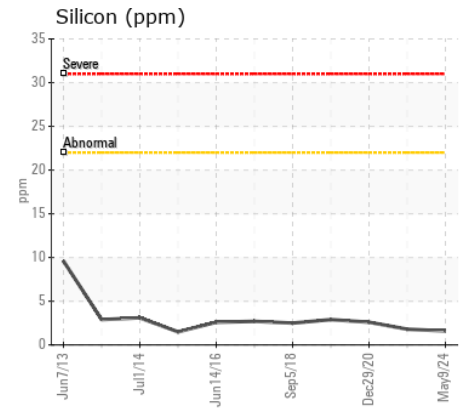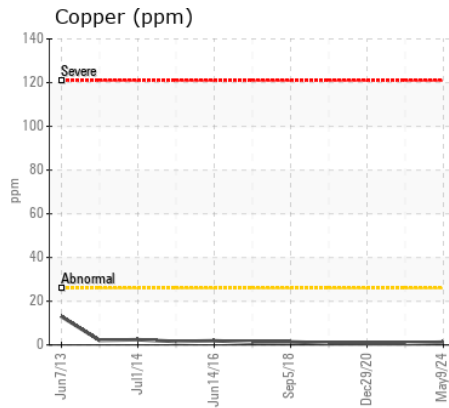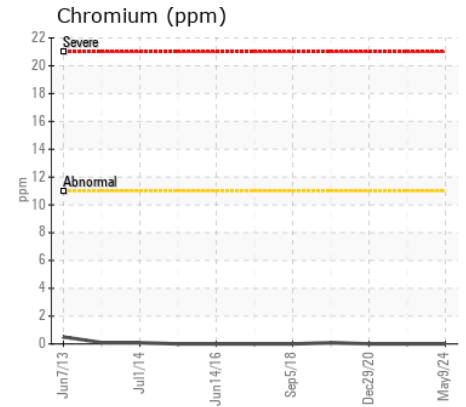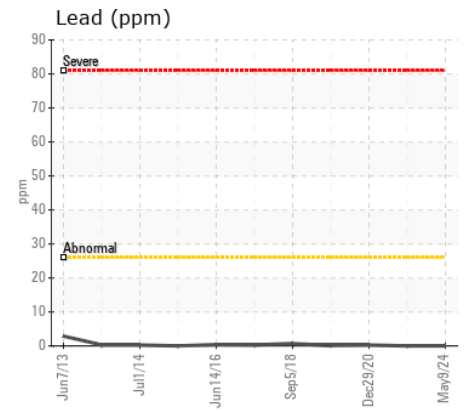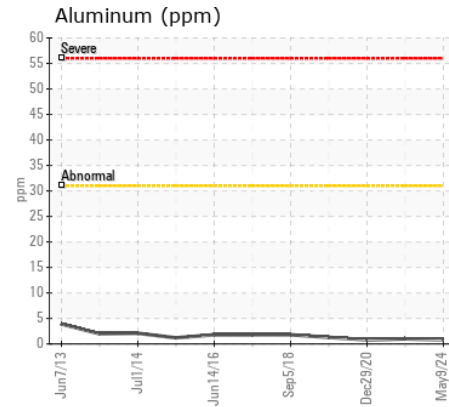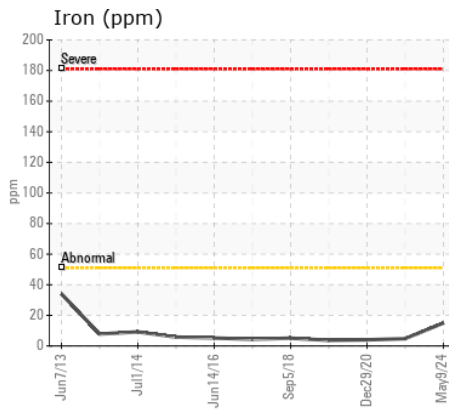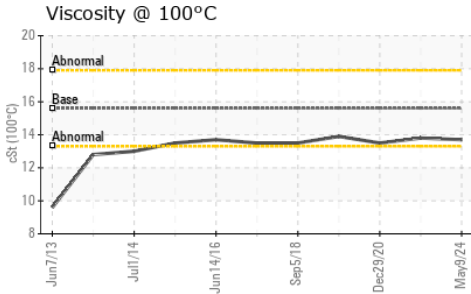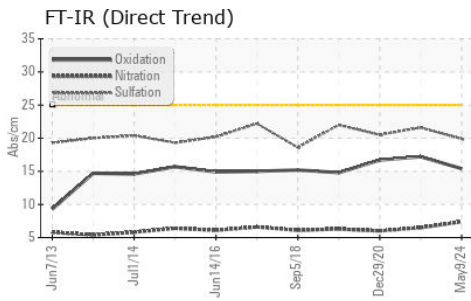

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WA0021289  
**Lab Number** : 02635208  
**Unique Number** : 5776361  
**Test Package** : MOB 1  
**Received** : 14 May 2024  
**Tested** : 14 May 2024  
**Diagnosed** : 14 May 2024 - Wes Davis

**Wajax Power Systems**  
 70 Raddall Avenue  
 Dartmouth, NS  
 CA B3B 1T7  
 Contact: Danelle Hoffman  
 dhoffman@wajax.com  
 T: (902)468-6200  
 F: (902)468-3325

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.