



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id  
**TJ036461**  
 Component  
**Diesel Engine**  
 Fluid  
**DIESEL ENGINE OIL SAE 40 (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) DIESEL ENGINE OIL SAE 40. Please confirm.  
 Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0938899	---	---
Sample Date		Client Info		03 May 2024	---	---
Machine Age	hrs	Client Info		155	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				NORMAL	---	---

## WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	1	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	1	---	---
Lead	ppm	ASTM D5185(m)	>40	0	---	---
Copper	ppm	ASTM D5185(m)	>330	3	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

## CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	3	---	---
Potassium	ppm	ASTM D5185(m)	>20	<1	---	---
Fuel		WC Method	>5	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	4.8	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	19.1	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

## FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185(m)	>216	2	---	---
Boron	ppm	ASTM D5185(m)	250	235	---	---
Barium	ppm	ASTM D5185(m)	10	0	---	---
Molybdenum	ppm	ASTM D5185(m)	100	80	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)	450	367	---	---
Calcium	ppm	ASTM D5185(m)	3000	1422	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	859	---	---
Zinc	ppm	ASTM D5185(m)	1350	961	---	---
Sulfur	ppm	ASTM D5185(m)	4250	2420	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	15.0	---	---
Base Number (BN)	mg KOH/g	ASTM D2896*	8.5	9.42	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	13.2	---	---

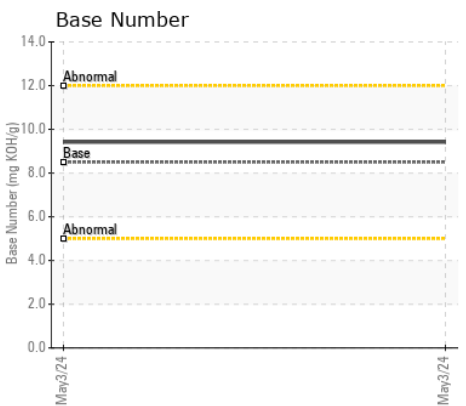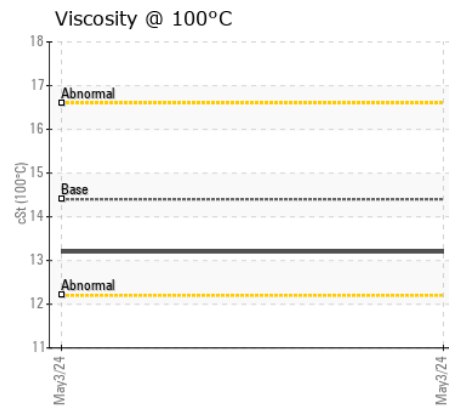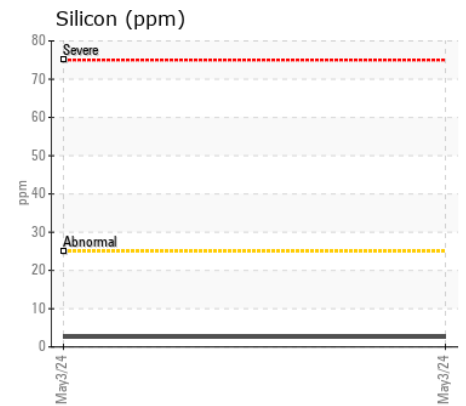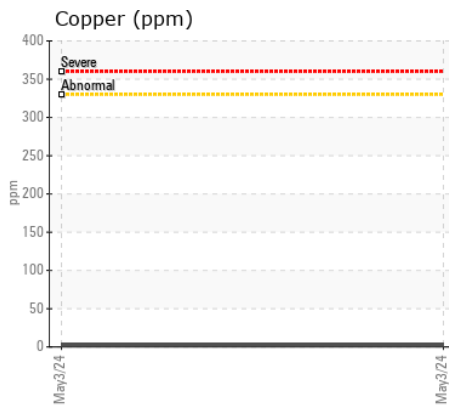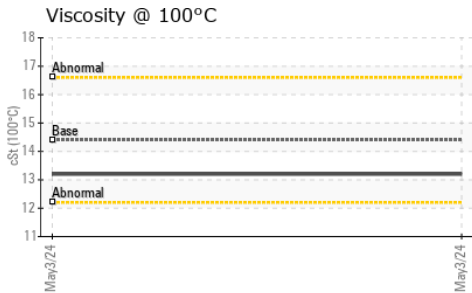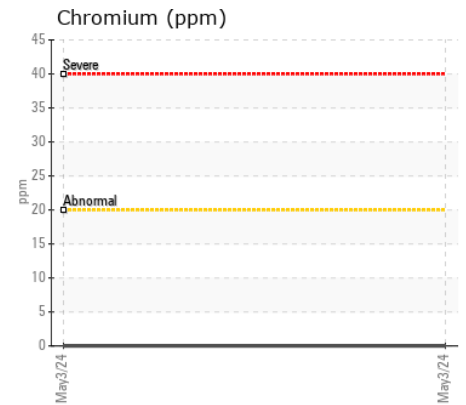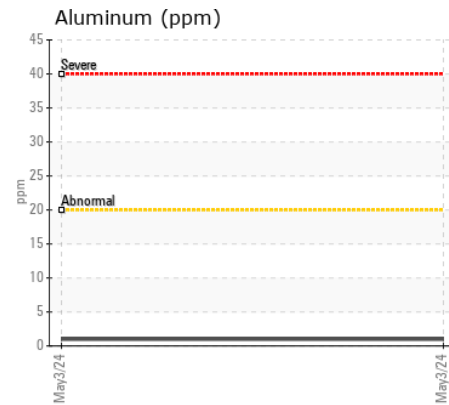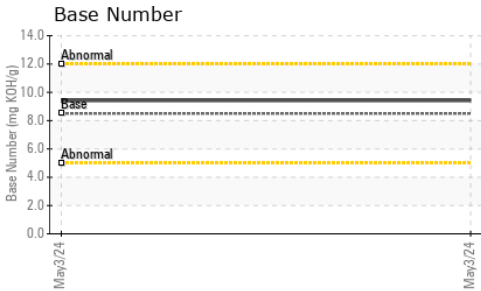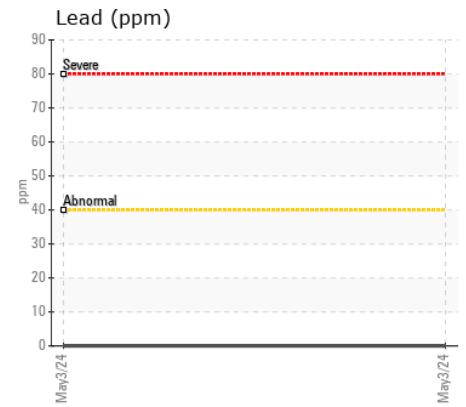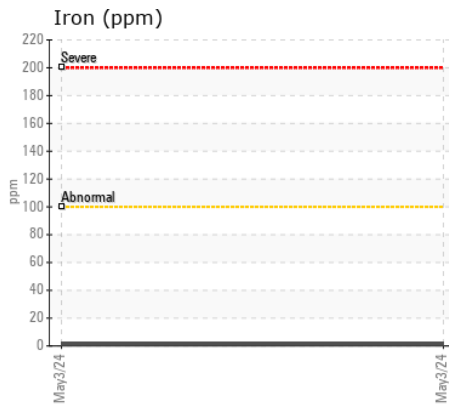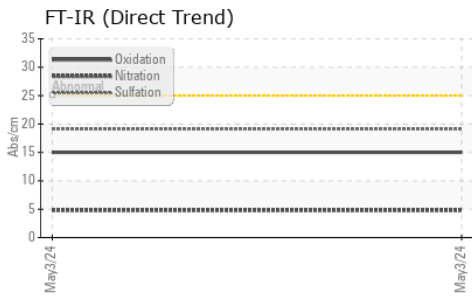

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0938899 **Received** : 16 May 2024  
**Lab Number** : 02636001 **Tested** : 17 May 2024  
**Unique Number** : 5785163 **Diagnosed** : 17 May 2024 - Wes Davis  
**Test Package** : MOB 2

**GENREP LTD.**  
 134 RIVALDA ROAD  
 NORTH YORK, ON  
 CA M9M 2M8  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

T:  
F: