



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
WICHMANN NEELANDSLONGOSNG1
 Component
Natural Gas Engine
 Fluid
PETRO CANADA SENTRON LD 5000 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0915636	WC0915634	PC0078881
Sample Date		Client Info		06 May 2024	01 Apr 2024	17 Jan 2024
Machine Age	hrs	Client Info		40547	39708	38115
Oil Age	hrs	Client Info		839	877	836
Filter Age	hrs	Client Info		839	877	836
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>80	4	10	14
Chromium	ppm	ASTM D5185(m)	>6	0	<1	<1
Nickel	ppm	ASTM D5185(m)	>2	0	0	<1
Titanium	ppm	ASTM D5185(m)	>2	0	0	0
Silver	ppm	ASTM D5185(m)	>2	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	2	1	2
Lead	ppm	ASTM D5185(m)	>95	0	0	<1
Copper	ppm	ASTM D5185(m)	>85	<1	1	<1
Tin	ppm	ASTM D5185(m)	>9	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	1	2	3
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Water		WC Method	>0.1	NEG	NEG	NEG
Soot %	%	ASTM D7844*		0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	4.7	4.3	5.0
Sulfation	Abs/.1mm	ASTM D7415*	>30	15.8	15.2	16.7
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		0	<1	<1
Boron	ppm	ASTM D5185(m)	2	1	<1	<1
Barium	ppm	ASTM D5185(m)	3	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0	1
Manganese	ppm	ASTM D5185(m)	0	0	0	0
Magnesium	ppm	ASTM D5185(m)	4	9	7	11
Calcium	ppm	ASTM D5185(m)	1727	1798	1833	1855
Phosphorus	ppm	ASTM D5185(m)	272	271	272	279
Zinc	ppm	ASTM D5185(m)	333	322	326	335
Sulfur	ppm	ASTM D5185(m)	3415	2608	2678	2882
Oxidation	Abs/.1mm	ASTM D7414*	>25	8.9	8.7	9.9
Visc @ 100°C	cSt	ASTM D7279(m)	13.4	13.3	13.3	13.4

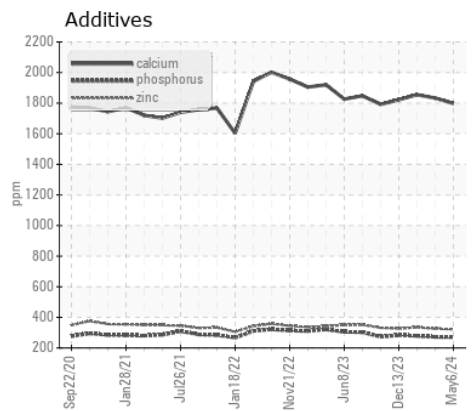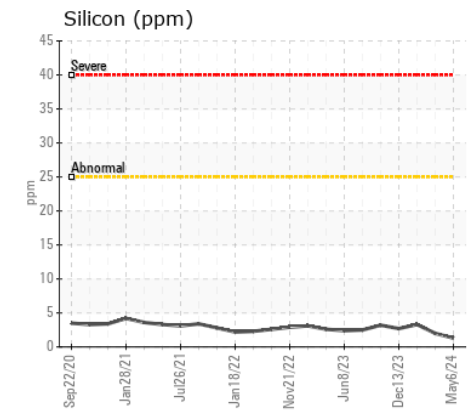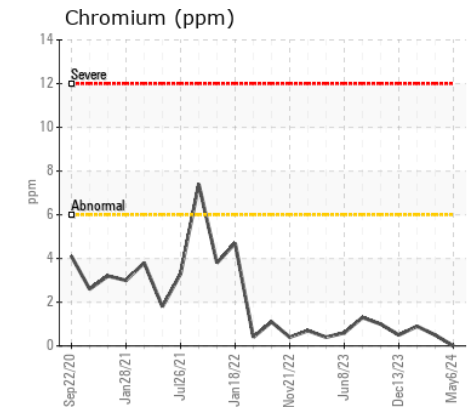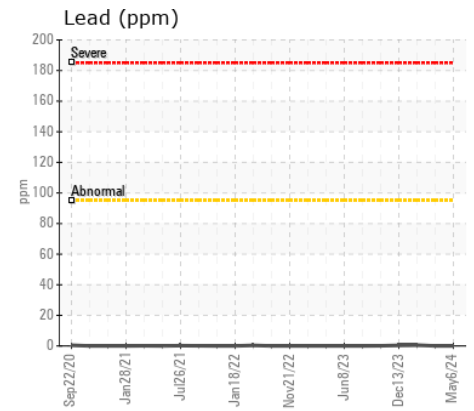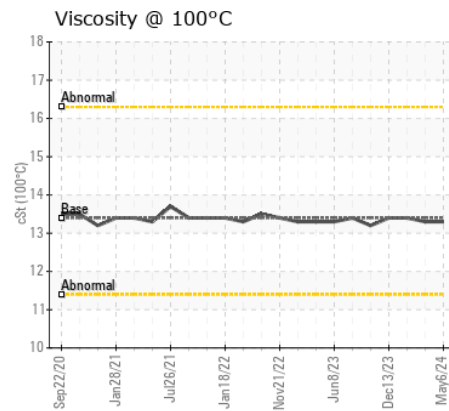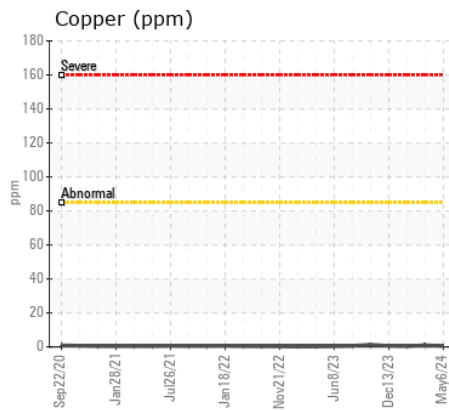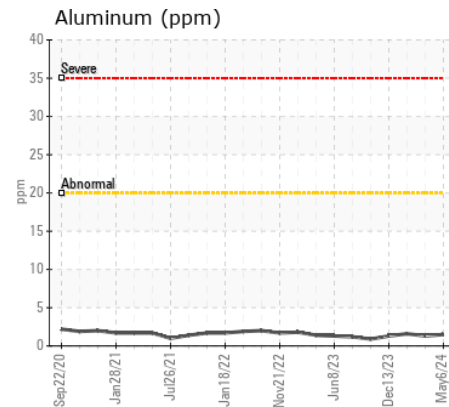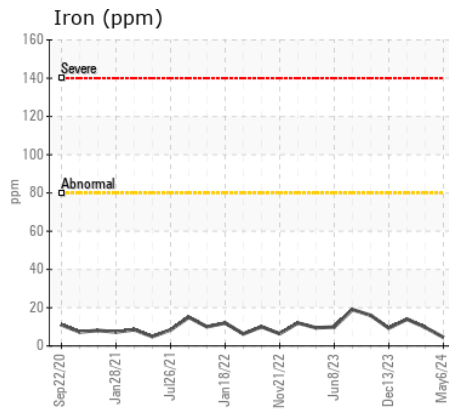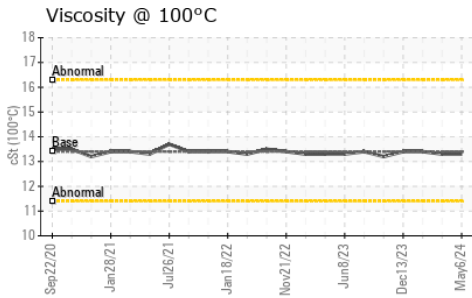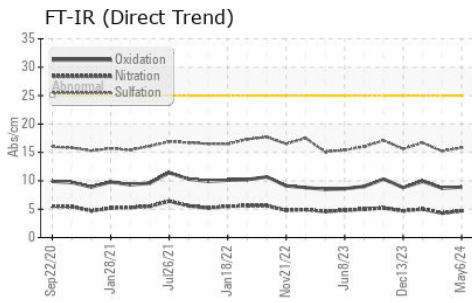

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0915636
Lab Number : 02636008
Unique Number : 5785170
Test Package : MOB 1

Received : 16 May 2024
Tested : 16 May 2024
Diagnosed : 16 May 2024 - Wes Davis

Martin Energy Group Canada
 5531 Schummer Line
 Linwood, ON
 CA N0B 2A0
 Contact: Allen Steiner
 asteiner@martinenergygroup.com
 T: (226)545-0230
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.