

#### **CORROSION** NORMAL CONTAMINANTS NORMAL COOLANT CONDITION NORMAL

# TROY LIFE SAFETY [289551] PE6068T792036 Coolant

**EXTENDED LIFE COOLANT (--- GAL)** 

#### RECOMMENDATION

The fluid is suitable for further service. Resample at the next service interval to monitor.

DD	
	ION

All metal levels are normal indicating no corrosion in the cooling system.

### **CONTAMINANTS**


There is no indication of any contamination in the coolant.


## COOLANT CONDITION

The nitrite level is acceptable. The pH level of this fluid is within the acceptable limits. The reserve alkalinity of this fluid is acceptable.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WA0021510		
Sample Date		Client Info		08 May 2024		
Machine Age	hrs	Client Info		292		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
Iron	ppm	ASTM D5185(m)	>15	3		
Aluminum	ppm	ASTM D5185(m)	>10	<1		
Copper	ppm	ASTM D5185(m)	>10	<1		
Lead	ppm	ASTM D5185(m)	>10	<1		
Tin	ppm	ASTM D5185(m)	>10	0		
Silver	ppm	ASTM D5185(m)	>10	<1		
Zinc	ppm	ASTM D5185(m)	>10	2		
Calcium	ppm	ASTM D5185(m)	>100	1		
Magnesium	ppm	ASTM D5185(m)	>40	1		
Appearance	scalar	Visual*	NORML	NORML		
Odor	scalar	Visual*	NORML	NORML		
Coolant Appearance		Visual*	Clear	Clear		
Boiling Point	°C	WC Method*		108		
Specific Gravity		ASTM D1298*		1.069		
рН	Scale 0-14	ASTM D1287*	9.0	8.21		
Nitrites	ppm	Alcan Test Kit*		920		
Reserve Alkalinity	Scale 0-20	ASTM D1121*		3.3		
Percentage Glycol	%	ASTM D3321*	50	51.0		
Freezing Point	°C	ASTM D3321*	-40	-39		
Carboxylate						
Silicon	ppm	ASTM D5185(m)		38		
Phosphorus	ppm	ASTM D5185(m)		53		
Boron	ppm	ASTM D5185(m)		232		
Molybdenum	ppm	ASTM D5185(m)		11		
Sodium	ppm	ASTM D5185(m)		2100		
Potassium	ppm	ASTM D5185(m)		729		
Coolant Color		Visual*	Orange/R	Red		

Contact/Location: David Gilkes - HARTOR Page 1 of 2



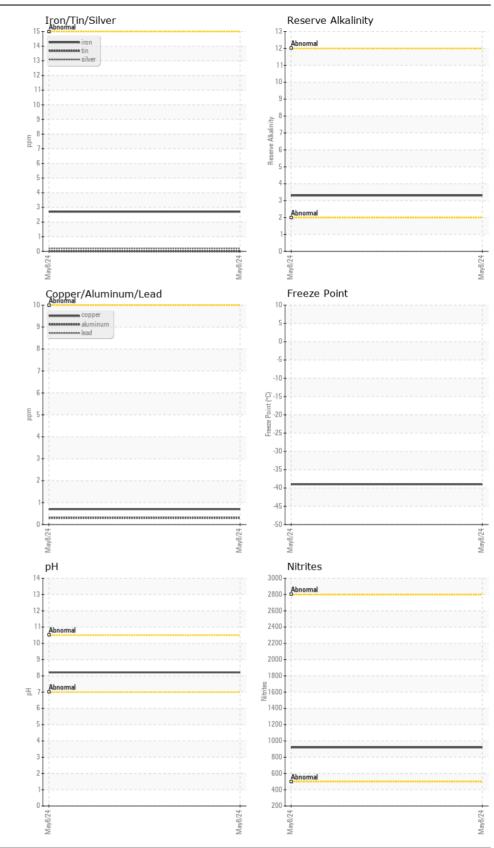

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Wajax Power Systems CALA Sample No. Received 10 Diesel Drive : WA0021510 : 16 May 2024 Lab Number : 02636215 Tested Toronto, ON : 17 May 2024 ISO 17025:2017 Accredited Laboratory Unique Number : 5785377 : 21 May 2024 - Kevin Marson CA M8W 2T8 Diagnosed Test Package : COOL (Additional Tests: GlycolType) Contact: David Gilkes To discuss this sample report, contact Customer Service at 1-800-268-2131. dgilkes@wajax.com Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab. T: (416)259-3281 Validity of results and interpretation are based on the sample and information as supplied. F: (416)251-6191