



FUEL REPORT

CORROSION	NORMAL
CONTAMINANTS	NORMAL
FUEL CONDITION	NORMAL

Area

[ORD0113699]

Machine Id

DAY TANK #1

Component

Diesel Fuel

Fluid

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

RECOMMENDATION

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0942483	---	---
Sample Date		Client Info		03 May 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Sample Status				NORMAL	---	---

CORROSION

{not applicable}

Aluminum	ppm	ASTM D5185(m)	<0.1	0	---	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	---	---
Lead	ppm	ASTM D5185(m)	<0.1	<1	---	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	---	---
Iron	ppm	ASTM D5185(m)	<0.1	<1	---	---

CONTAMINANTS









The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. There is no indication of any contamination in the diesel fuel.

Silicon	ppm	ASTM D5185(m)	<1.0	0	---	---
Sodium	ppm	ASTM D5185(m)	<0.1	<1	---	---
Potassium	ppm	ASTM D5185(m)	<0.1	0	---	---
Water	%	ASTM D6304*	<0.05	0.002	---	---
ppm Water	ppm	ASTM D6304*	<500	24	---	---
Particles >4µm		ASTM D7647	>2500	529	---	---
Particles >6µm		ASTM D7647	>640	71	---	---
Particles >14µm		ASTM D7647	>80	4	---	---
Particles >21µm		ASTM D7647	>20	1	---	---
Particles >38µm		ASTM D7647	>4	0	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	16/13/9	---	---
Calcium	ppm	ASTM D5185(m)	<0.1	0	---	---
Magnesium	ppm	ASTM D5185(m)	<0.1	0	---	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	0	---	---
Zinc	ppm	ASTM D5185(m)	<0.1	0	---	---

FUEL CONDITION

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B).

Specific Gravity		ASTM D1298*	0.839	0.837	---	---
Fuel Color	text	Visual Screen*	Yellow	Pink	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	2.2	---	---
Pensky-Martens Flash Point	°C	ASTM D7215*	52	56.8	---	---
Sulfur	ppm	ASTM D5185(m)	10	13	---	---
Initial Boiling Point	°C	ASTM D2887*	165	167	---	---
10% Distill Point	°C	ASTM D2887*	201	198	---	---
20% Distill Point	°C	ASTM D2887*	216	214	---	---
30% Distill Point	°C	ASTM D2887*	230	229	---	---
40% Distill Point	°C	ASTM D2887*	243	243	---	---
50% Distill Point	°C	ASTM D2887*	255	256	---	---
60% Distill Point	°C	ASTM D2887*	267	268	---	---
70% Distill Point	°C	ASTM D2887*	280	280	---	---
80% Distill Point	°C	ASTM D2887*	295	292	---	---
90% Distill Point	°C	ASTM D2887*	310	308	---	---
Final Boiling Point	°C	ASTM D2887*	341	334	---	---
API Gravity		ASTM D1298*	37.7	37	---	---
Cetane Index		ASTM D4737*	<40.0	48	---	---

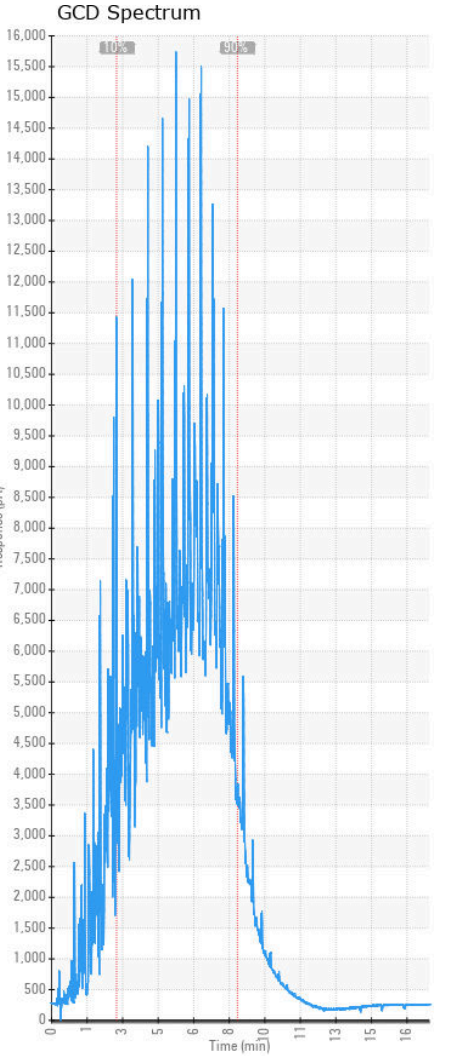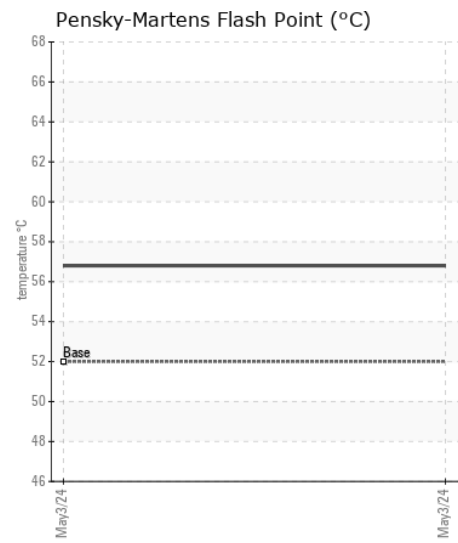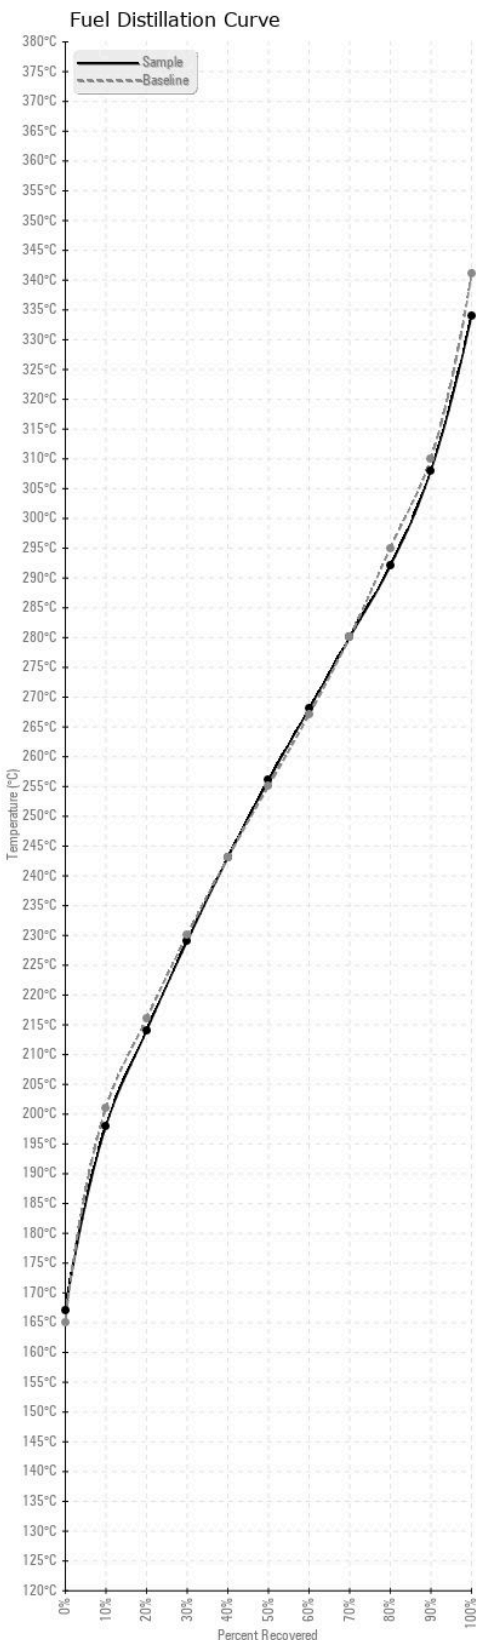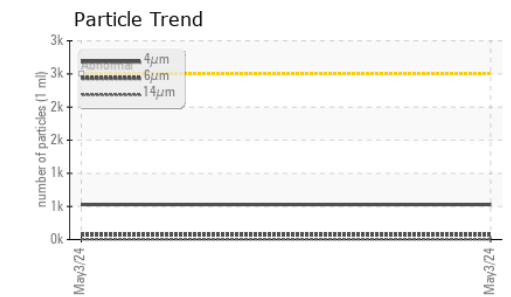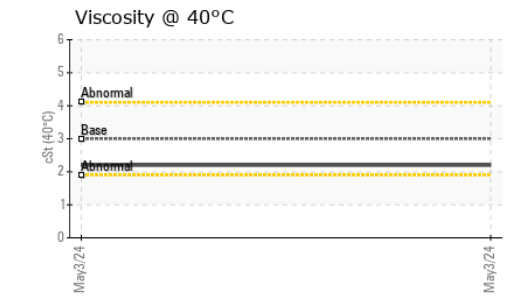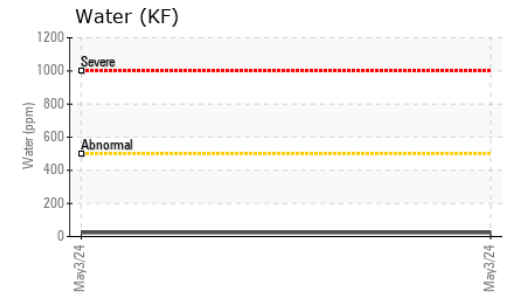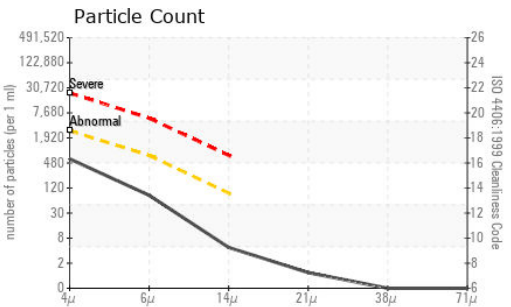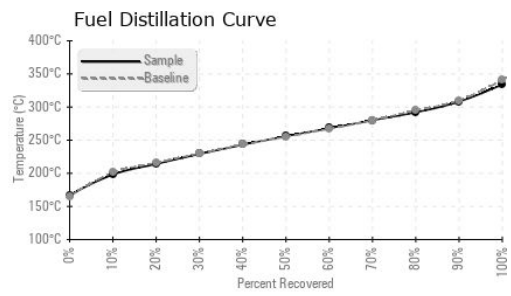

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0942483 **Received** : 16 May 2024
Lab Number : 02636224 **Tested** : 21 May 2024
Unique Number : 5785386 **Diagnosed** : 21 May 2024 - Kevin Marson
Test Package : FUEL (Additional Tests: CC Flash, PrtCount)

HONEYWELL
 1929 OGILVIE RD
 GLOUCESTER, ON
 CA K1J 0B9
 Contact: Alain Guindon
 joseph.guindon@cse-cst.gc.ca
 T: (613)991-2659
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.