



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
WELLINGTON BUILDING [103565]

Machine Id
7A42773

Component
Diesel Engine

Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CU0021092	CU0018590	CU0017928
Sample Date		Client Info		11 May 2024	28 May 2022	29 May 2021
Machine Age	hrs	Client Info		142	116	100
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	N/A	Changed
Filter Changed		Client Info		N/A	N/A	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>200	4	9	16
Chromium	ppm	ASTM D5185(m)	>20	0	<1	<1
Nickel	ppm	ASTM D5185(m)	>2	0	<1	0
Titanium	ppm	ASTM D5185(m)	>2	1	20	76
Silver	ppm	ASTM D5185(m)	>2	0	<1	<1
Aluminum	ppm	ASTM D5185(m)	>30	<1	1	2
Lead	ppm	ASTM D5185(m)	>30	<1	4	7
Copper	ppm	ASTM D5185(m)	>30	1	2	4
Tin	ppm	ASTM D5185(m)	>15	0	2	3
Vanadium	ppm	ASTM D5185(m)		0	<1	<1
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	VLITE	---	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>30	14	19	44
Potassium	ppm	ASTM D5185(m)	>20	0	1	2
Fuel		WC Method	>3.0	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	6.8	6.2	6.9
Sulfation	Abs/.1mm	ASTM D7415*	>30	20.1	20.6	19.9
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>158	3	4	5
Boron	ppm	ASTM D5185(m)	250	45	63	105
Barium	ppm	ASTM D5185(m)	10	0	0	<1
Molybdenum	ppm	ASTM D5185(m)	100	45	24	8
Manganese	ppm	ASTM D5185(m)		<1	<1	<1
Magnesium	ppm	ASTM D5185(m)	450	788	446	382
Calcium	ppm	ASTM D5185(m)	3000	1220	1839	1914
Phosphorus	ppm	ASTM D5185(m)	1150	726	1094	1031
Zinc	ppm	ASTM D5185(m)	1350	834	1193	1246
Sulfur	ppm	ASTM D5185(m)	4250	1984	3068	3422
Oxidation	Abs/.1mm	ASTM D7414*	>25	17.2	12.3	15.1
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	14.3	13.5	13.6

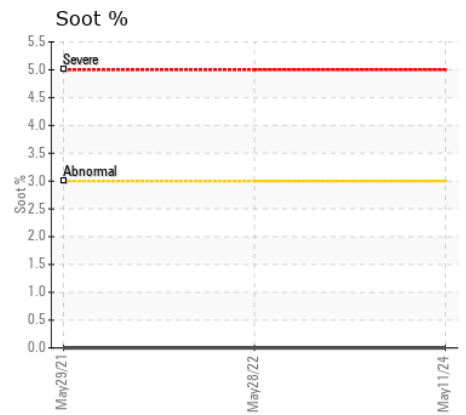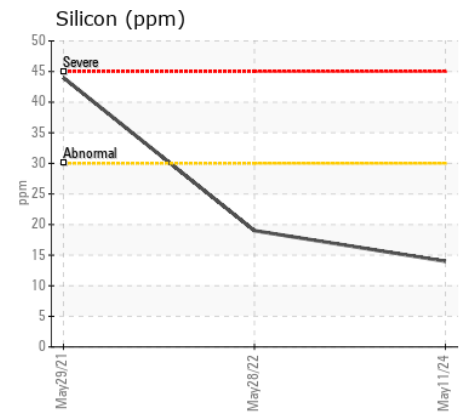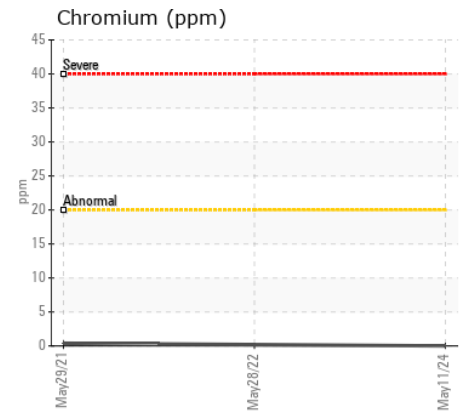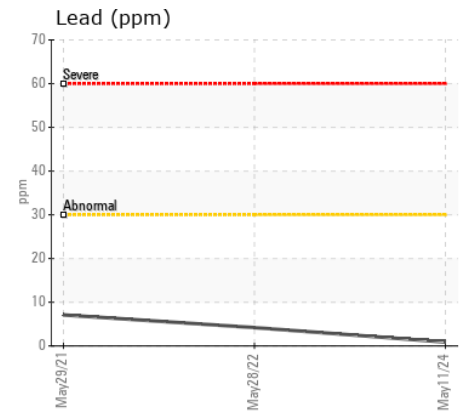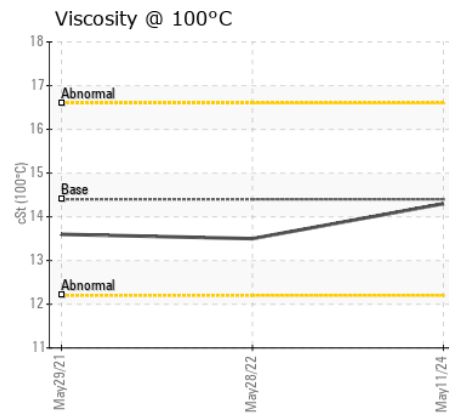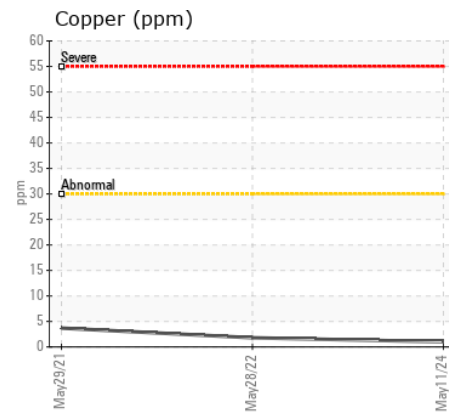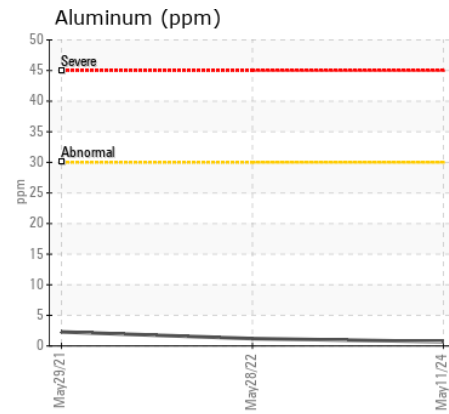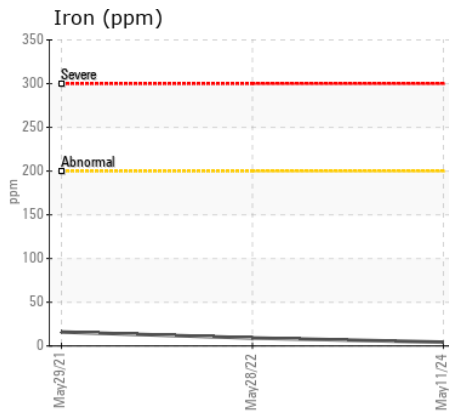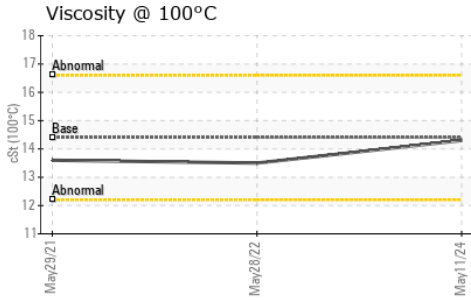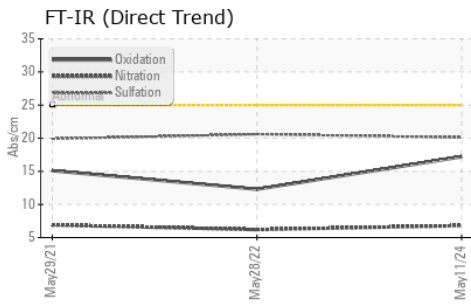

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CU0021092 **Received** : 17 May 2024
Lab Number : 02636303 **Tested** : 17 May 2024
Unique Number : 5785465 **Diagnosed** : 17 May 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: Visual)

CUMMINS EASTERN CANADA LP
 3189 SWANSEA CRESCENT
 OTTAWA, ON
 CA K1G 3W5
 Contact: Cindy Harrison
 cindy.harrison@cummins.com
 T: (613)736-1146
 F: x:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.