



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
PM2-225-25
 Component
Hydraulic System
 Fluid
ESSO NUTO H ISO 100 (10000 LTR)

RECOMMENDATION

This is a baseline read-out on the submitted sample.

WEAR

{not applicable}



CONTAMINATION

{not applicable}

FLUID CONDITION

The Rotating Pressure Vessel Oxidation Test (RPVOT – ASTM D2272) result indicates suitable amounts of anti-oxidant(s) present in the oil.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0939879	WC0561625	---
Sample Date		Client Info		14 May 2024	21 Mar 2024	---
Machine Age	mths	Client Info		240	240	---
Oil Age	mths	Client Info		0	0	---
Filter Age	mths	Client Info		6	6	---
Oil Changed		Client Info		Filtered	Filtered	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				NORMAL	NORMAL	---
White Metal	scalar	Visual*	NONE	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	---
Water		WC Method	>0.05	NEG	NEG	---
Silt	scalar	Visual*	NONE	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Oxidation Test (RPVOT)	minutes	ASTM D2272*	250	170	---	---

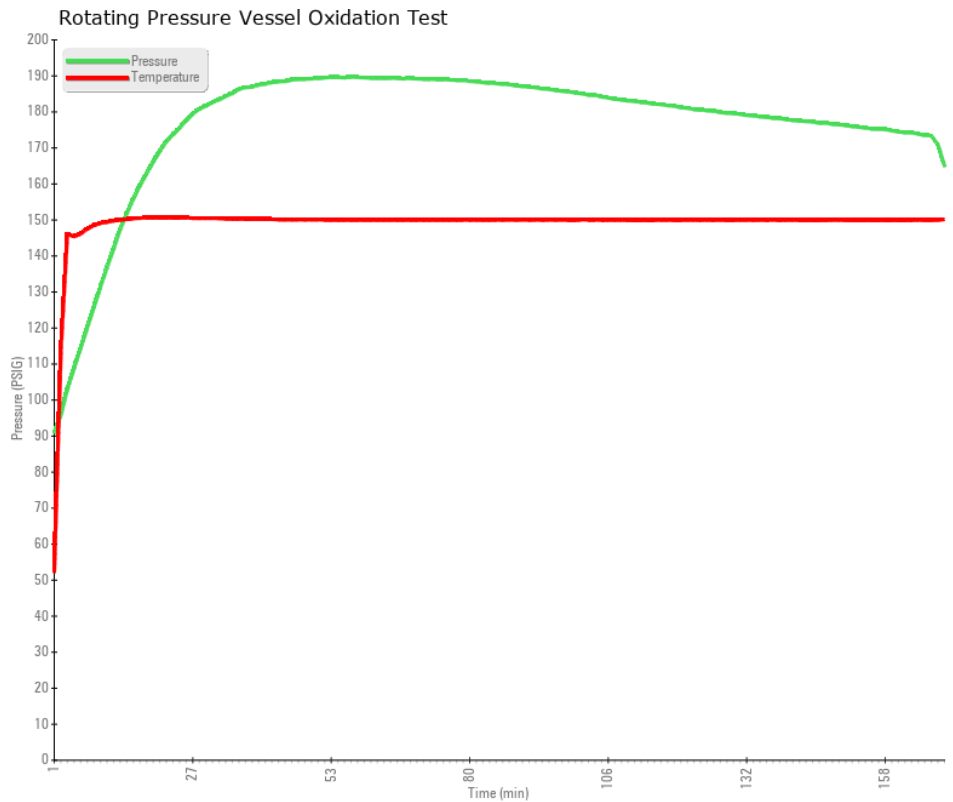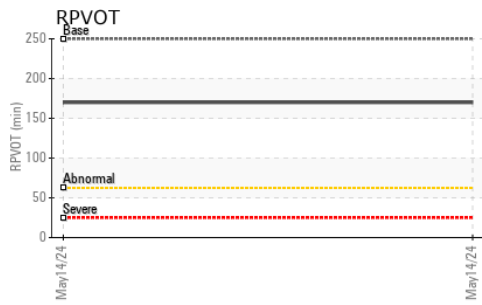

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0939879
Lab Number : 02636450
Unique Number : 5785612
Test Package : TEST (Additional Tests: RPVOT)

Received : 17 May 2024
Tested : 21 May 2024
Diagnosed : 21 May 2024 - Kevin Marson

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

IRVING PAPER LTD
 435 BAYSIDE DRIVE
 SAINT JOHN, NB
 CA E2L 4K9
 Contact: Terry Tomney
 tomney.terry@irvingpaper.com
 T: (506)650-8435
 F: