



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
9061-5479 QUEBEC INC

Machine Id

06
Component

Diesel Engine

Fluid
DIESEL ENGINE OIL SAE 40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) DIESEL ENGINE OIL SAE 40. Please confirm. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CU0023109	---	---
Sample Date		Client Info		21 May 2024	---	---
Machine Age	mls	Client Info		0	---	---
Oil Age	mls	Client Info		0	---	---
Filter Age	mls	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	8	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<1	---	---
Lead	ppm	ASTM D5185(m)	>40	6	---	---
Copper	ppm	ASTM D5185(m)	>330	9	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	2	---	---
Potassium	ppm	ASTM D5185(m)	>20	15	---	---
Fuel		WC Method	>5	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol	%	ASTM D7922*		0.0	---	---
Soot %	%	ASTM D7844*	>3	0.2	---	---
Nitration	Abs/cm	ASTM D7624*	>20	7.6	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	20.6	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>216	18	---	---
Boron	ppm	ASTM D5185(m)	250	33	---	---
Barium	ppm	ASTM D5185(m)	10	0	---	---
Molybdenum	ppm	ASTM D5185(m)	100	4	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)	450	19	---	---
Calcium	ppm	ASTM D5185(m)	3000	2188	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	827	---	---
Zinc	ppm	ASTM D5185(m)	1350	1020	---	---
Sulfur	ppm	ASTM D5185(m)	4250	2824	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	14.6	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	15.7	---	---

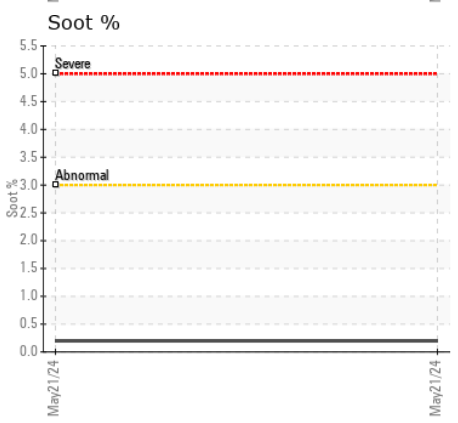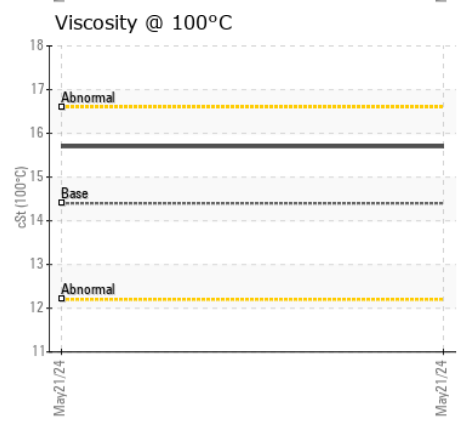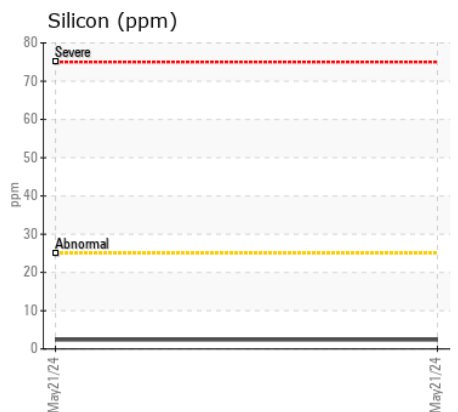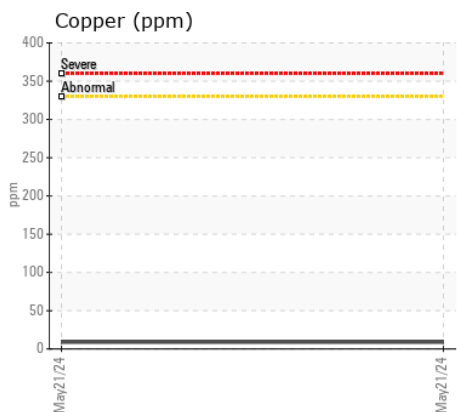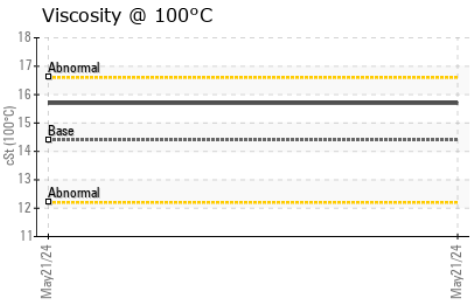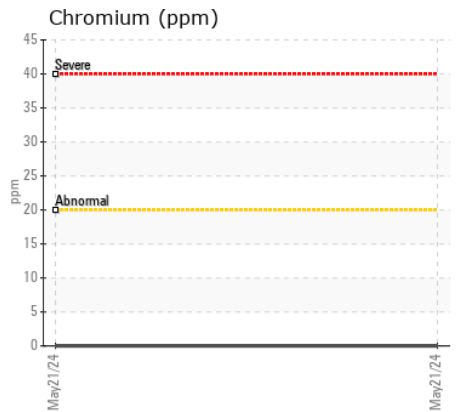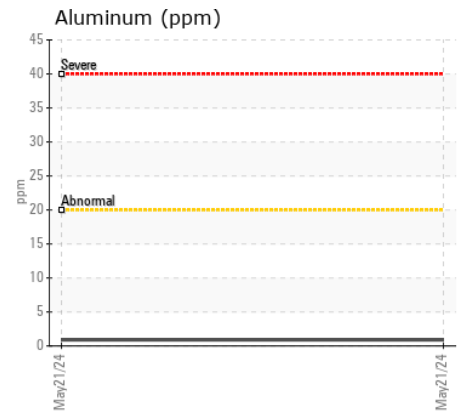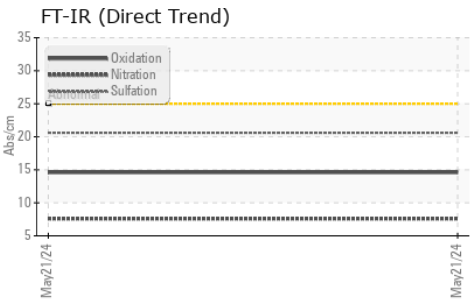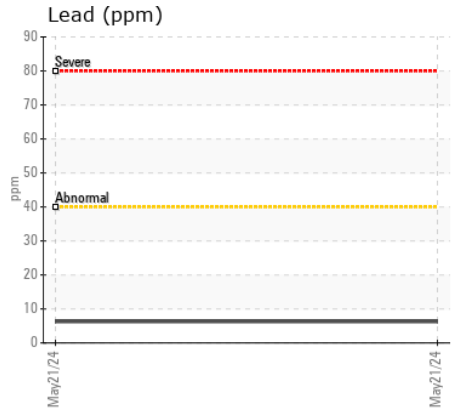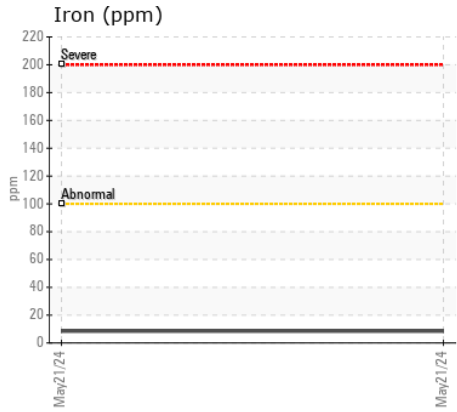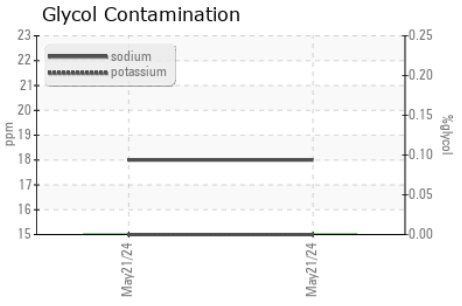

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CU0023109 **Received** : 22 May 2024
Lab Number : 02636886 **Tested** : 22 May 2024
Unique Number : 5786048 **Diagnosed** : 22 May 2024 - Kevin Marson
Test Package : MOB 1 (Additional Tests: Glycol)

CUMMINS DIESEL
 2400 AV WATT
 Quebec City, QC
 CA G1P 3T3
 Contact: Remi Fillion
 remi.fillion@cummins.com
 T: (418)651-2911
 F: (418)651-8434

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.