



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	ABNORMAL

Area
[6229977]
 Machine Id
5001-PR29-TAB23
 Component
Main Gearbox
 Fluid
DAVLEY DARMEX RPL-NT0140 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

WEAR

All component wear rates are normal.









CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION

Viscosity of sample indicates oil is within ISO 320 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CB0031827	CB0031273	CB5985511
Sample Date		Client Info		30 Mar 2024	15 Mar 2023	27 Mar 2022
Machine Age	yrs	Client Info		0	0	0
Oil Age	yrs	Client Info		0	0	0
Filter Age	yrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
PQ		ASTM D8184*		0	0	0
Iron	ppm	ASTM D5185(m)	>200	69	71	68
Chromium	ppm	ASTM D5185(m)	>15	0	0	<1
Nickel	ppm	ASTM D5185(m)	>15	0	0	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	0	0
Aluminum	ppm	ASTM D5185(m)	>25	0	0	<1
Lead	ppm	ASTM D5185(m)	>100	0	0	0
Copper	ppm	ASTM D5185(m)	>200	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>25	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Silicon	ppm	ASTM D5185(m)	>50	1	3	2
Potassium	ppm	ASTM D5185(m)	>20	<1	0	<1
Water		WC Method	>0.2	NEG	NEG	NEG
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	VLITE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG
Sodium	ppm	ASTM D5185(m)		0	<1	<1
Boron	ppm	ASTM D5185(m)		<1	<1	<1
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		<1	<1	<1
Magnesium	ppm	ASTM D5185(m)		<1	<1	<1
Calcium	ppm	ASTM D5185(m)		2	<1	2
Phosphorus	ppm	ASTM D5185(m)		133	157	153
Zinc	ppm	ASTM D5185(m)		2	2	2
Sulfur	ppm	ASTM D5185(m)		101	152	113
Acid Number (AN)	mg KOH/g	ASTM D974*		0.33	0.32	0.35
Visc @ 40°C	cSt	ASTM D7279(m)	441	▲ 274	▲ 275	▲ 311

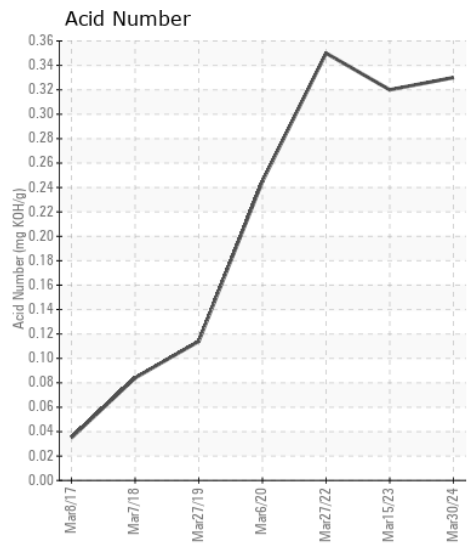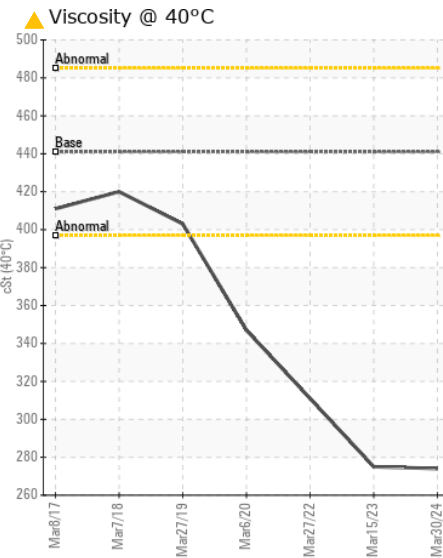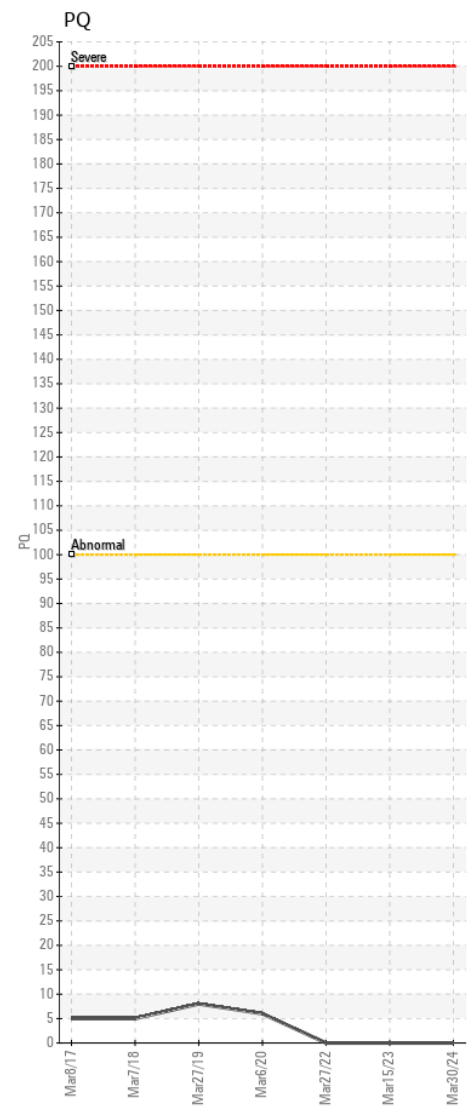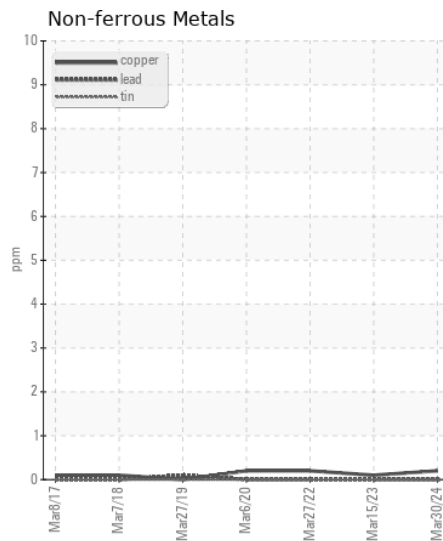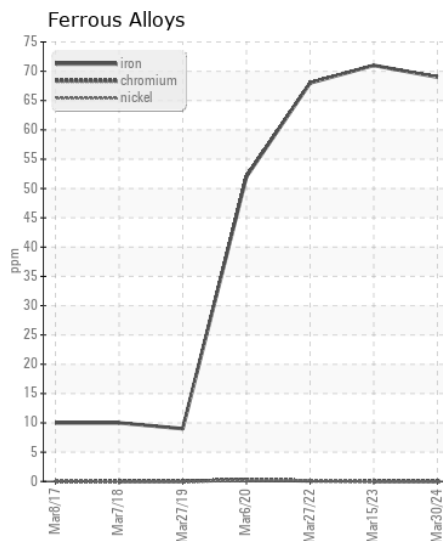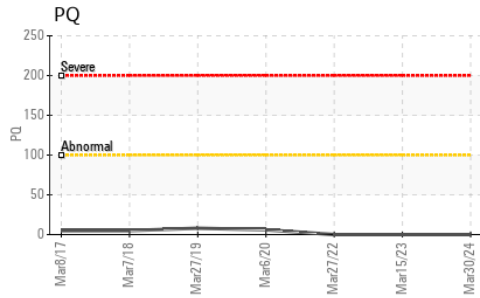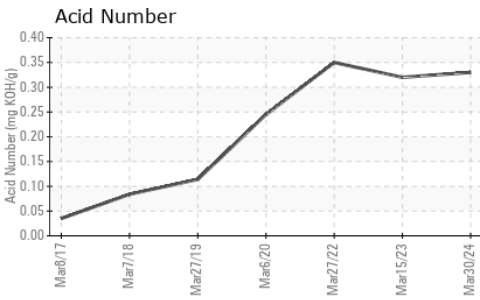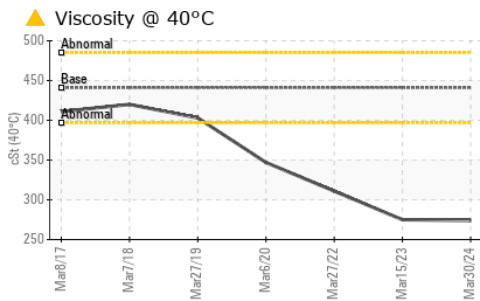

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CB0031827
Lab Number : 02637011
Unique Number : 5786173
Test Package : IND 2 (Additional Tests: TAN Man)
Received : 22 May 2024
Tested : 23 May 2024
Diagnosed : 23 May 2024 - Kevin Marson

Synovos/Apotex
 50 Steinway Blvd.
 Etobicoke, ON
 CA M9W 6Y3
 Contact: Emmanuel Okelue
 eokelue@apotex.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T:
F: