MOB

POWERStation
WWW.POWERSTATIONGENERATORS.COM
POWER GENERATION PRODUCTS

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
[86395]
Machine Id
1 ADELAIDE ST E TORONTO GWL GWL
Component
Right Diesel Engine
Fluid
ESSO XD-3 EXTRA 15W40 (100 GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using MOB 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. this testkit includes BN to determine the suitability of the oil for continued use.

WEAR

Metal levels are typical for a new component breaking in. Component wear rates appear to be normal (unconfirmed).

CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION

The condition of the oil is acceptable for the time in service (unconfirmed).

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		**PN0006188**	PN0004669	PN0003479
Sample Date		Client Info		**17 May 2024**	03 May 2023	10 May 2022
Machine Age	hrs	Client Info		**746**	743	724
Oil Age	hrs	Client Info		**4**	19	9
Filter Age	hrs	Client Info		**4**	19	9
Oil Changed		Client Info		**Changed**	Changed	Changed
Filter Changed		Client Info		**Changed**	Changed	Changed
Sample Status				**NORMAL**	NORMAL	NORMAL
Iron	ppm	ASTM D5185(m)	>200	**2**	3	3
Chromium	ppm	ASTM D5185(m)	>20	**0**	0	0
Nickel	ppm	ASTM D5185(m)	>2	**0**	0	<1
Titanium	ppm	ASTM D5185(m)	>2	**0**	0	0
Silver	ppm	ASTM D5185(m)	>2	**0**	0	4
Aluminum	ppm	ASTM D5185(m)	>30	**0**	<1	<1
Lead	ppm	ASTM D5185(m)	>30	**<1**	<1	1
Copper	ppm	ASTM D5185(m)	>30	**<1**	<1	<1
Tin	ppm	ASTM D5185(m)	>15	**<1**	2	2
Vanadium	ppm	ASTM D5185(m)		**0**	0	0
White Metal	scalar	Visual*	NONE	**NONE**	---	---
Yellow Metal	scalar	Visual*	NONE	**NONE**	---	---
Silicon	ppm	ASTM D5185(m)	>30	**6**	3	3
Potassium	ppm	ASTM D5185(m)	>20	**0**	0	<1
Fuel		WC Method	>3.0	**<1.0**	<1.0	<1.0
Water		WC Method	>0.2	**NEG**	NEG	NEG
Glycol		WC Method		**NEG**	NEG	NEG
Soot %	%	ASTM D7844*	>3	**0**	0	0
Nitration	Abs/cm	ASTM D7624*	>20	**3.0**	3.6	3.6
Sulfation	Abs/.1mm	ASTM D7415*	>30	**12.5**	13.4	15.1
Silt	scalar	Visual*	NONE	**NONE**	---	---
Debris	scalar	Visual*	NONE	**VLITE**	---	---
Sand/Dirt	scalar	Visual*	NONE	**NONE**	---	---
Appearance	scalar	Visual*	NORML	**NORML**	---	---
Odor	scalar	Visual*	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	**NEG**	NEG	NEG
Sodium	ppm	ASTM D5185(m)	>192	**<1**	<1	<1
Boron	ppm	ASTM D5185(m)		**2**	14	11
Barium	ppm	ASTM D5185(m)		**0**	0	0
Molybdenum	ppm	ASTM D5185(m)		**1**	11	11
Manganese	ppm	ASTM D5185(m)		**0**	<1	0
Magnesium	ppm	ASTM D5185(m)		**834**	96	40
Calcium	ppm	ASTM D5185(m)	3780	**1288**	3573	3064
Phosphorus	ppm	ASTM D5185(m)	1370	**1009**	761	664
Zinc	ppm	ASTM D5185(m)	1500	**1161**	764	705
Sulfur	ppm	ASTM D5185(m)	3800	**2551**	2457	2145
Oxidation	Abs/.1mm	ASTM D7414*	>25	**5.3**	5.1	5.1
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	**14.0**	13.2	13.4

FT-IR (Direct Trend)

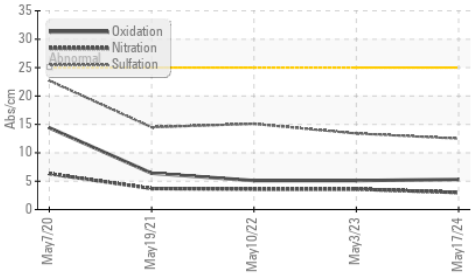

Viscosity @ 100°C

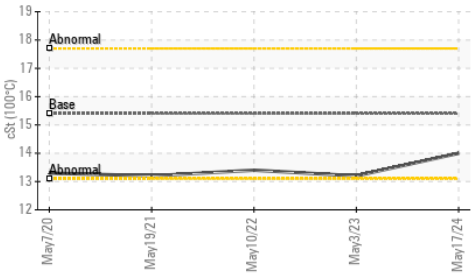

Iron (ppm)

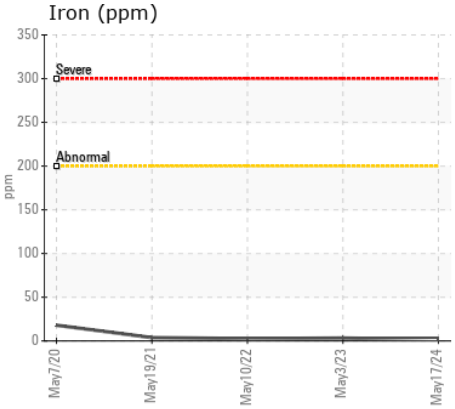

Lead (ppm)

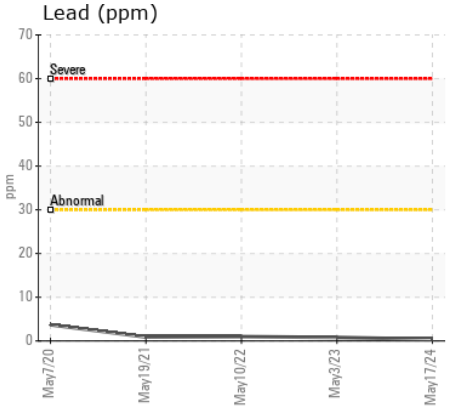

Aluminum (ppm)

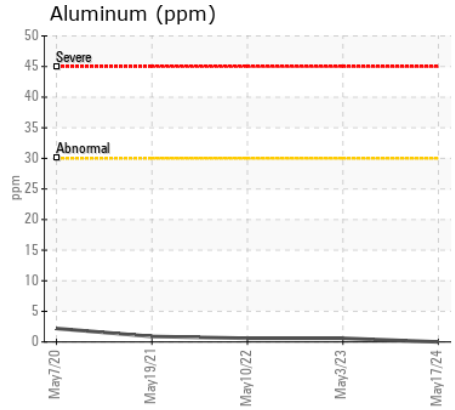

Chromium (ppm)

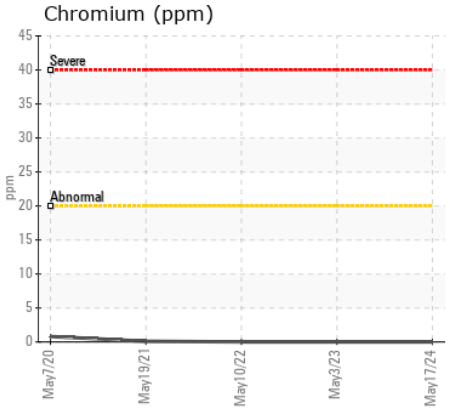

Copper (ppm)

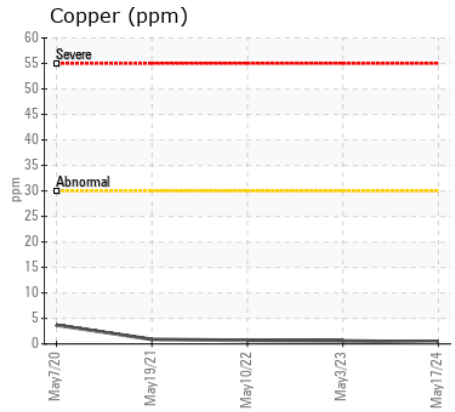

Silicon (ppm)

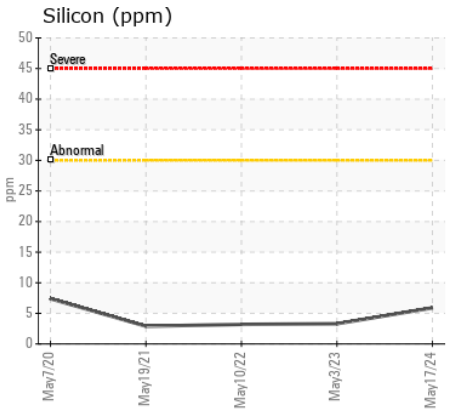

Viscosity @ 100°C

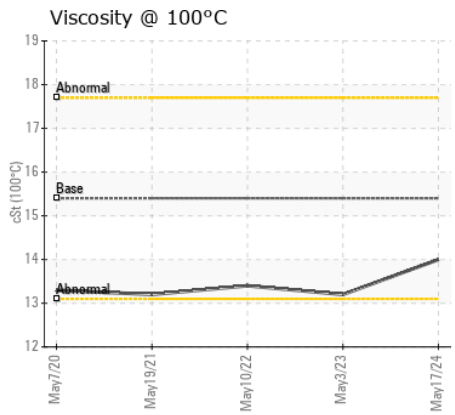

Soot %

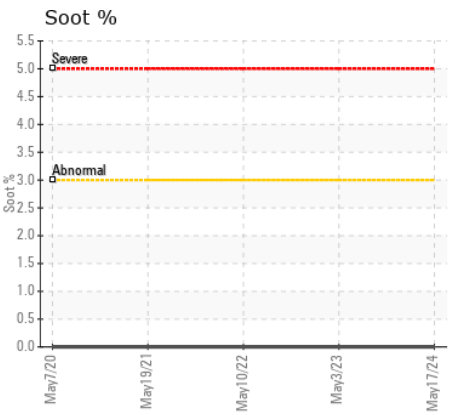

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0006188 **Received** : 24 May 2024
Lab Number : 02637380 **Tested** : 24 May 2024
Unique Number : 5786542 **Diagnosed** : 24 May 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: Visual)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

POWER STATION INC.
1050 JAYSON COURT
MISSISSAUGA, ON
CA L4W 2V5
Contact: Brett Kinkley
Bkinkley@pwrstn.com
T:
F: (905)565-8544