



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	ABNORMAL

Area
BRUCE A/4/33120
Machine Id
4-33120-P1-PM Lower Brg
Component
Lower Bearing
Fluid
MOBIL DTE 746 (21 GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0914986	WC	WC0815762
Sample Date		Client Info		06 May 2024	12 Feb 2024	08 Nov 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

WEAR

The Direct-Reading Ferrographic data (DL, DS, %large) is normal. All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>1	0	0	0
Chromium	ppm	ASTM D5185(m)	>1	0	0	0
Nickel	ppm	ASTM D5185(m)	>1	0	0	<1
Titanium	ppm	ASTM D5185(m)	>5	0	0	0
Silver	ppm	ASTM D5185(m)		0	0	<1
Aluminum	ppm	ASTM D5185(m)	>1	0	<1	0
Lead	ppm	ASTM D5185(m)	>3	0	<1	<1
Copper	ppm	ASTM D5185(m)	>1	0	0	<1
Tin	ppm	ASTM D5185(m)	>1	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Large Particles		DR-Ferr*		1.9	1.0	3.7
Small Particles		DR-Ferr*		1.3	0.6	2.8
Total Particles		DR-Ferr*	>---	3.2	1.6	6.5
Large Particles Percentage	%	DR-Ferr*		18.7	25	13.8
Severity Index		DR-Ferr*		1	0	3

CONTAMINATION











The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Silicon	ppm	ASTM D5185(m)	>5	0	0	0
Potassium	ppm	ASTM D5185(m)	>20	0	1	0
Water	%	ASTM D6304*	>0.005	0.001	0.002	0.001
ppm Water	ppm	ASTM D6304*	>50	10	16	5
Particles >4µm		ASTM D7647	>10000	527	1678	528
Particles >6µm		ASTM D7647	>2500	84	321	118
Particles >14µm		ASTM D7647	>160	6	24	12
Particles >21µm		ASTM D7647	>40	2	6	3
Particles >38µm		ASTM D7647	>10	0	2	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/14	16/14/10	18/16/12	16/14/11
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.005	NEG	NEG	NEG

FLUID CONDITION

Viscosity of sample indicates oil is within ISO 32 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185(m)	>5	0	0	0
Boron	ppm	ASTM D5185(m)		0	0	<1
Barium	ppm	ASTM D5185(m)		0	0	<1
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		<1	<1	0
Calcium	ppm	ASTM D5185(m)		0	0	<1
Phosphorus	ppm	ASTM D5185(m)		0	0	0
Zinc	ppm	ASTM D5185(m)		<1	2	<1
Sulfur	ppm	ASTM D5185(m)		12	0	20
Acid Number (AN)	mg KOH/g	ASTM D974*	0.10	0.09	0.08	0.11
Visc @ 40°C	cSt	ASTM D7279(m)	44.0	30.5	30.4	30.4

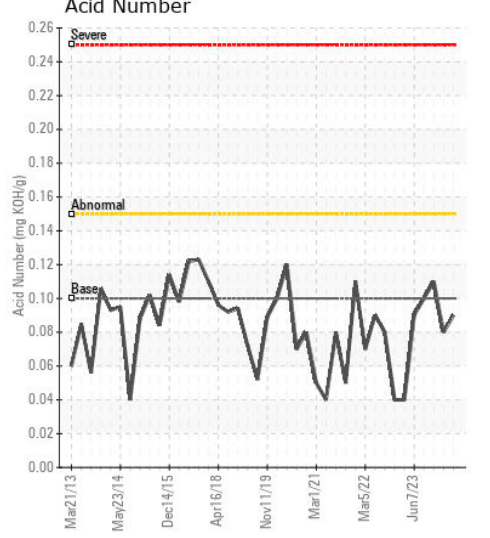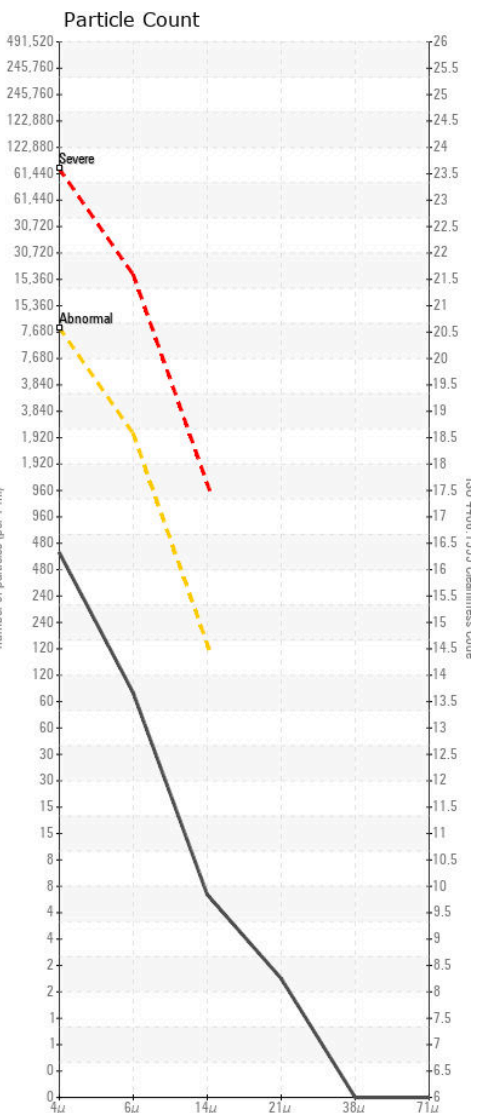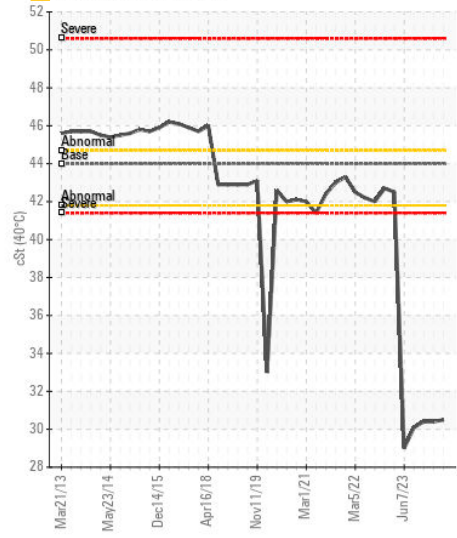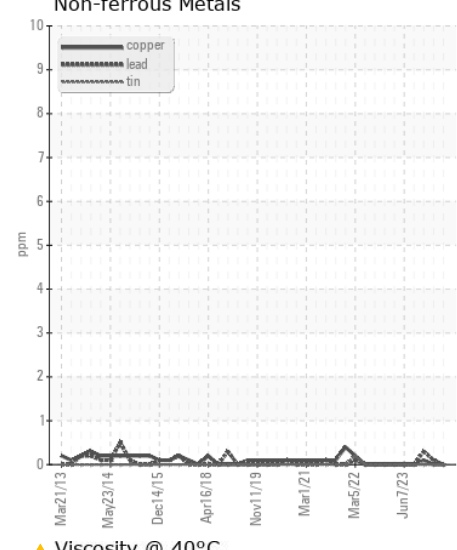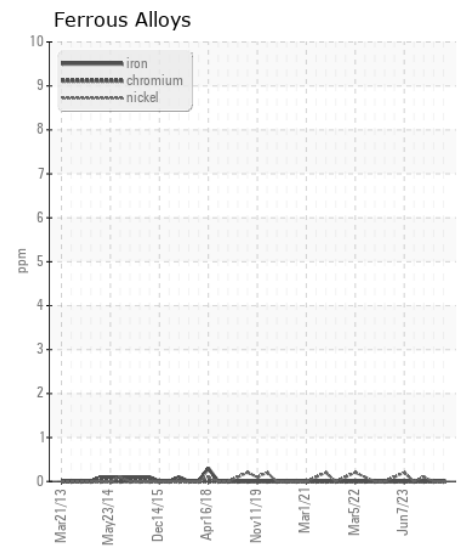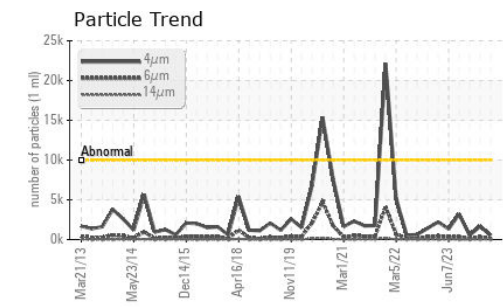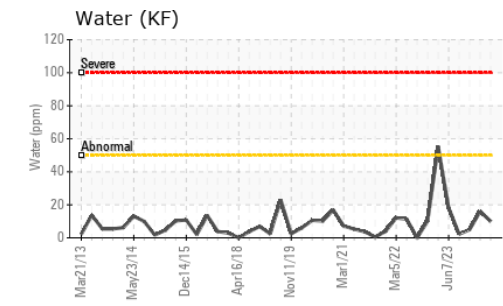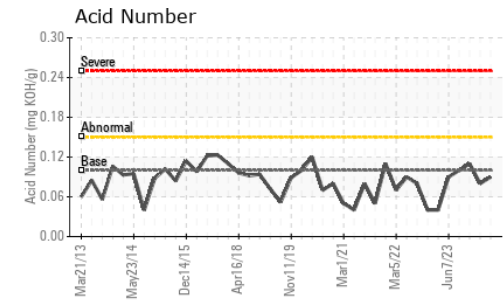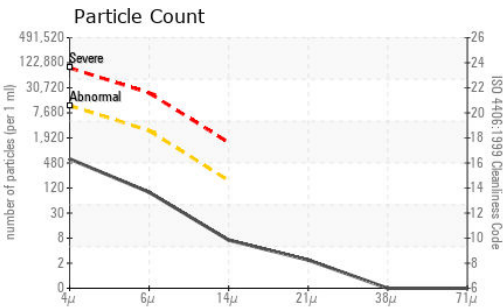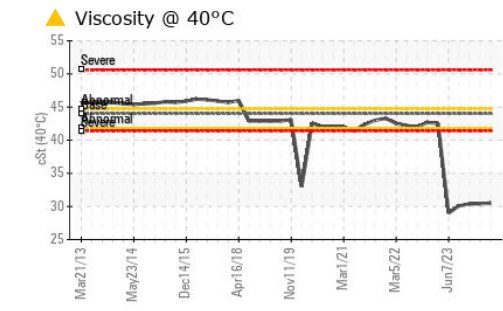

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0914986 **Received** : 27 May 2024
Lab Number : 02637676 **Tested** : 28 May 2024
Unique Number : 5786838 **Diagnosed** : 28 May 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: Bottom, DR-Ferr, TAN Man)

Bruce Power - Bruce A PdM
 P.O.Box 1540, 177 Tie Road., RM-222 U2 Column 2N11 615
 Tiverton, ON
 CA N0G 2T0
 Contact: Pierre Adouki
 pierre.adouki@brucepower.com
 T: (519)361-2673
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.