



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id  
**#2 AUX GENERATOR**  
 Component  
**2 Diesel Engine**  
 Fluid  
**MOBIL DELVAC 1640 (1500 LTR)**

## RECOMMENDATION

Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using MAR 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. this testkit includes BN to determine the suitability of the oil for continued use.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0926682	WC0803095	WC0803035
Sample Date		Client Info		19 May 2024	20 Apr 2024	23 Mar 2024
Machine Age	hrs	Client Info		25321	25068	24636
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	Not Changd	N/A
Filter Changed		Client Info		N/A	Not Changd	N/A
Sample Status				NORMAL	NORMAL	NORMAL

## WEAR

Component wear rates appear to be normal (unconfirmed).

Iron	ppm	ASTM D5185(m)	>120	3	3	2
Chromium	ppm	ASTM D5185(m)	>10	0	0	0
Nickel	ppm	ASTM D5185(m)	>5	0	0	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)	>5	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>40	0	0	0
Copper	ppm	ASTM D5185(m)	>300	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>10	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE

## CONTAMINATION

There is no indication of any contamination in the oil.


Silicon	ppm	ASTM D5185(m)	>25	6	5	6
Potassium	ppm	ASTM D5185(m)	>20	0	0	0
Fuel		WC Method	>4.0	<1.0	<1.0	<1.0
Water		WC Method	>0.1	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*		0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	7.1	6.7	6.7
Sulfation	Abs/.1mm	ASTM D7415*	>30	16.9	16.1	16.2
Silt	scalar	Visual*	NONE	VLITE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	VLITE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG

## FLUID CONDITION


The condition of the oil is acceptable for the time in service (unconfirmed).

Sodium	ppm	ASTM D5185(m)		<1	<1	<1
Boron	ppm	ASTM D5185(m)		1	1	1
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		0	<1	<1
Manganese	ppm	ASTM D5185(m)		<1	<1	0
Magnesium	ppm	ASTM D5185(m)		220	223	226
Calcium	ppm	ASTM D5185(m)		3644	3757	3687
Phosphorus	ppm	ASTM D5185(m)		873	887	880
Zinc	ppm	ASTM D5185(m)		984	996	994
Sulfur	ppm	ASTM D5185(m)		8076	8202	8104
Oxidation	Abs/.1mm	ASTM D7414*	>25	10.7	10.1	10.3
Visc @ 100°C	cSt	ASTM D7279(m)	14.7	14.1	14.2	14.1


**FT-IR (Direct Trend)**

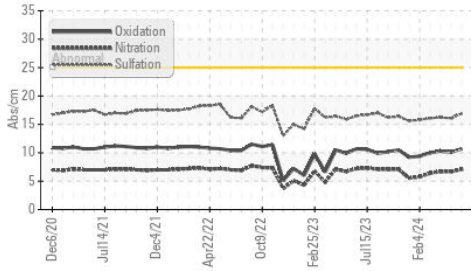


**Viscosity @ 100°C**

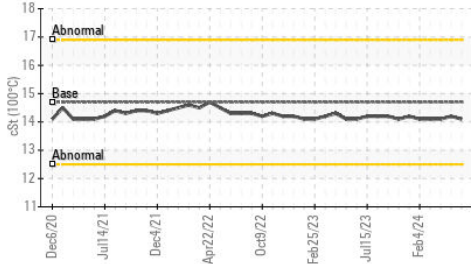


**Ferrous Alloys**

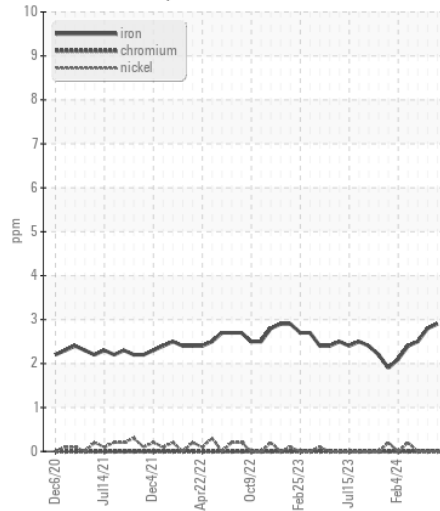

**Non-ferrous Metals**

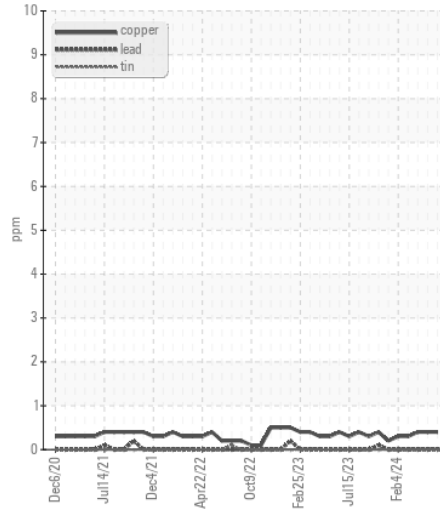

**Viscosity @ 100°C**

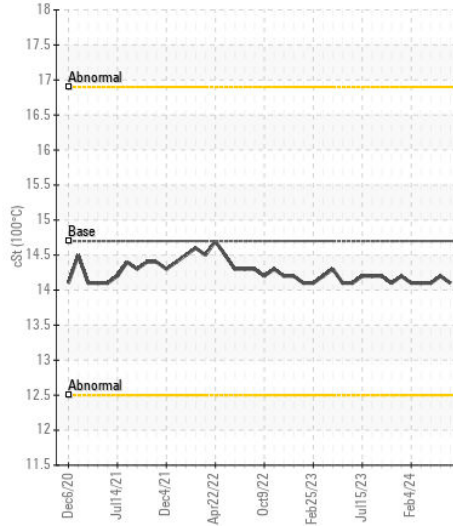

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0926682  
**Lab Number** : 02637849  
**Unique Number** : 5787011  
**Test Package** : MAR 1

**Siem Offshore Canada LP.**  
 M/V Avalon Sea, 140 WATER STREET SUITE 1000  
 ST. JOHN'S, NL  
 CA A1C 6H6  
 Contact: Avalon Sea  
 ecr@avalonsea.siemoffshore.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

T:  
F: