



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	SEVERE
FLUID CONDITION	ABNORMAL

Area
[01-27023]
Machine Id
OW384676
Component
Diesel Engine
Fluid
{not provided} (--- GAL)

RECOMMENDATION

We advise that you check the fuel injection system. We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample.

WEAR

All component wear rates are normal.













CONTAMINATION

There is a high amount of fuel present in the oil. Tests confirm the presence of fuel in the oil.

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. Fuel is present in the oil and is lowering the viscosity. The oil is no longer serviceable due to the presence of contaminants.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WA0021534	---	---
Sample Date		Client Info		22 May 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		50	---	---
Filter Age	hrs	Client Info		50	---	---
Oil Changed		Client Info		Not Changd	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				SEVERE	---	---
Iron	ppm	ASTM D5185(m)	>100	19	---	---
Chromium	ppm	ASTM D5185(m)	>20	<1	---	---
Nickel	ppm	ASTM D5185(m)	>4	2	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	3	---	---
Lead	ppm	ASTM D5185(m)	>40	3	---	---
Copper	ppm	ASTM D5185(m)	>330	10	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
Silicon	ppm	ASTM D5185(m)	>25	16	---	---
Potassium	ppm	ASTM D5185(m)	>20	3	---	---
Fuel	%	ASTM D7593*	>5	▲ 8.2	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	11.3	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	23.5	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---
Sodium	ppm	ASTM D5185(m)		7	---	---
Boron	ppm	ASTM D5185(m)		67	---	---
Barium	ppm	ASTM D5185(m)		0	---	---
Molybdenum	ppm	ASTM D5185(m)		51	---	---
Manganese	ppm	ASTM D5185(m)		<1	---	---
Magnesium	ppm	ASTM D5185(m)		64	---	---
Calcium	ppm	ASTM D5185(m)		2026	---	---
Phosphorus	ppm	ASTM D5185(m)		671	---	---
Zinc	ppm	ASTM D5185(m)		823	---	---
Sulfur	ppm	ASTM D5185(m)		1777	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	17.7	---	---
Base Number (BN)	mg KOH/g	ASTM D2896*		6.11	---	---
Visc @ 100°C	cSt	ASTM D7279(m)		▲ 12.1	---	---

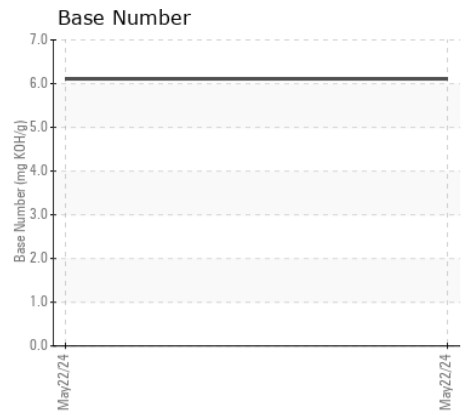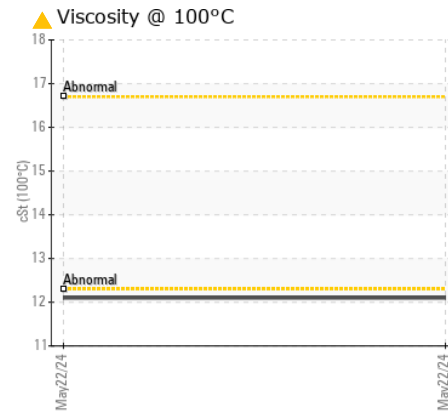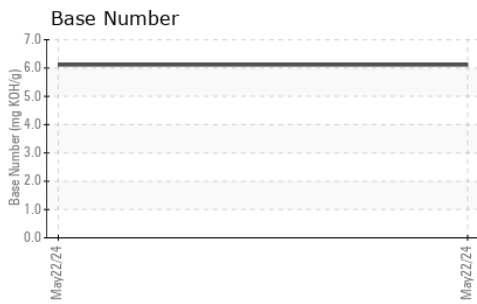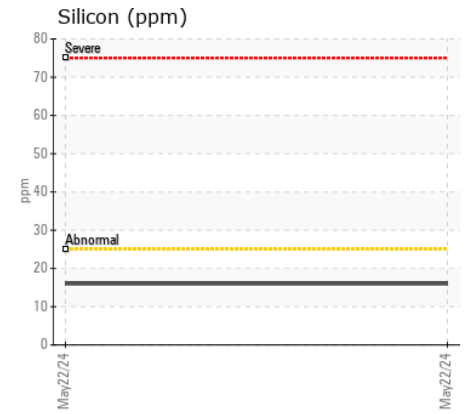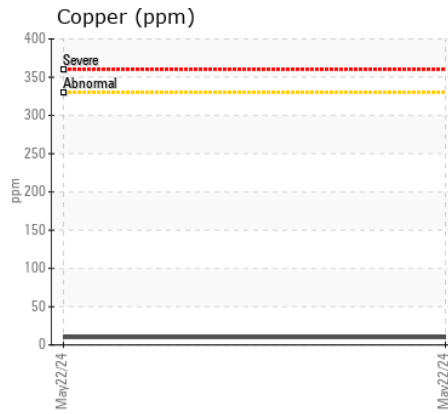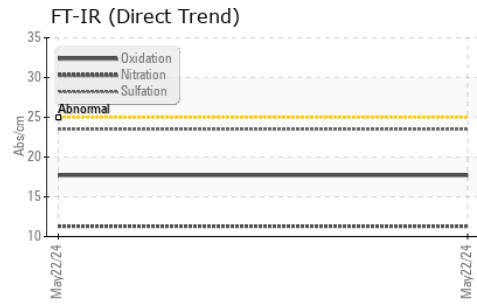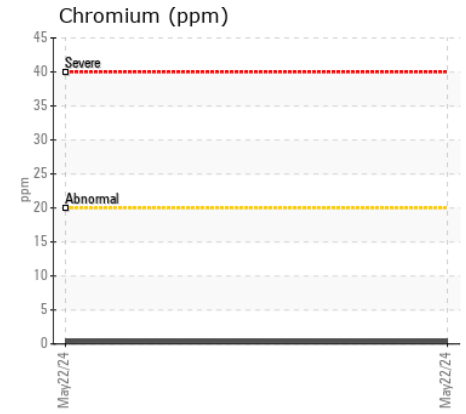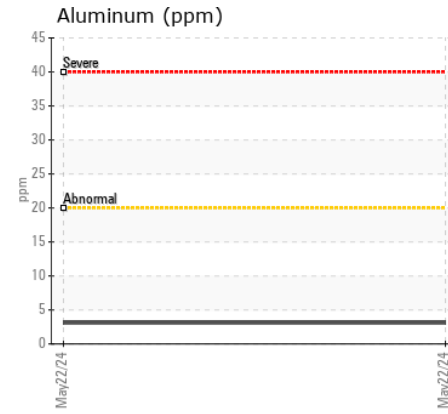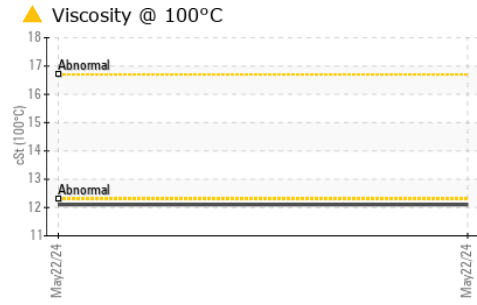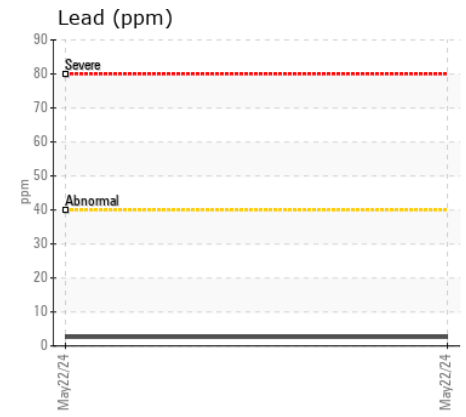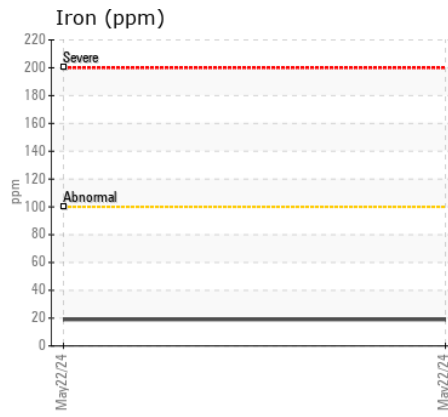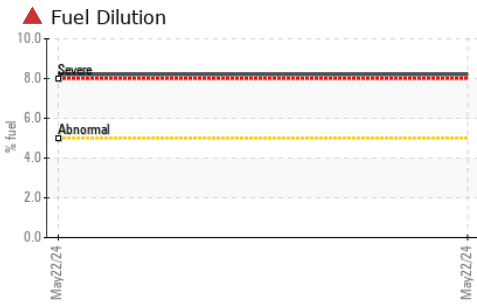

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0021534 **Received** : 31 May 2024
Lab Number : 02639133 **Tested** : 03 Jun 2024
Unique Number : 5788295 **Diagnosed** : 03 Jun 2024 - Wes Davis
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

CHANTIER BLYACHT
 1225 BOUL. CHAMPLAIN
 QUEBEC, QC
 CA G1K 0A2
 Contact: Service Manager
 rboulet@chantierblyacht.com
 T: (514)961-2206
 F: